

ADDENDUM

THE FOLLOWING DRAWINGS ARE
ATTACHED HERETO:
11" x 17": E3.1 and E3.2

ADDENDUM NO. 3

ARCHITECT:
City of Duluth
Tari Rayala

PROJECT:
Duluth City Hall Generator
Replacement
G&M Project No. 83295

OWNER:
City of Duluth
Joe Miller

DATE:
September 18, 2014

Sent from:

St. Paul Office
700 Rosedale Tower
1700 Highway 36 West
St. Paul, MN 55113
Phone: 651-639-9606
FAX: 651-639-9618

Duluth Office
Suite 310
501 South Lake Avenue
Duluth, MN 55802
Phone: 218-722-2555
FAX: 218-722-9306

Santa Clarita Office
Suite 205
26415 Carl Boyer Drive
Santa Clarita, CA 91350
Phone: 661-291-1978
FAX: 661-291-6213

To: Prime Contract Bidders and all others to whom the Project Manual and the Project Drawings have been issued by the Architect/Engineer or Contractor.

This Addendum is a Contract Document and may apply to any or all Contracts and subcontracts. Unless otherwise specified herein or shown on the attached drawings (if any), all work required by this Addendum shall be in complete accord with the Contract Documents and subsequent Addenda thereto.


The items listed in this Addendum are not in any order in regard to the Project Drawings or the Project Manual. All contractors are cautioned to examine each and every item of this Addendum.

The bidder shall insert the Addendum number in the space indicated on the Project Proposal Form. Failure to comply may result in the bid being rejected.

<u>ITEM</u>	<u>REFERENCE</u>	<u>CHANGE/COMMENTS</u>
-------------	------------------	------------------------

CHANGES TO ELECTRICAL DRAWINGS

- | | | |
|----|---------------|---|
| 1. | E3.1 and E3.2 | Refer to attached for inclusion of ATS-2 and panelboard LP3A-G05 as add alternate. Include add alternate price on separate company letterhead and attach to bid form. |
|----|---------------|---|

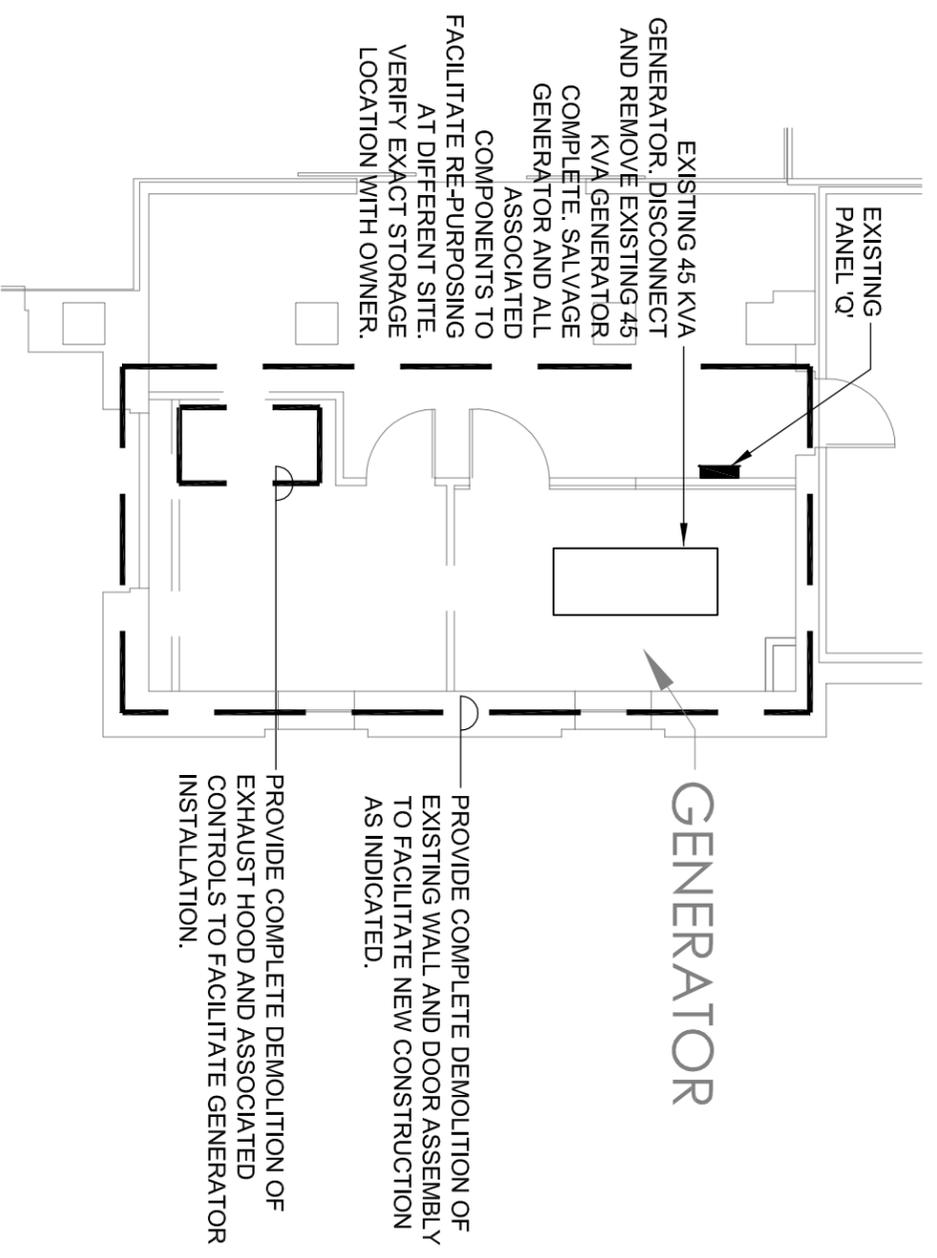


1 ENLARGED DEMOLITION PLAN

E3.1 SCALE: 0' 8'



NUMBERED NOTES: X

- 1 PROVIDE 120V CONNECTION TO BATTERY CHARGER.
- 2 PROVIDE 120V CONNECTION TO BLOCK HEATER.
- 3 PROVIDE 120V CONNECTION AND CONTROL RELAY FOR RECIRCULATION DAMPER ASSEMBLY. COORDINATE VOLTAGE AND CONNECTION REQUIREMENTS WITH DIVISION 23, TYPICAL OF THREE (3) LOCATIONS.
- 4 PROVIDE 120V CONNECTION AND CONTROL RELAY FOR INTAKE AIR DAMPER ASSEMBLY AND LIMIT SWITCH FOR ENGINE START SIGNAL. COORDINATE VOLTAGE AND CONNECTION REQUIREMENTS WITH DIVISION 23, TYPICAL OF TWO (2) LOCATIONS.

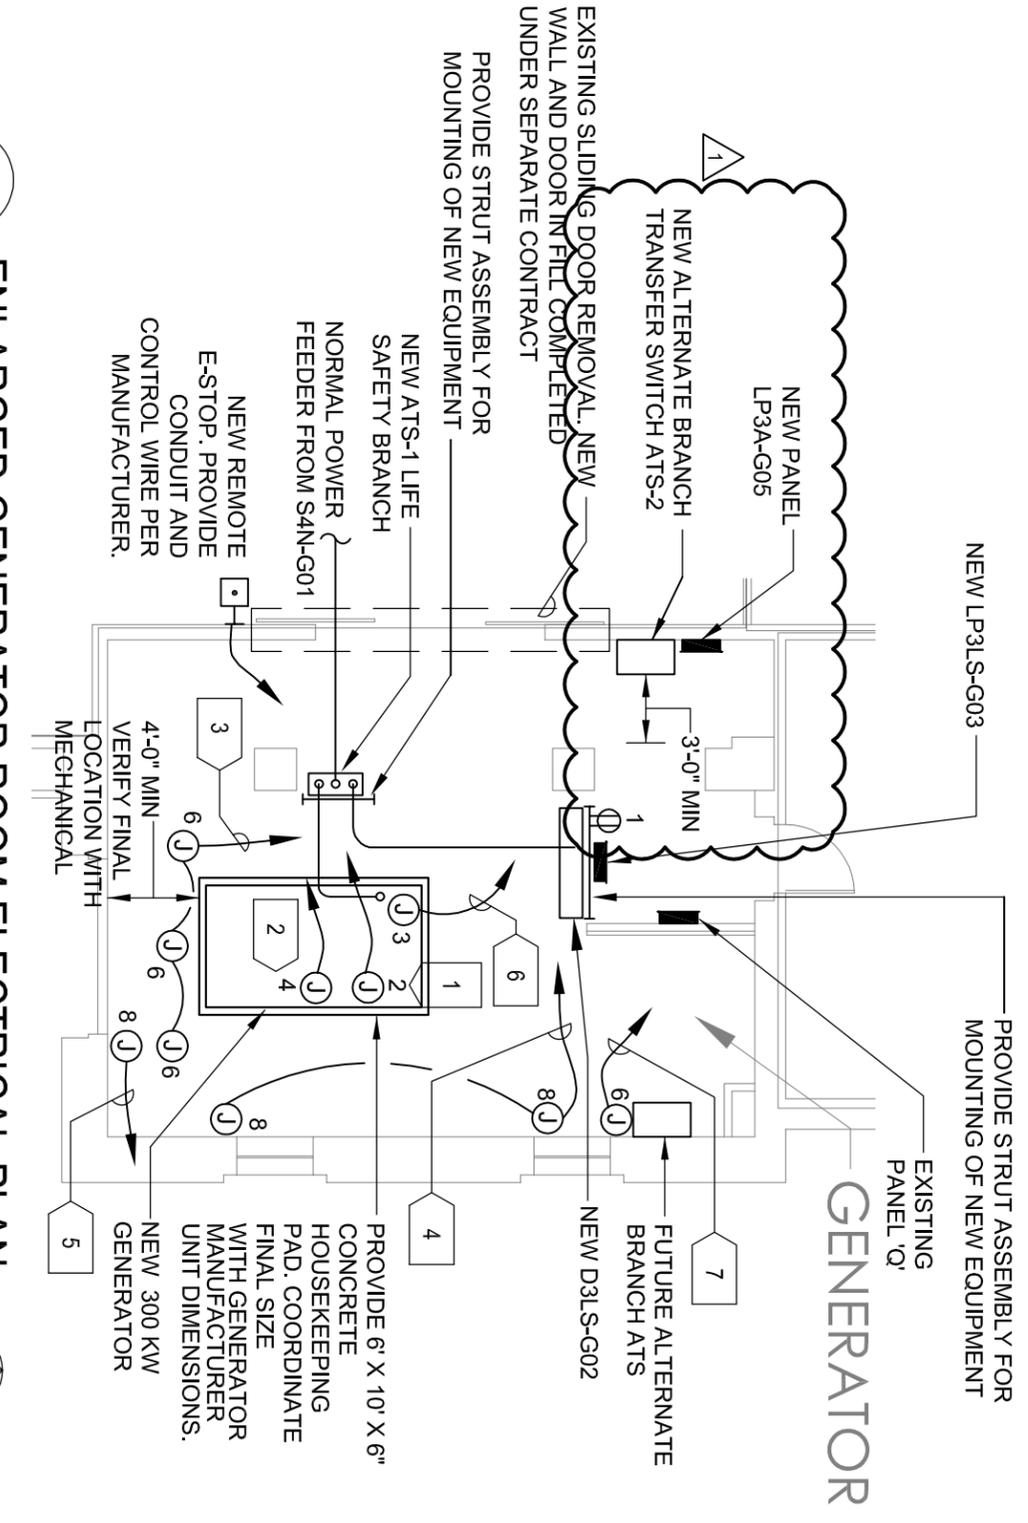

2 ENLARGED GENERATOR ROOM ELECTRICAL PLAN

E3.1 SCALE: 0' 8'



LP3A-G05		LP3A-G05		LP3A-G05				
PANEL NAME:	LP3A-G05	VOLT:	208Y/120	BUS SIZE:	200 AMP/PS			
LOCATION:	GEN ROOM	PH:	3	MAIN BRKR:	200 AMP/PS			
MOUNTING:	SURFACE	WIRE:	4	FEED THROUGH LUGS:				
RM. NO.	LOAD DESCRIPTION	TYPE	BRKR	CCT	BRKR	TYPE	LOAD DESCRIPTION	RM. NO.
SPARE	SPARE	20/1	1	2	20/1	SPARE	SPARE	
SPARE	SPARE	20/1	3	4	20/1	SPARE	SPARE	
SPARE	SPARE	20/1	5	6	20/1	SPARE	SPARE	
SPARE	SPARE	20/1	7	8	20/1	SPARE	SPARE	
SPARE	SPARE	20/1	9	10	20/1	SPARE	SPARE	
SPARE	SPARE	20/1	11	12	20/1	SPARE	SPARE	
SPARE	SPARE	20/1	13	14	20/1	SPARE	SPARE	
SPARE	SPARE	20/1	15	16	20/1	SPARE	SPARE	
SPARE	SPARE	20/1	17	18	20/1	SPARE	SPARE	
SPARE	SPARE	20/1	19	20	20/1	SPARE	SPARE	
SPARE	SPARE	20/1	21	22		SPACE & BUS		
SPARE	SPARE	20/1	23	24		SPACE & BUS		
SPARE	SPARE	20/1	25	26		SPACE & BUS		
SPARE	SPARE	20/1	27	28		SPACE & BUS		
SPARE	SPARE	20/1	29	30		SPACE & BUS		
SPARE	SPARE	20/1	31	32		SPACE & BUS		
SPARE	SPARE	20/1	33	34		SPACE & BUS		
SPARE	SPARE	20/1	35	36		SPACE & BUS		
SPARE	SPARE	20/1	37	38		SPACE & BUS		
SPARE	SPARE	20/1	39	40		SPACE & BUS		
SPARE	SPARE	20/1	41	42		SPACE & BUS		

GENERAL NOTES:

- A RELOCATE EXISTING GENERATOR ROOM LIGHTING FIXTURES AS REQUIRED FOR UNIFORM COVERAGE AND SINGLE AREA CONTROL SWITCH. RECONNECT TO NEW PANEL LP3LS-C03, CIRCUIT 10.

REVISIONS:

1	ADDENDUM #3 - 9/18/14
---	-----------------------

I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed PROFESSIONAL ENGINEER under the laws of the State of Minnesota.

Signature: *Dave T. Blume*
 Name: DAVE T. BLUME
 License #: 24671
 Date: 07/17/14