


ATTACHEMENT A

2016 Contractor Gas Blanket Project City Wide PLAN SET

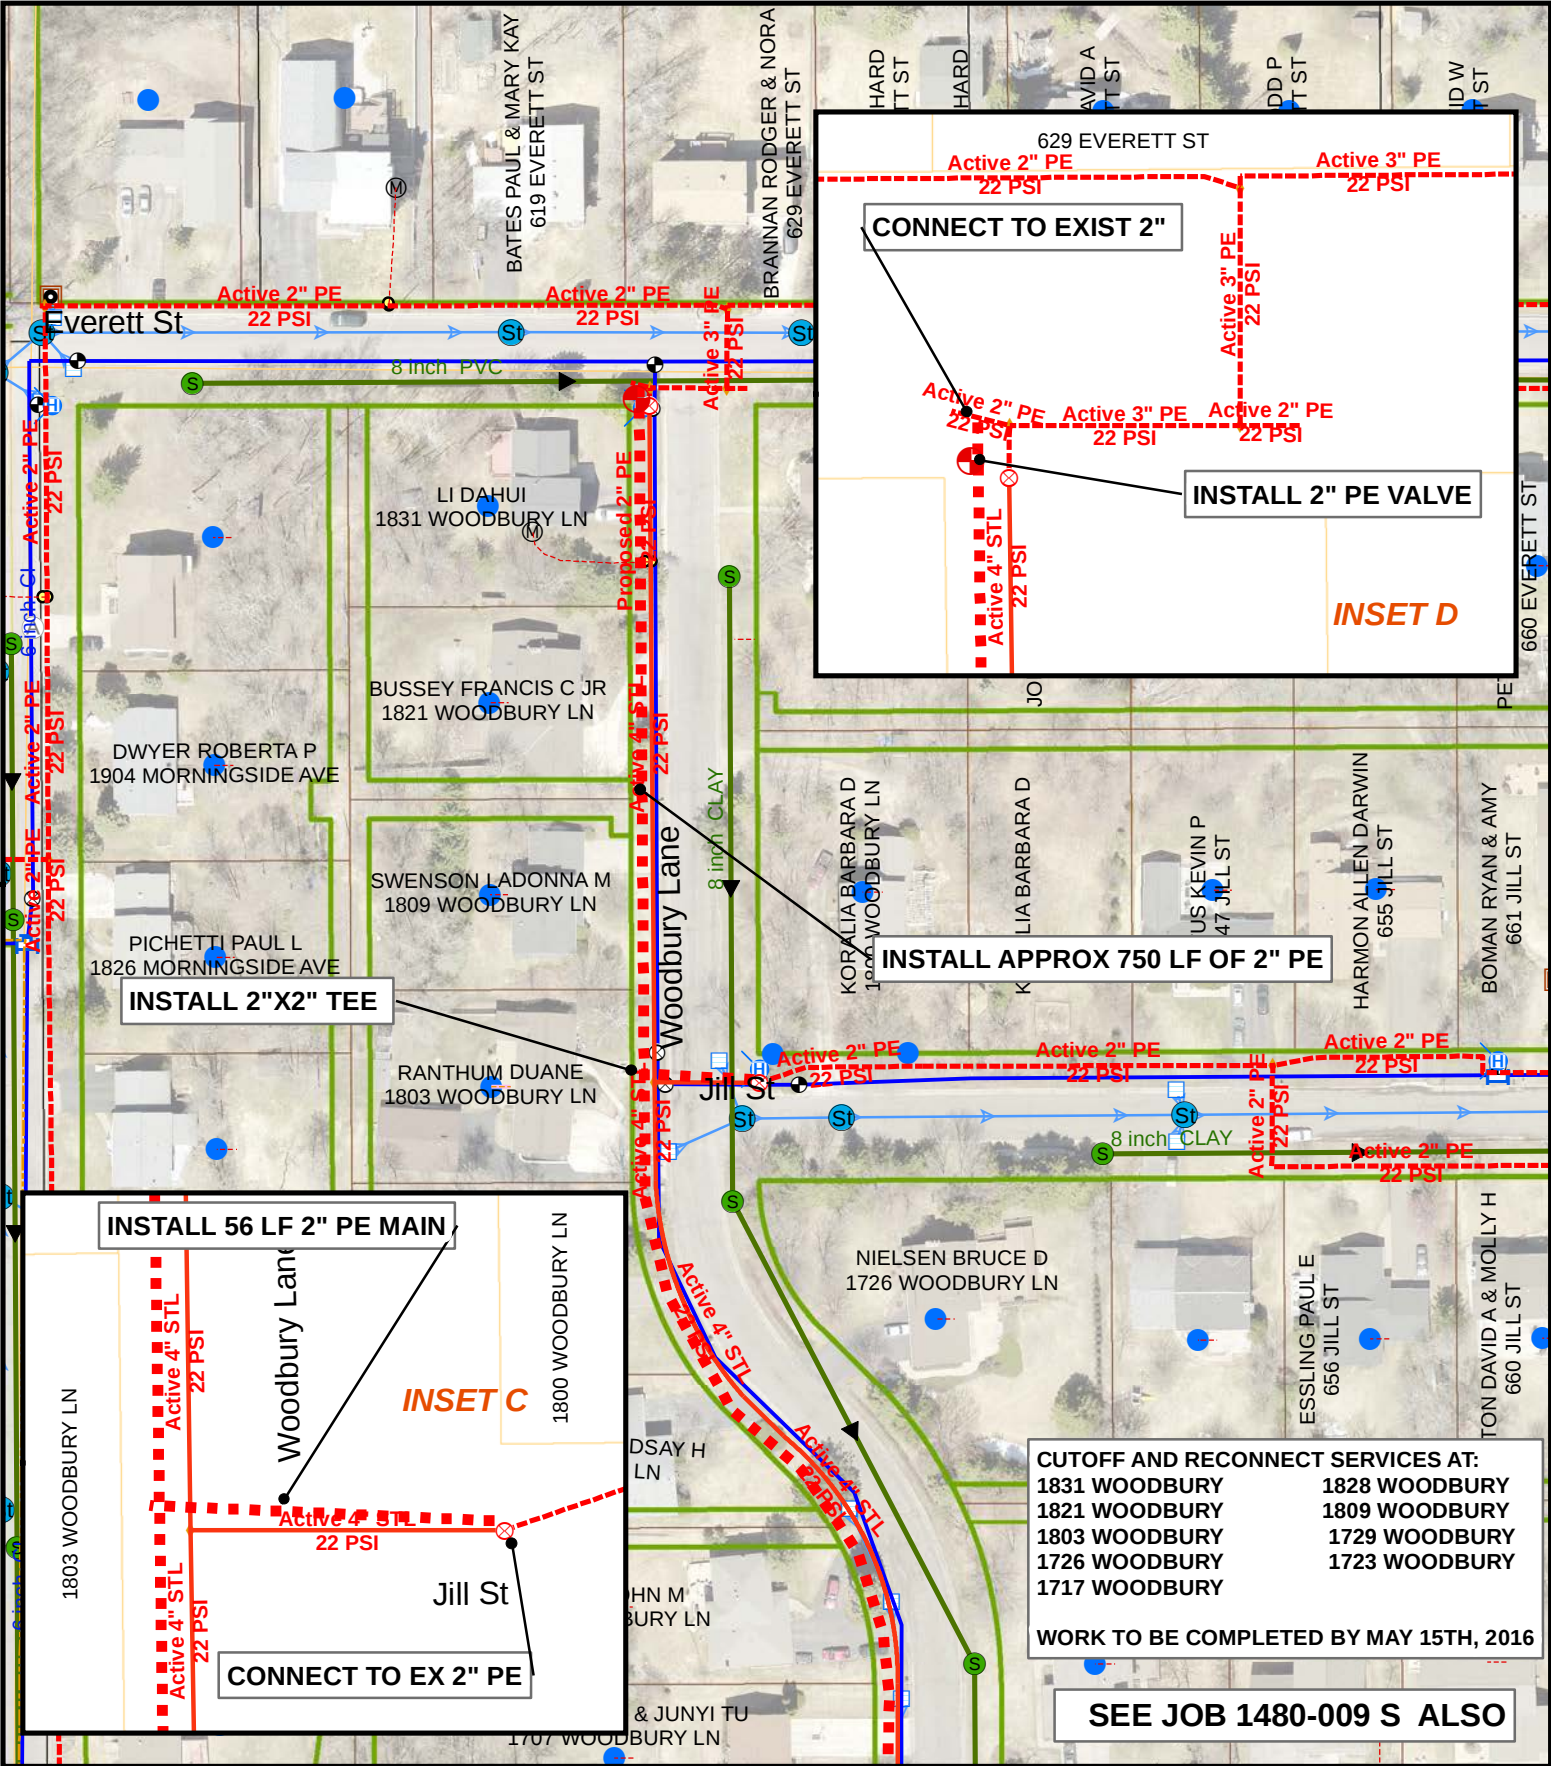

DATE COMPLETED:

INSPECTOR:

N

W

E

S

NTS

EXCESS FLOW VALVE: N/A

APPL #: N/A

EAM #: 428370

ZONE: 3

PLAN OF: INSTALL NEW 2" PE GAS MAIN

LOCATION: WOODBURY LANE-NORTH

FROM: EVERETT ST

TO: N OF CHERIE LANE

DEPARTMENT OF PUBLIC WORKS AND UTILITIES

THE CITY OF


DULUTH

MINNESOTA


JOB NO: 1480-009 N

DRAWN BY: MHW

DATE: 2/5/2016

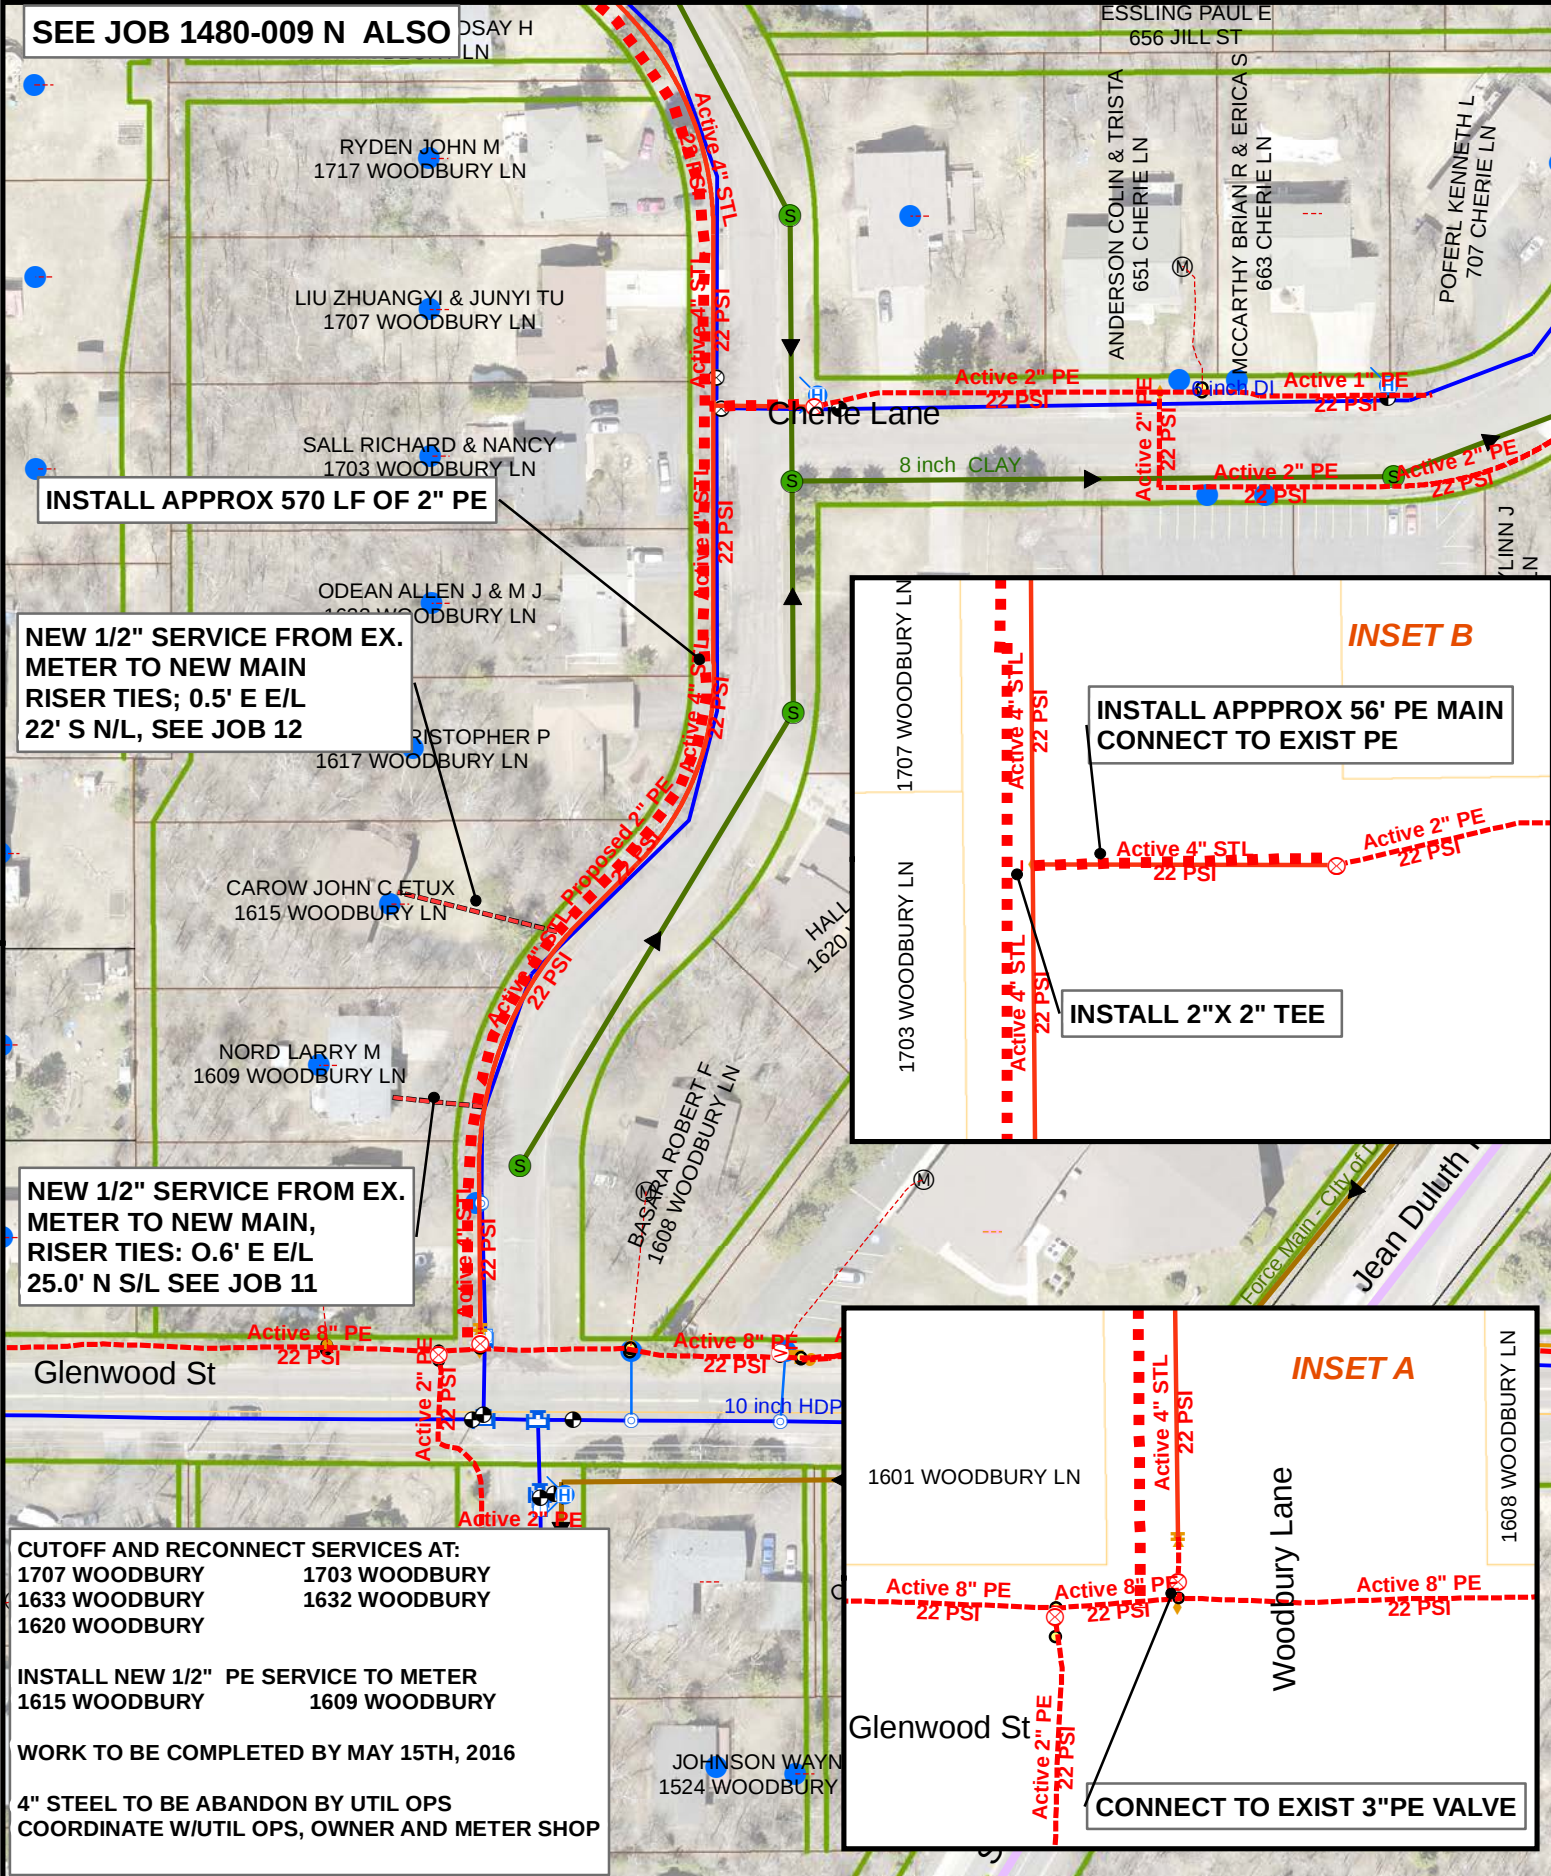


DATE COMPLETED:		INSPECTOR:	
		NTS	
EXCESS FLOW VALVE: <u>N/A</u> APPL #: <u>N/A</u> EAM #: <u>428370</u> ZONE: <u>3</u>			
PLAN OF: <u>INSTALL NEW 2" PE GAS MAIN</u>			
LOCATION: <u>WOODBURY LANE-SOUTH</u>			
FROM: <u>N OF CHERIE LANE</u> TO: <u>GLENWOOD ST</u>			
DEPARTMENT OF PUBLIC WORKS AND UTILITIES			
		JOB NO: <u>1480-009 S</u>	
		DRAWN BY: <u>MHW</u>	
		DATE: <u>2/5/2016</u>	

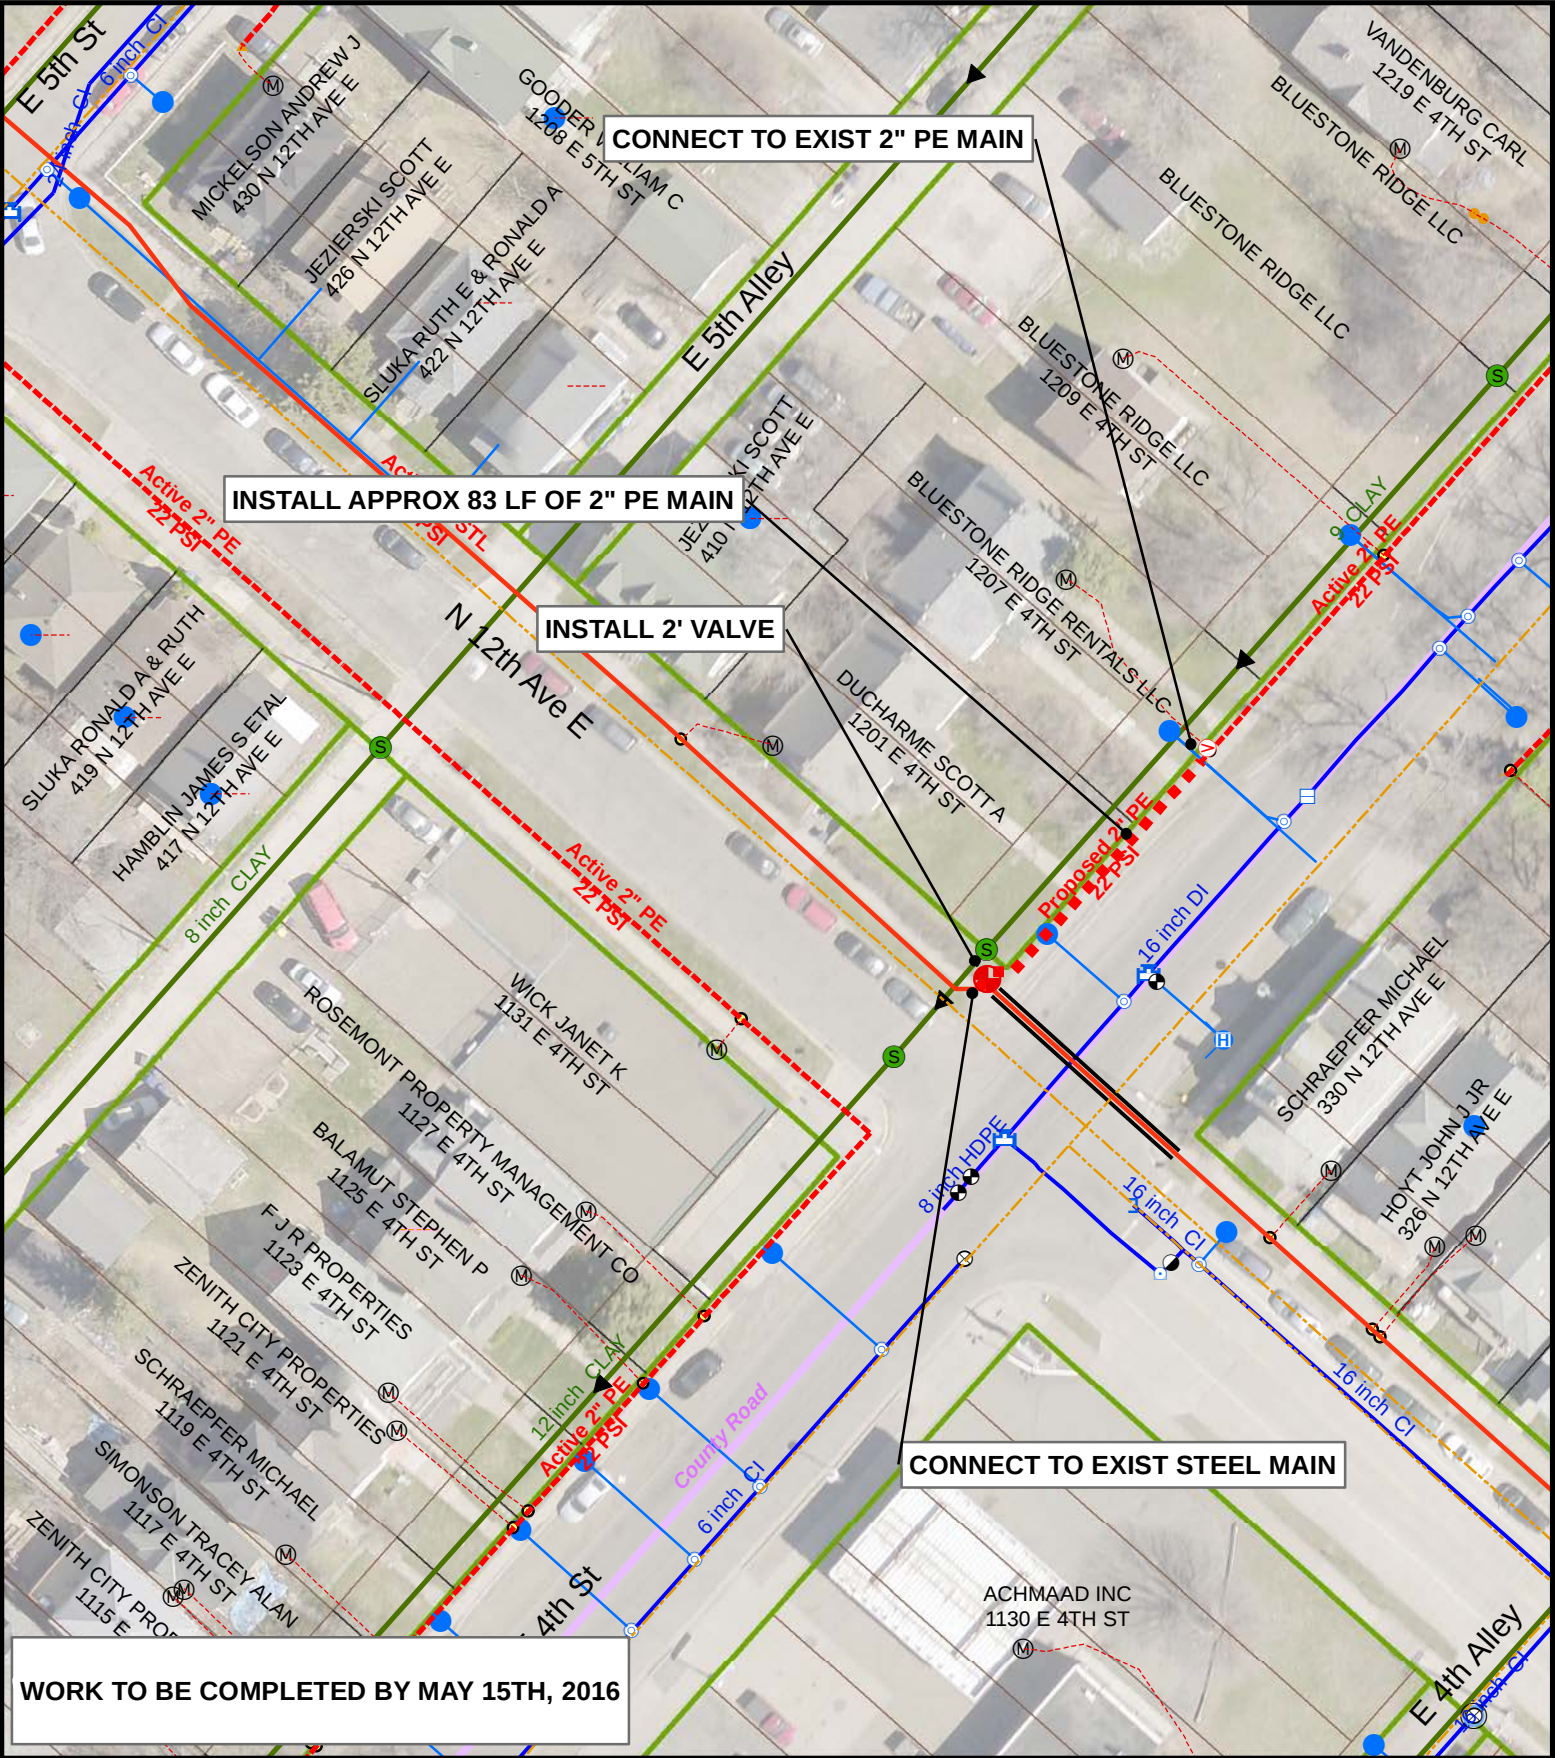

DATE COMPLETED:

INSPECTOR:



EXCESS FLOW VALVE: N/A APPL #: N/A EAM #: 428370 ZONE: 4

PLAN OF: INSTALL 2' PE GAS MAIN

LOCATION: N 12TH AVE E & E 4TH ST

FROM: 30' NE/CL N 12TH AVE E TO: 110' NLY


DEPARTMENT OF PUBLIC WORKS AND UTILITIES



JOB NO: 1480-010

DRAWN BY: MHW

DATE: 2/4/2016

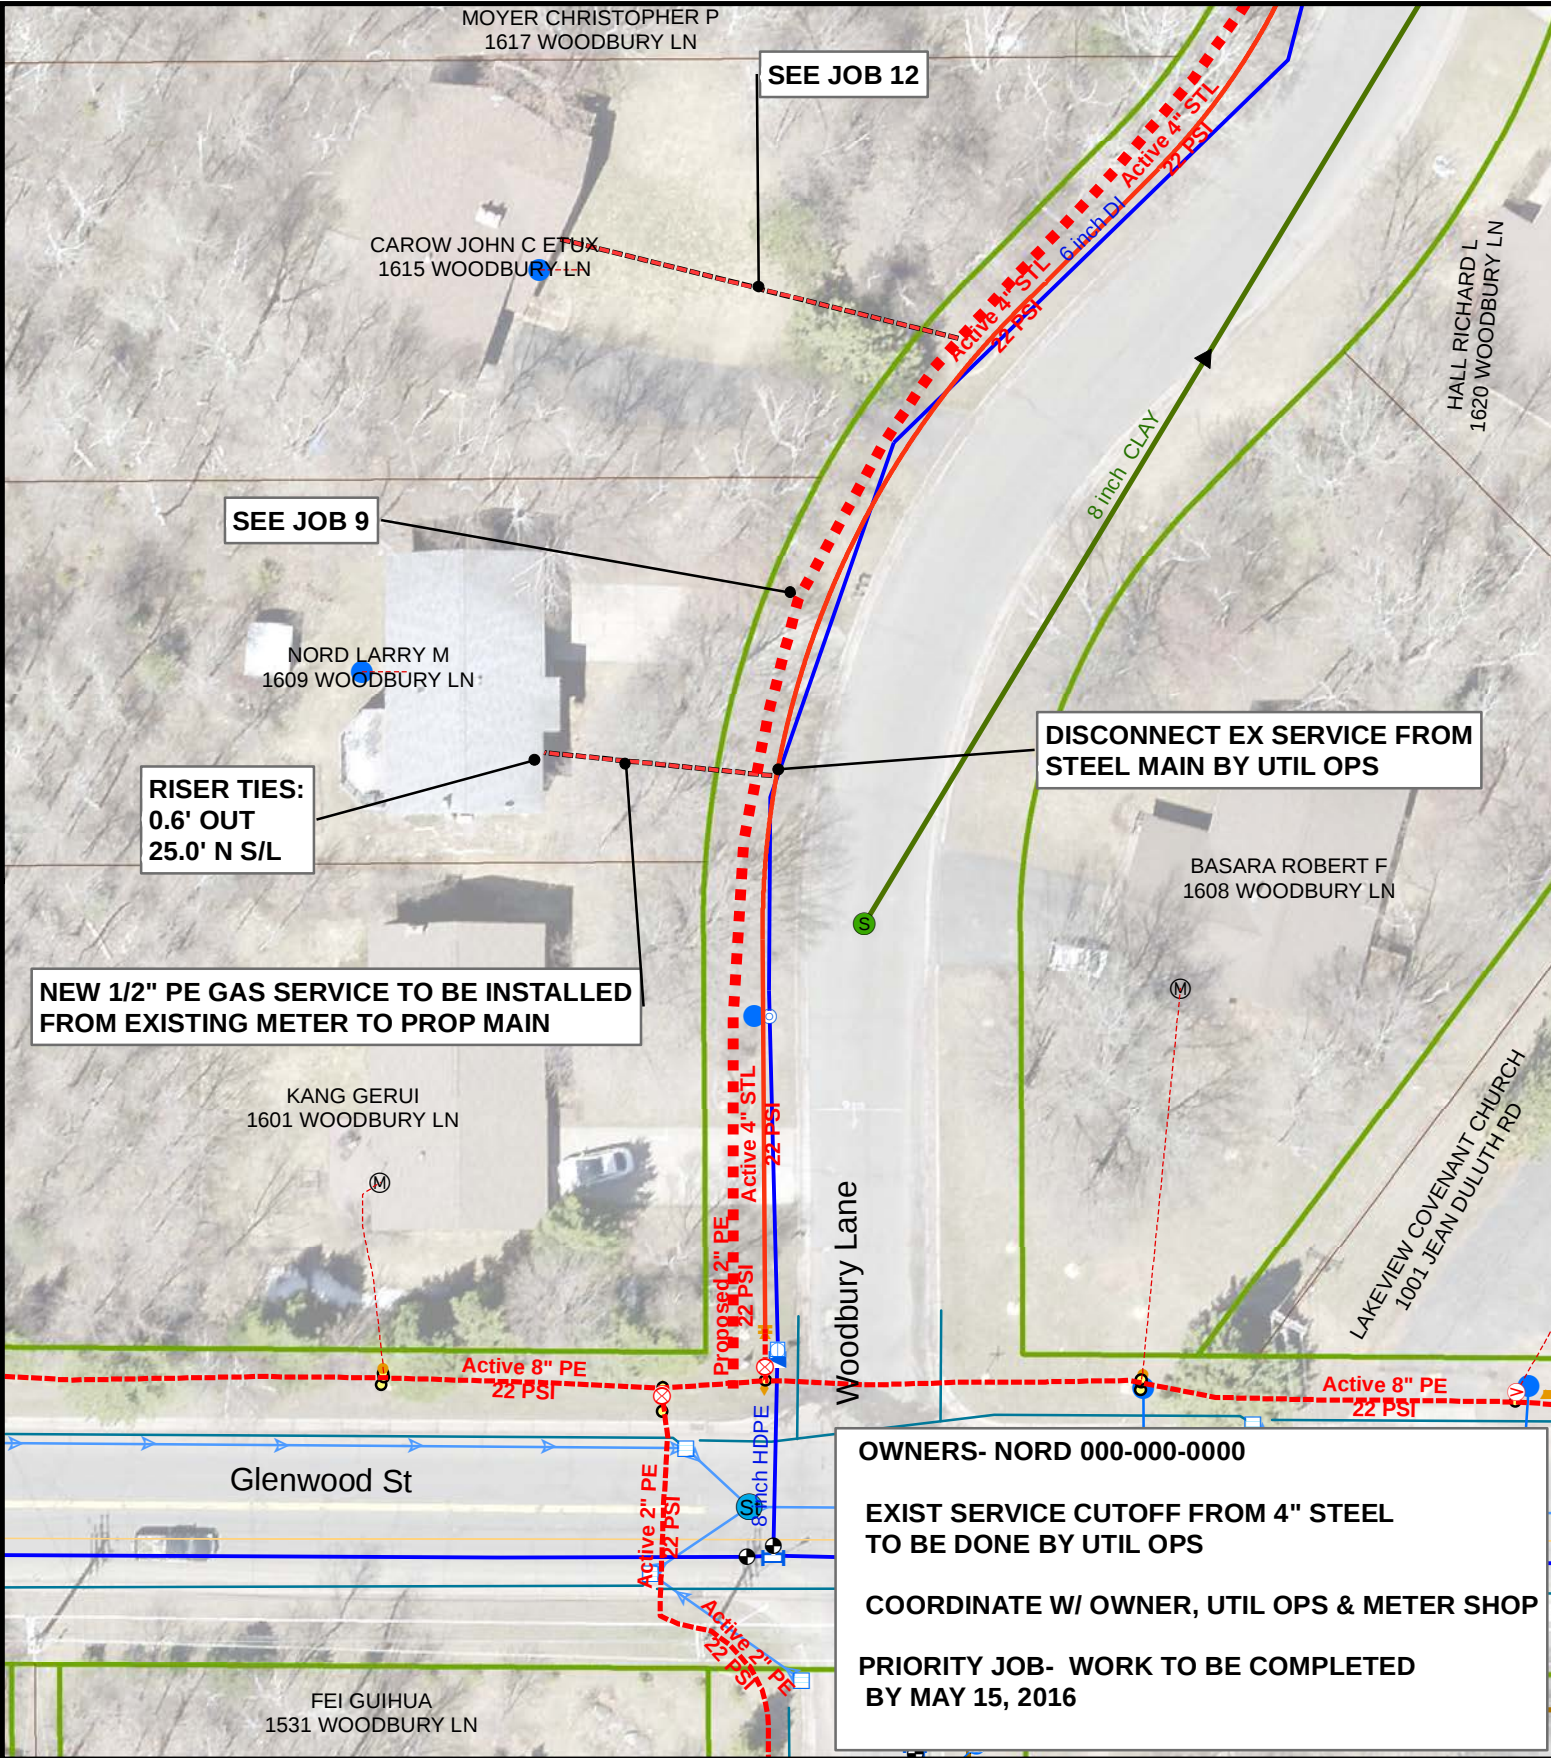

DATE COMPLETED:

INSPECTOR:

EXCESS FLOW VALVE: YES

APPL #: 2016018

EAM #: 428370

ZONE: 3

PLAN OF: NEW 1/2" PE GAS SERVICE-STEEL SERVICE REPLACEMENT

LOCATION: 1609 WOODBURY LN


FROM: _____ TO: _____


DEPARTMENT OF PUBLIC WORKS AND UTILITIES


JOB NO: 1480-011

DRAWN BY: MHW

DATE: 2/23/2016

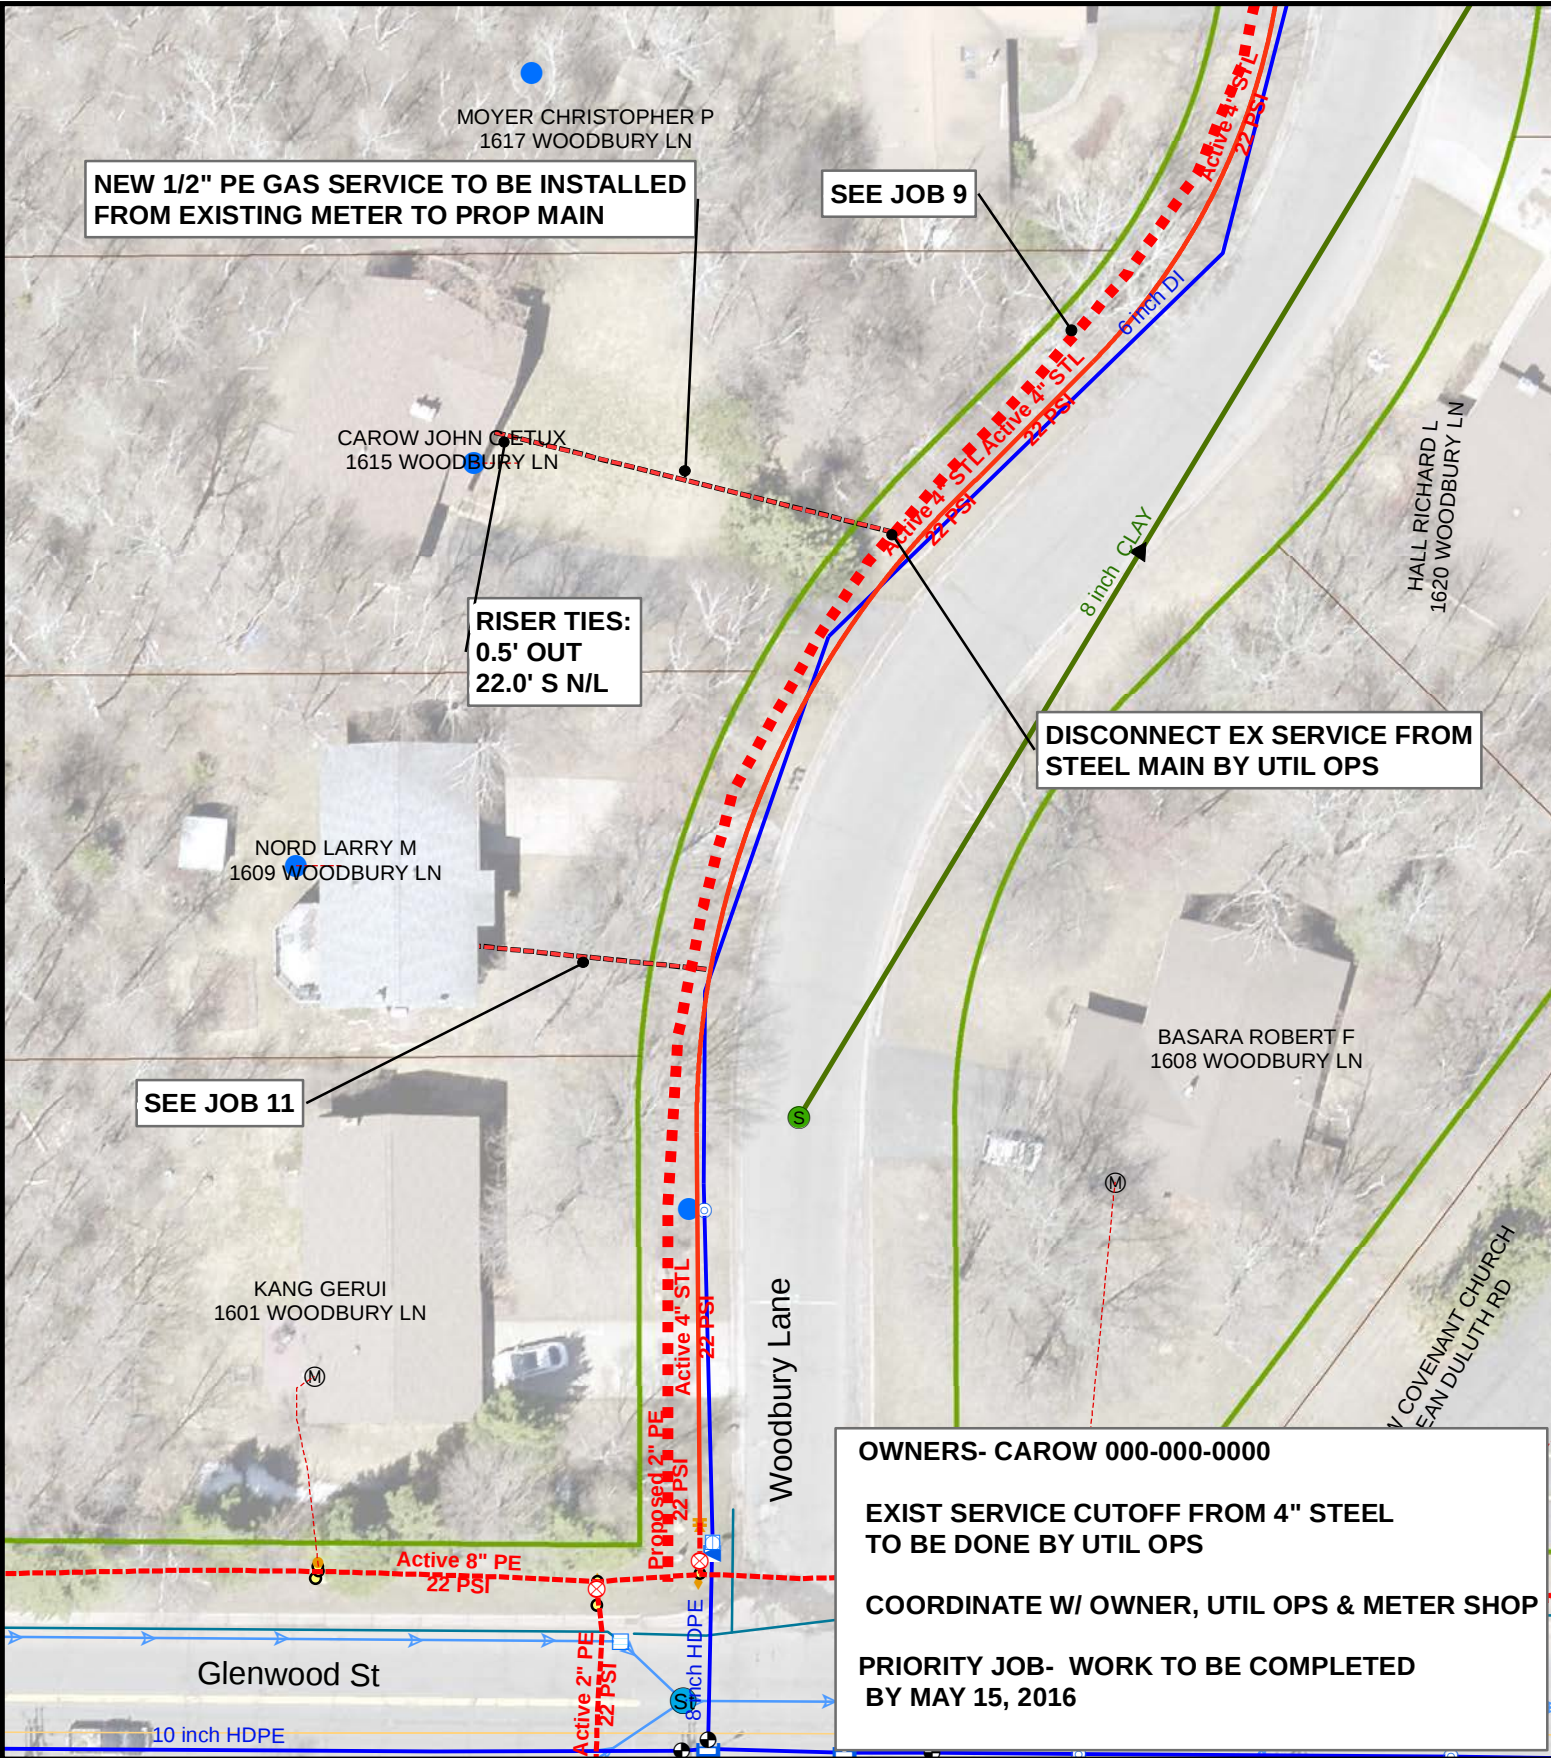

DATE COMPLETED:		INSPECTOR:	
			
EXCESS FLOW VALVE: <u>YES</u>	APPL #: <u>2016019</u>	EAM #: <u>428370</u>	ZONE: <u>3</u>
PLAN OF: <u>NEW 1/2" PE GAS SERVICE-STEEL SERVICE REPLACEMENT</u>			
LOCATION: <u>1615 WOODBURY LN</u>			
FROM: _____ TO: _____			
DEPARTMENT OF PUBLIC WORKS AND UTILITIES			
			
		JOB NO: <u>1480-012</u>	
		DRAWN BY: <u>MHW</u>	
		DATE: <u>2/23/2016</u>	

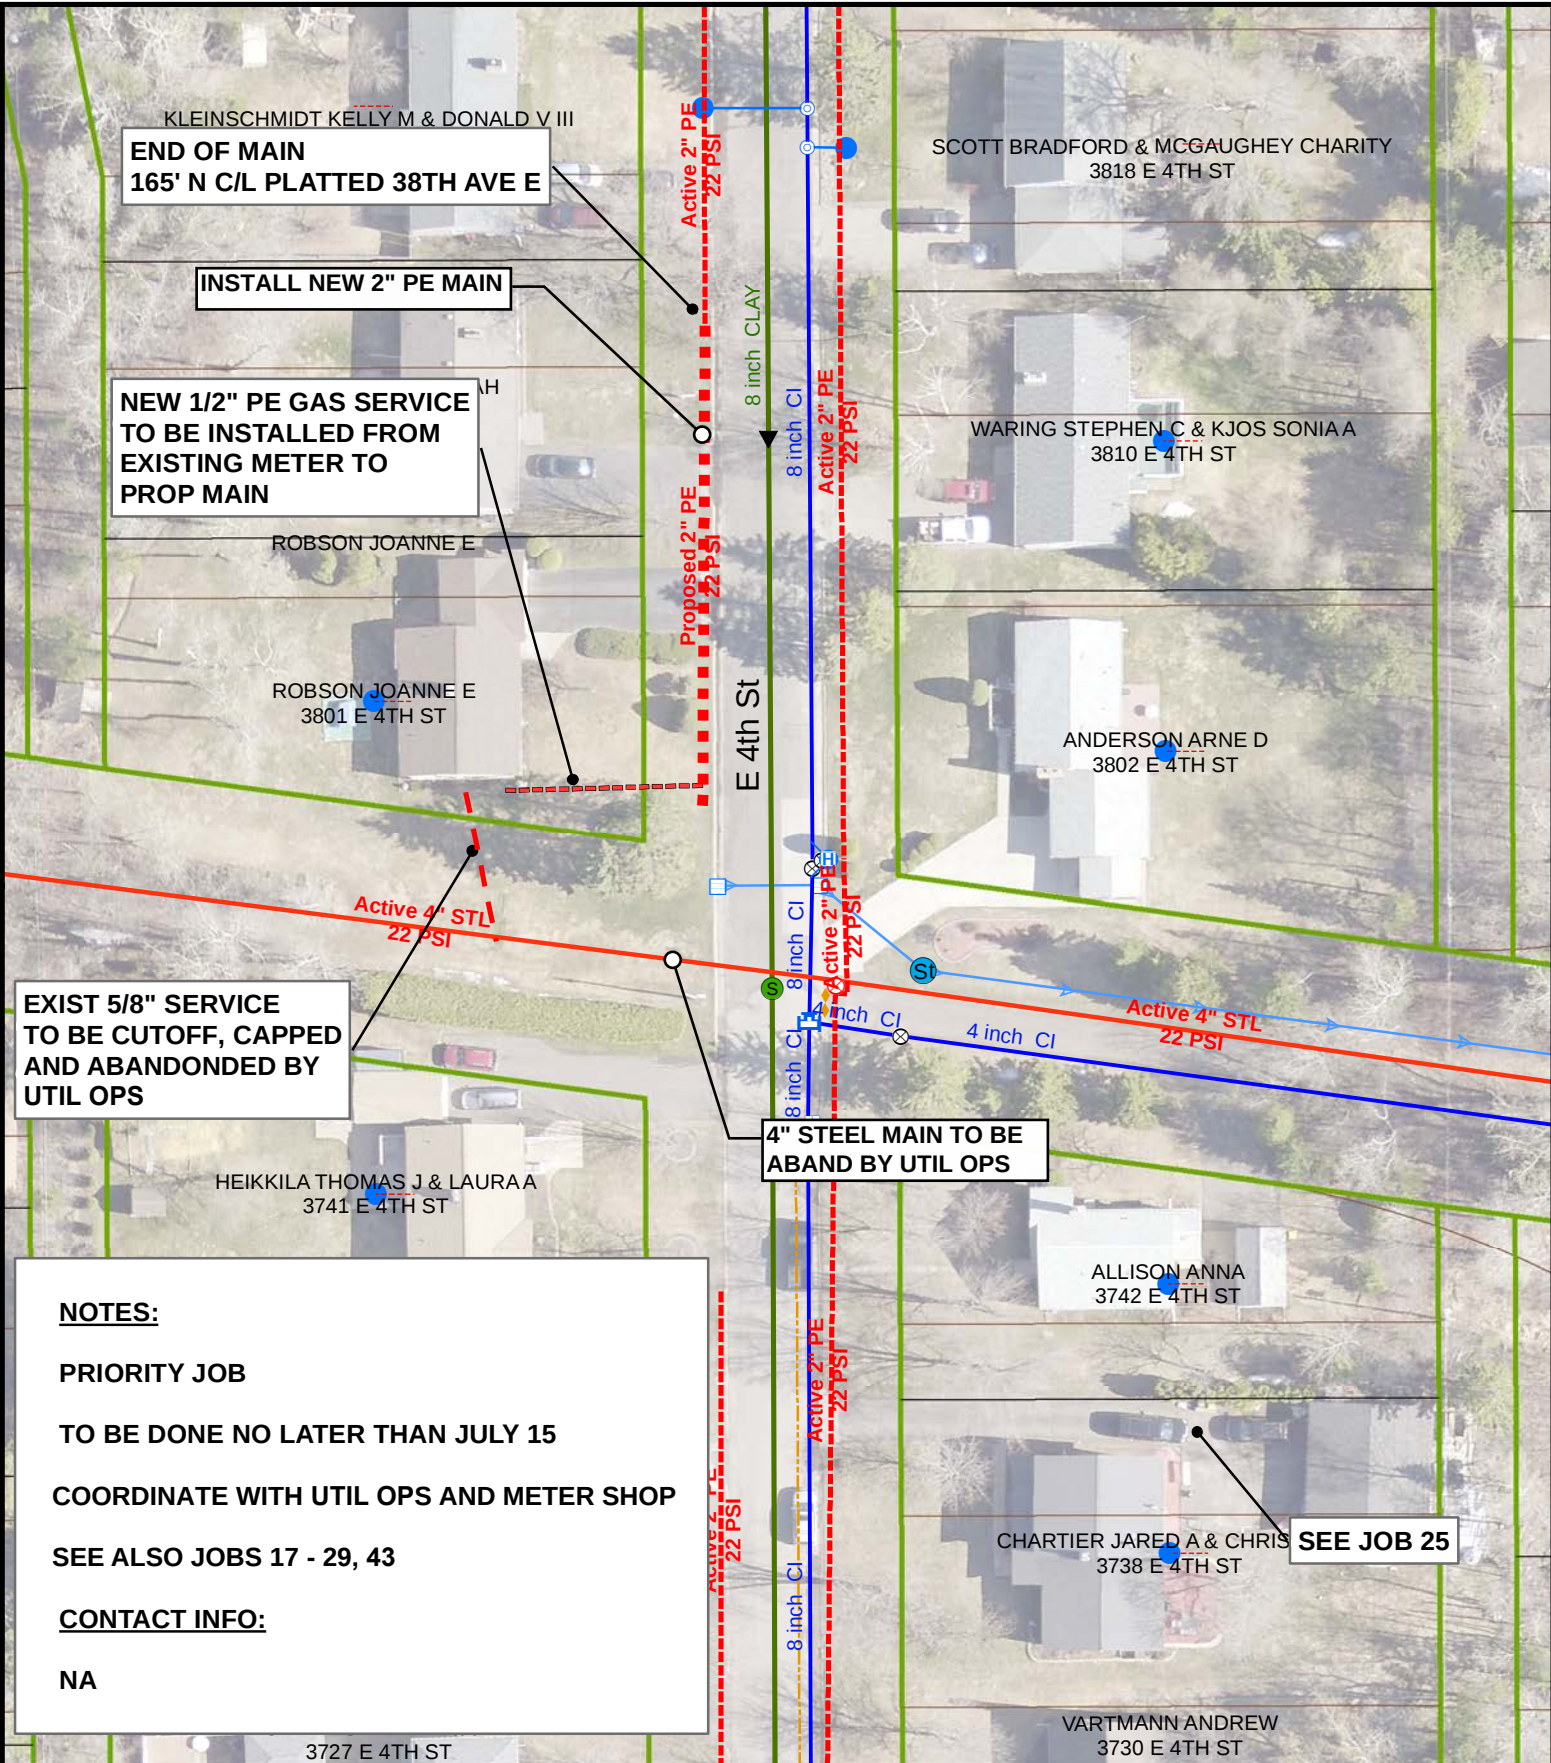

NOTES:

PRIORITY JOB

TO BE DONE NO LATER THAN JULY 15

COORDINATE WITH UTIL OPS AND METER SHOP

SEE ALSO JOBS 17 - 29, 43

CONTACT INFO:

NA

DATE COMPLETED:


INSPECTOR:

EXCESS FLOW VALVE:YES APPL #:2016011 EAM #:428370 ZONE: 3

PLAN OF: INSTALL NEW 2" PE GAS MAIN AND 1/2" PE GAS SERVICE

LOCATION: 3801 E 4TH ST

FROM: 165' N C/L PLATTED 38TH AVE E TO: SOUTHERNLY 125'

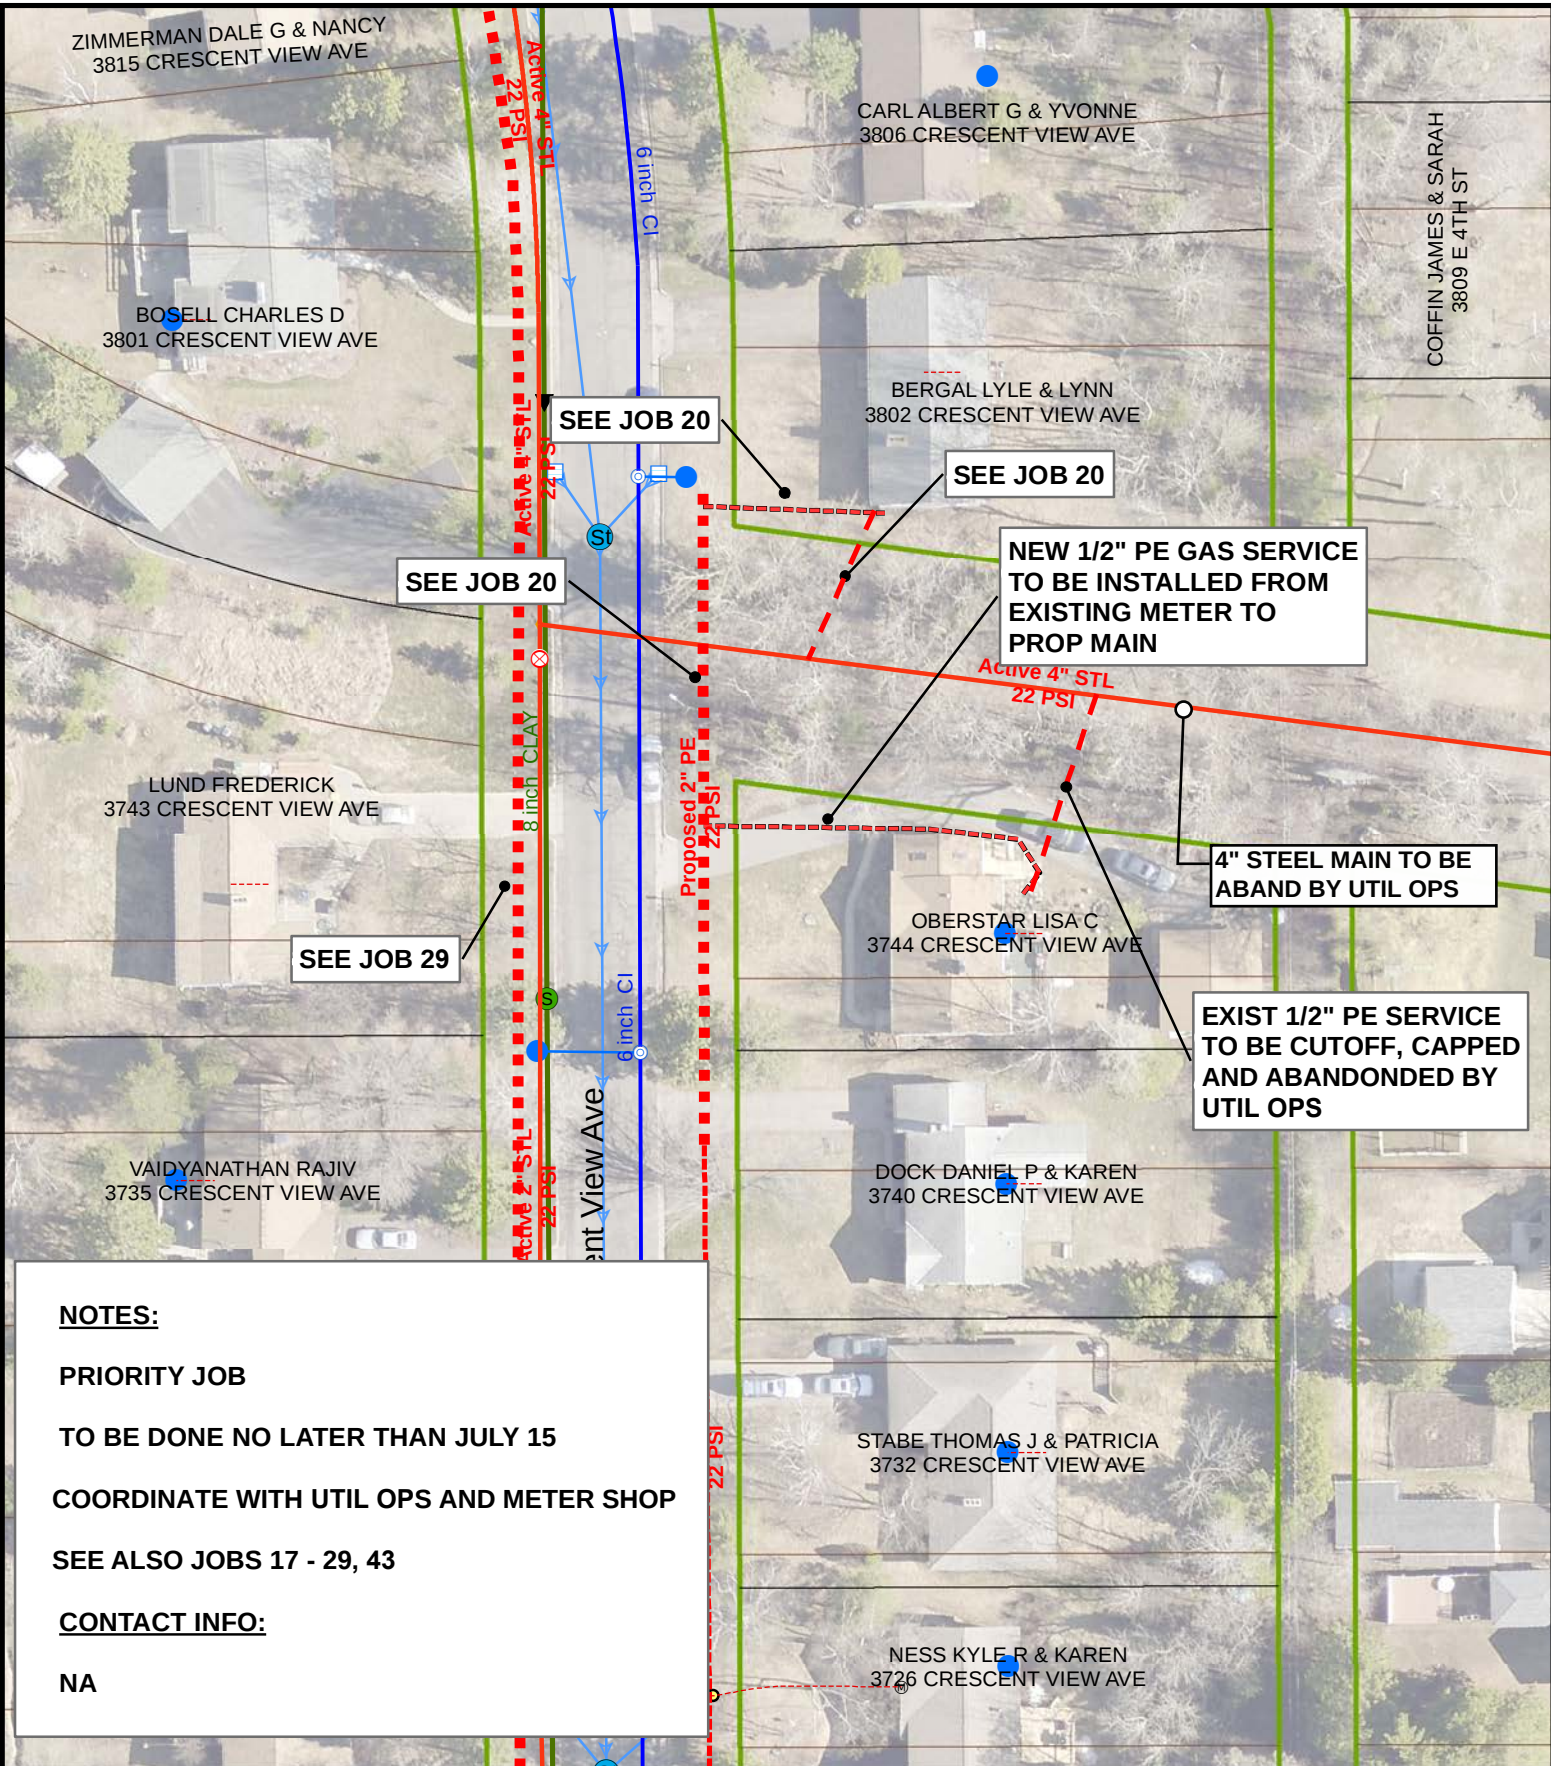

NOTES:

PRIORITY JOB

TO BE DONE NO LATER THAN JULY 15

COORDINATE WITH UTIL OPS AND METER SHOP


SEE ALSO JOBS 17 - 29, 43

CONTACT INFO:

NA

DATE COMPLETED:		INSPECTOR:	

EXCESS FLOW VALVE:	<u>NA</u>	APPL #:	<u>2016013</u>	EAM #:	<u>428370</u>	ZONE:	<u>3</u>
PLAN OF:	<u>INSTALL NEW 1/2" PE GAS SERVICE</u>						
LOCATION:	<u>3744 CRESCENT VIEW AVE</u>						
FROM:				TO:			

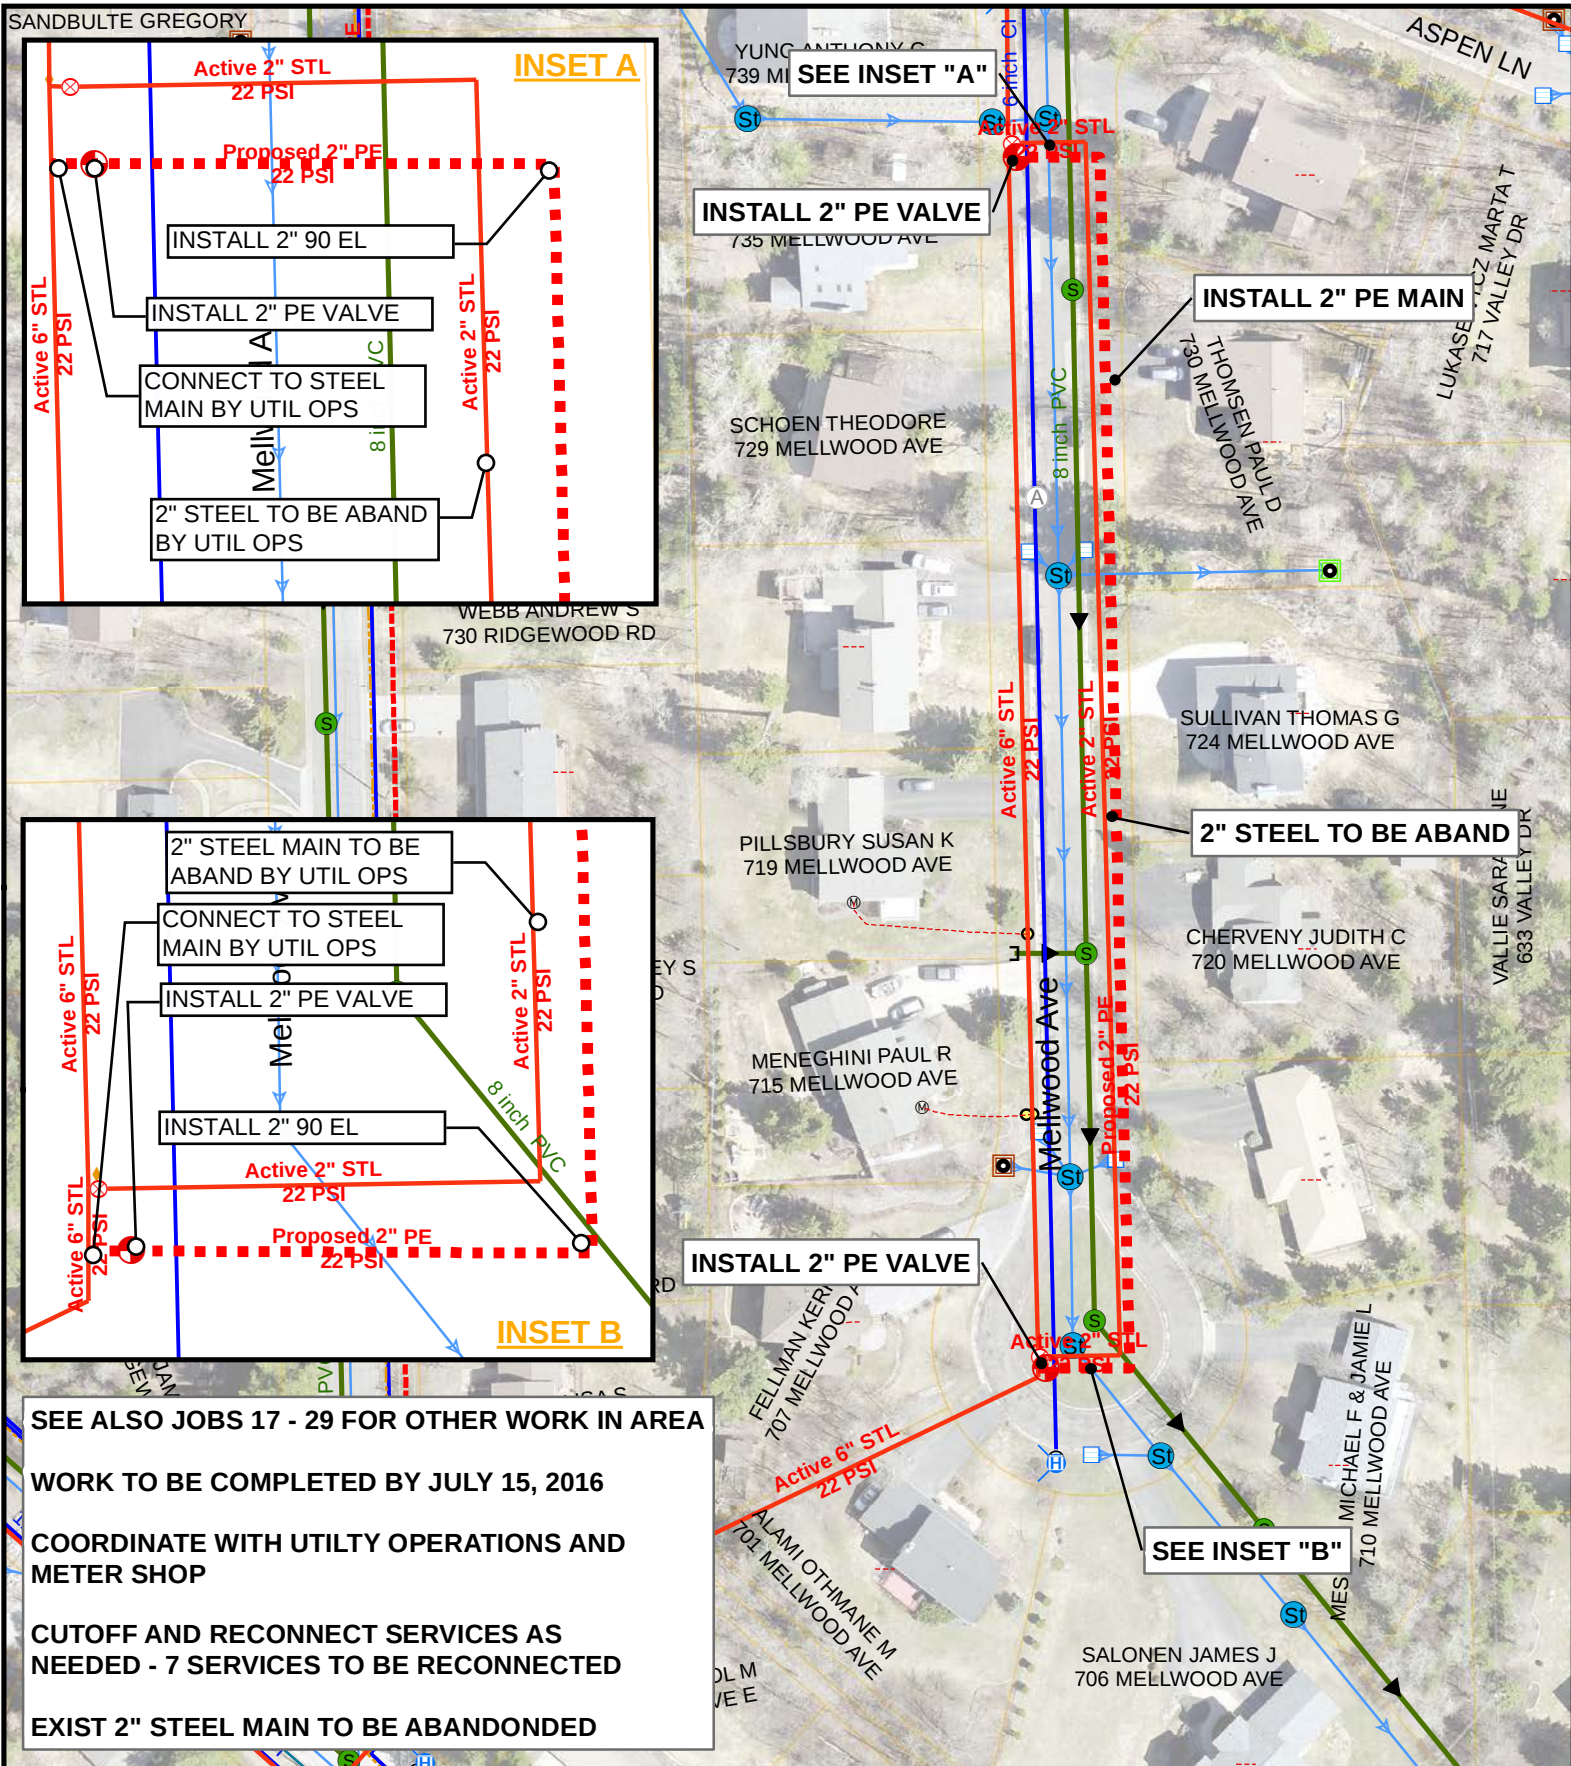

SEE ALSO JOBS 17 - 29 FOR OTHER WORK IN AREA

WORK TO BE COMPLETED BY JULY 15, 2016


COORDINATE WITH UTILITY OPERATIONS AND METER SHOP

CUTOFF AND RECONNECT SERVICES AS NEEDED - 7 SERVICES TO BE RECONNECTED

EXIST 2" STEEL MAIN TO BE ABANDONED

DATE COMPLETED:

INSPECTOR:



EXCESS FLOW VALVE: YES - MULTI APPL #: NA EAM #: 414728 ZONE: 3

PLAN OF: INSTALL NEW 2" PE - RECONNECT 7 SERVICES

LOCATION: MELLWOOD AVE

FROM: MELLWOOD AVE TO: NORTHERNLY 660'



DEPARTMENT OF PUBLIC WORKS AND UTILITIES



JOB NO: 1480-023

DRAWN BY: SRE

DATE: 1/26/2016

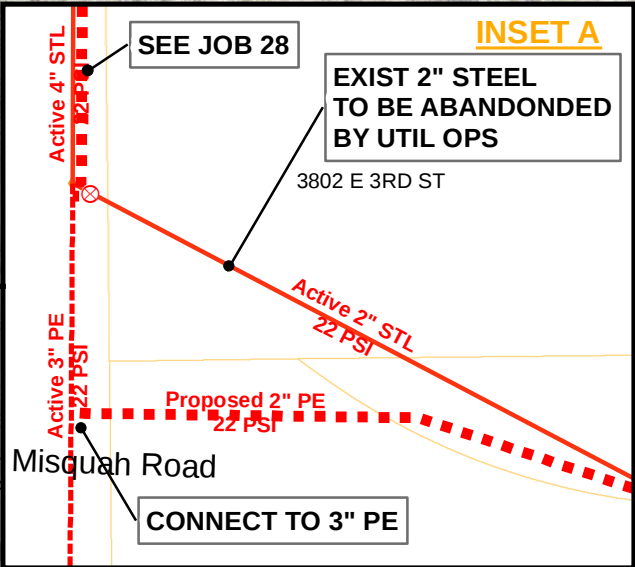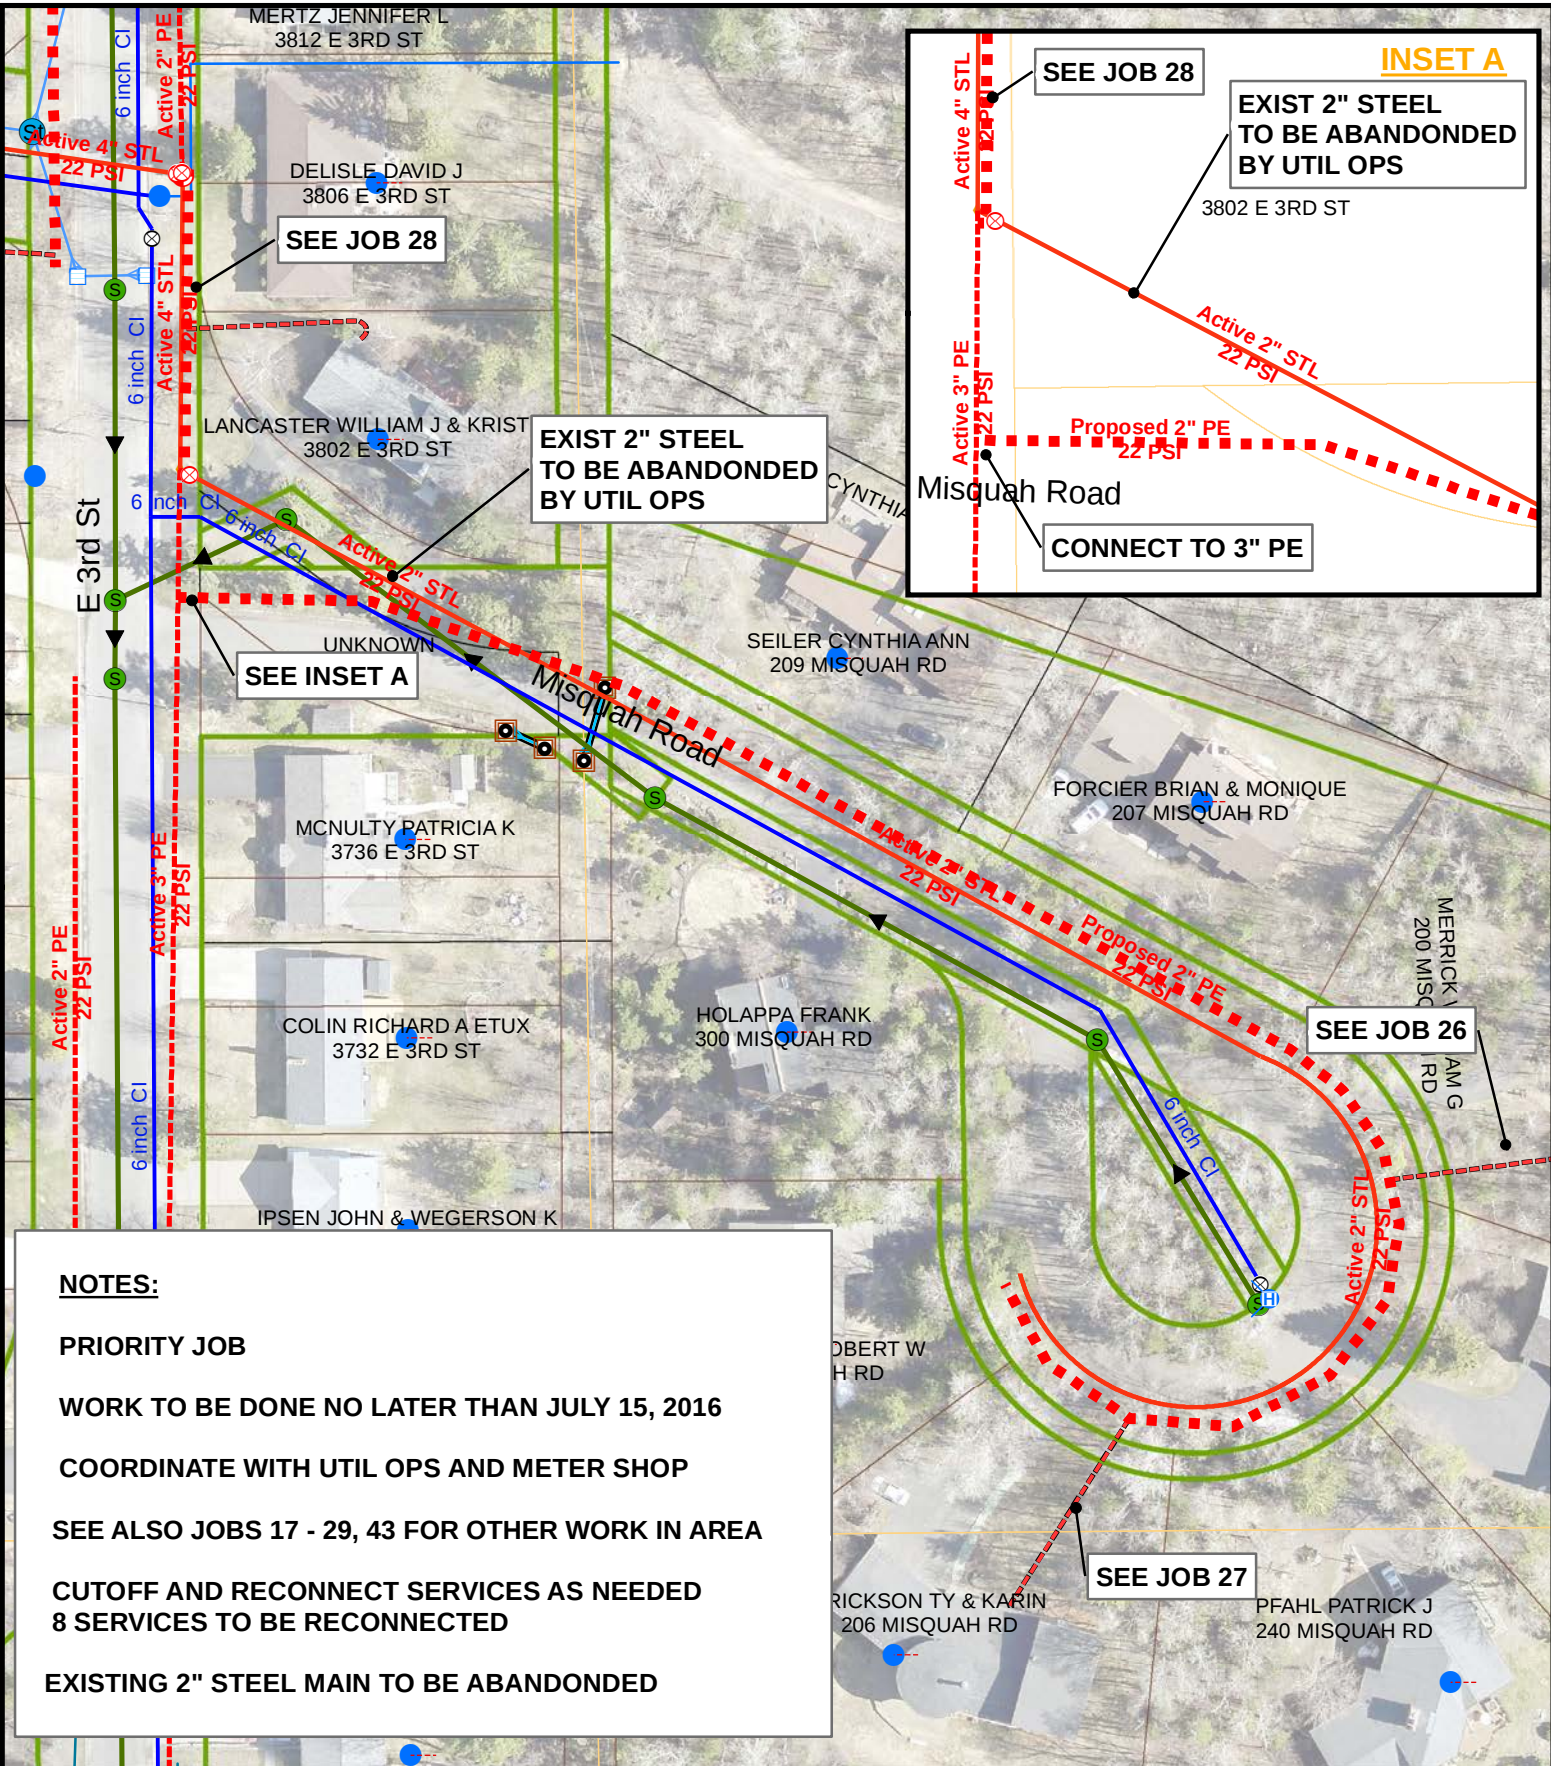

DATE COMPLETED:
INSPECTOR:

EXCESS FLOW VALVE: AS NEEDED
APPL #: NA
EAM #: 428370
ZONE: 3

PLAN OF: NEW 2" PE GAS MAIN - STEEL REPLACEMENT

LOCATION: MISQUAH RD


FROM: E 3RD ST
TO: ALONG MISQUAH RD - APPROX 885'

DEPARTMENT OF PUBLIC WORKS AND UTILITIES

JOB NO: 1480-025

DRAWN BY: SRE

DATE: 2/1/2016

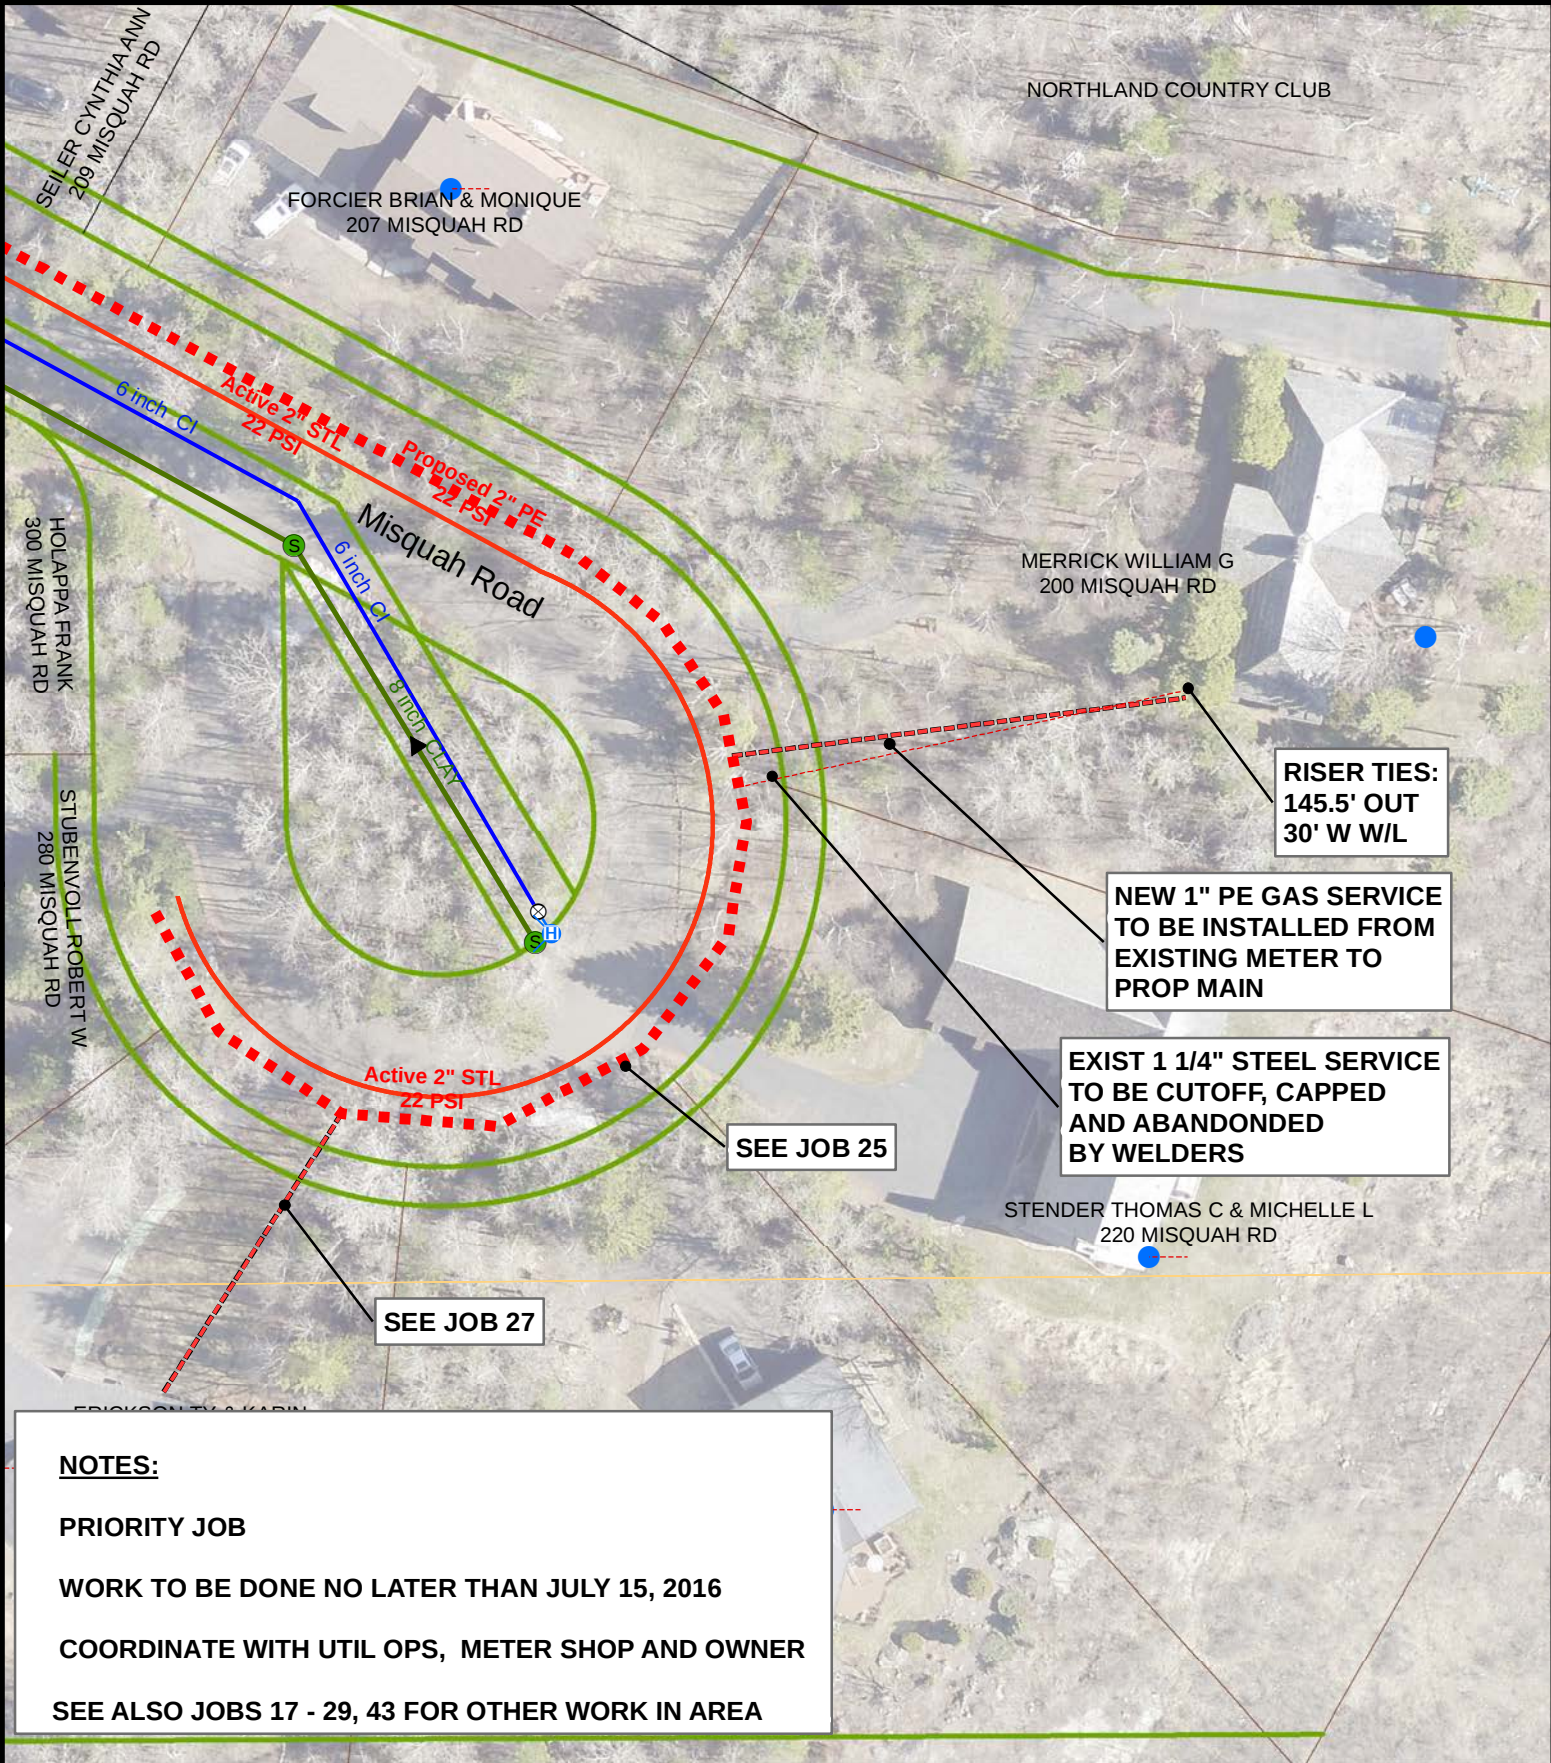

NOTES:

PRIORITY JOB

WORK TO BE DONE NO LATER THAN JULY 15, 2016

COORDINATE WITH UTIL OPS, METER SHOP AND OWNER

SEE ALSO JOBS 17 - 29, 43 FOR OTHER WORK IN AREA

DATE COMPLETED:

INSPECTOR:

EXCESS FLOW VALVE: YES APPL #: 2016015 EAM #: 428370 ZONE: 3

PLAN OF: NEW 1" PE GAS SERVICE - STEEL SERVICE REPLACEMENT


LOCATION: 200 MISQUAH RD

FROM: _____ TO: _____

JOB NO: 1480-026

DRAWN BY: SRE

DATE: 2/1/2016

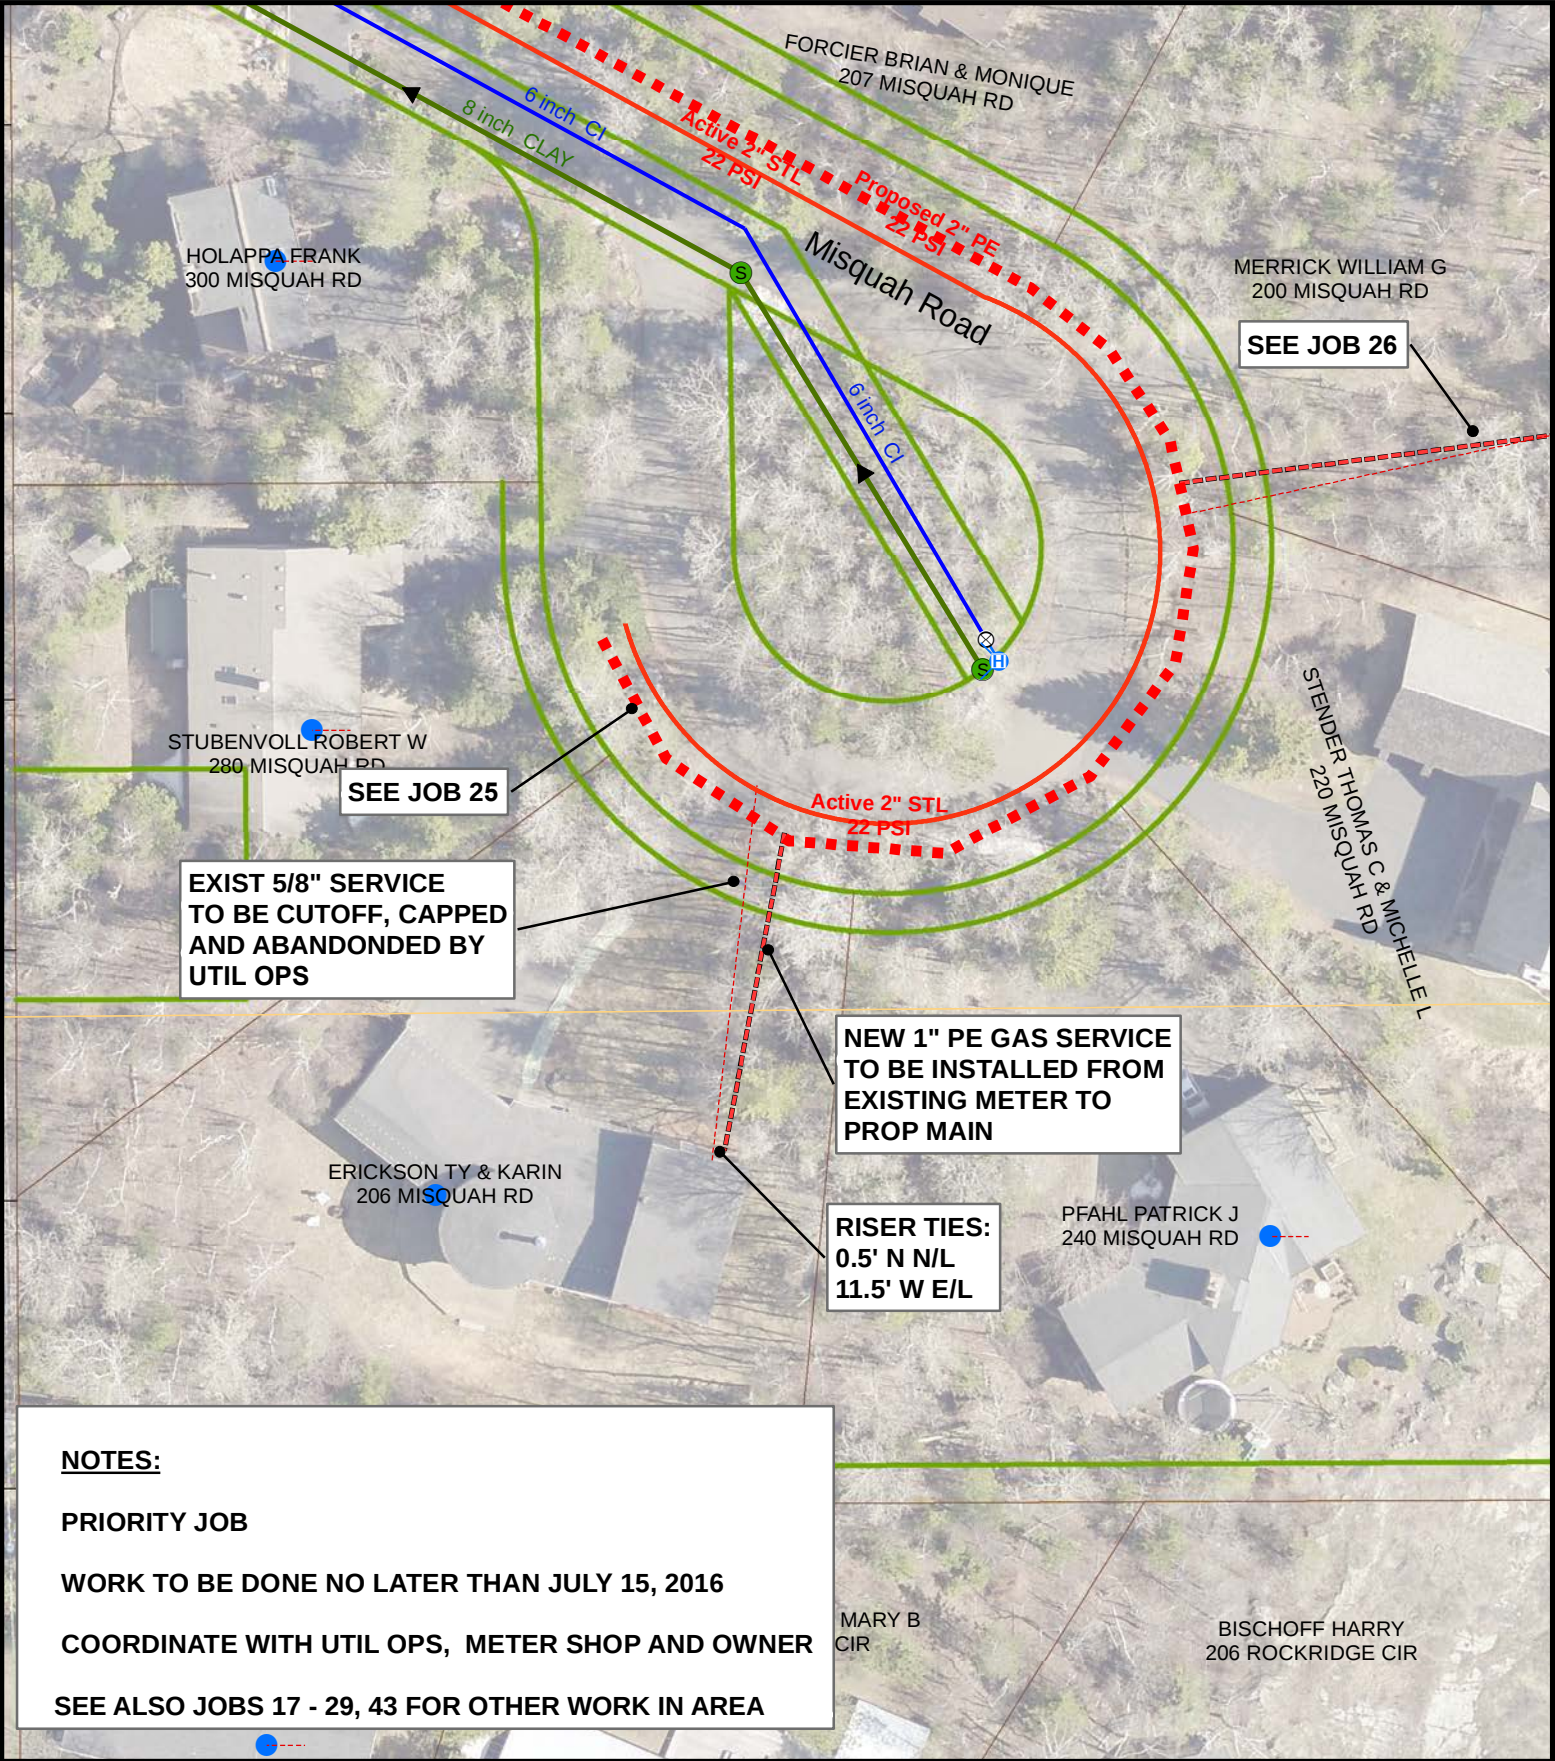


NOTES:

PRIORITY JOB


WORK TO BE DONE NO LATER THAN JULY 15, 2016

COORDINATE WITH UTIL OPS, METER SHOP AND OWNER

SEE ALSO JOBS 17 - 29, 43 FOR OTHER WORK IN AREA

DATE COMPLETED:		INSPECTOR:	
			

EXCESS FLOW VALVE: <u>YES</u>	APPL #: <u>2016016</u>	EAM #: <u>428370</u>	ZONE: <u>3</u>
PLAN OF: <u>NEW 1/2" PE GAS SERVICE - STEEL SERVICE REPLACEMENT</u>			
LOCATION: <u>206 MISQUAH RD</u>			
FROM: _____ TO: _____			

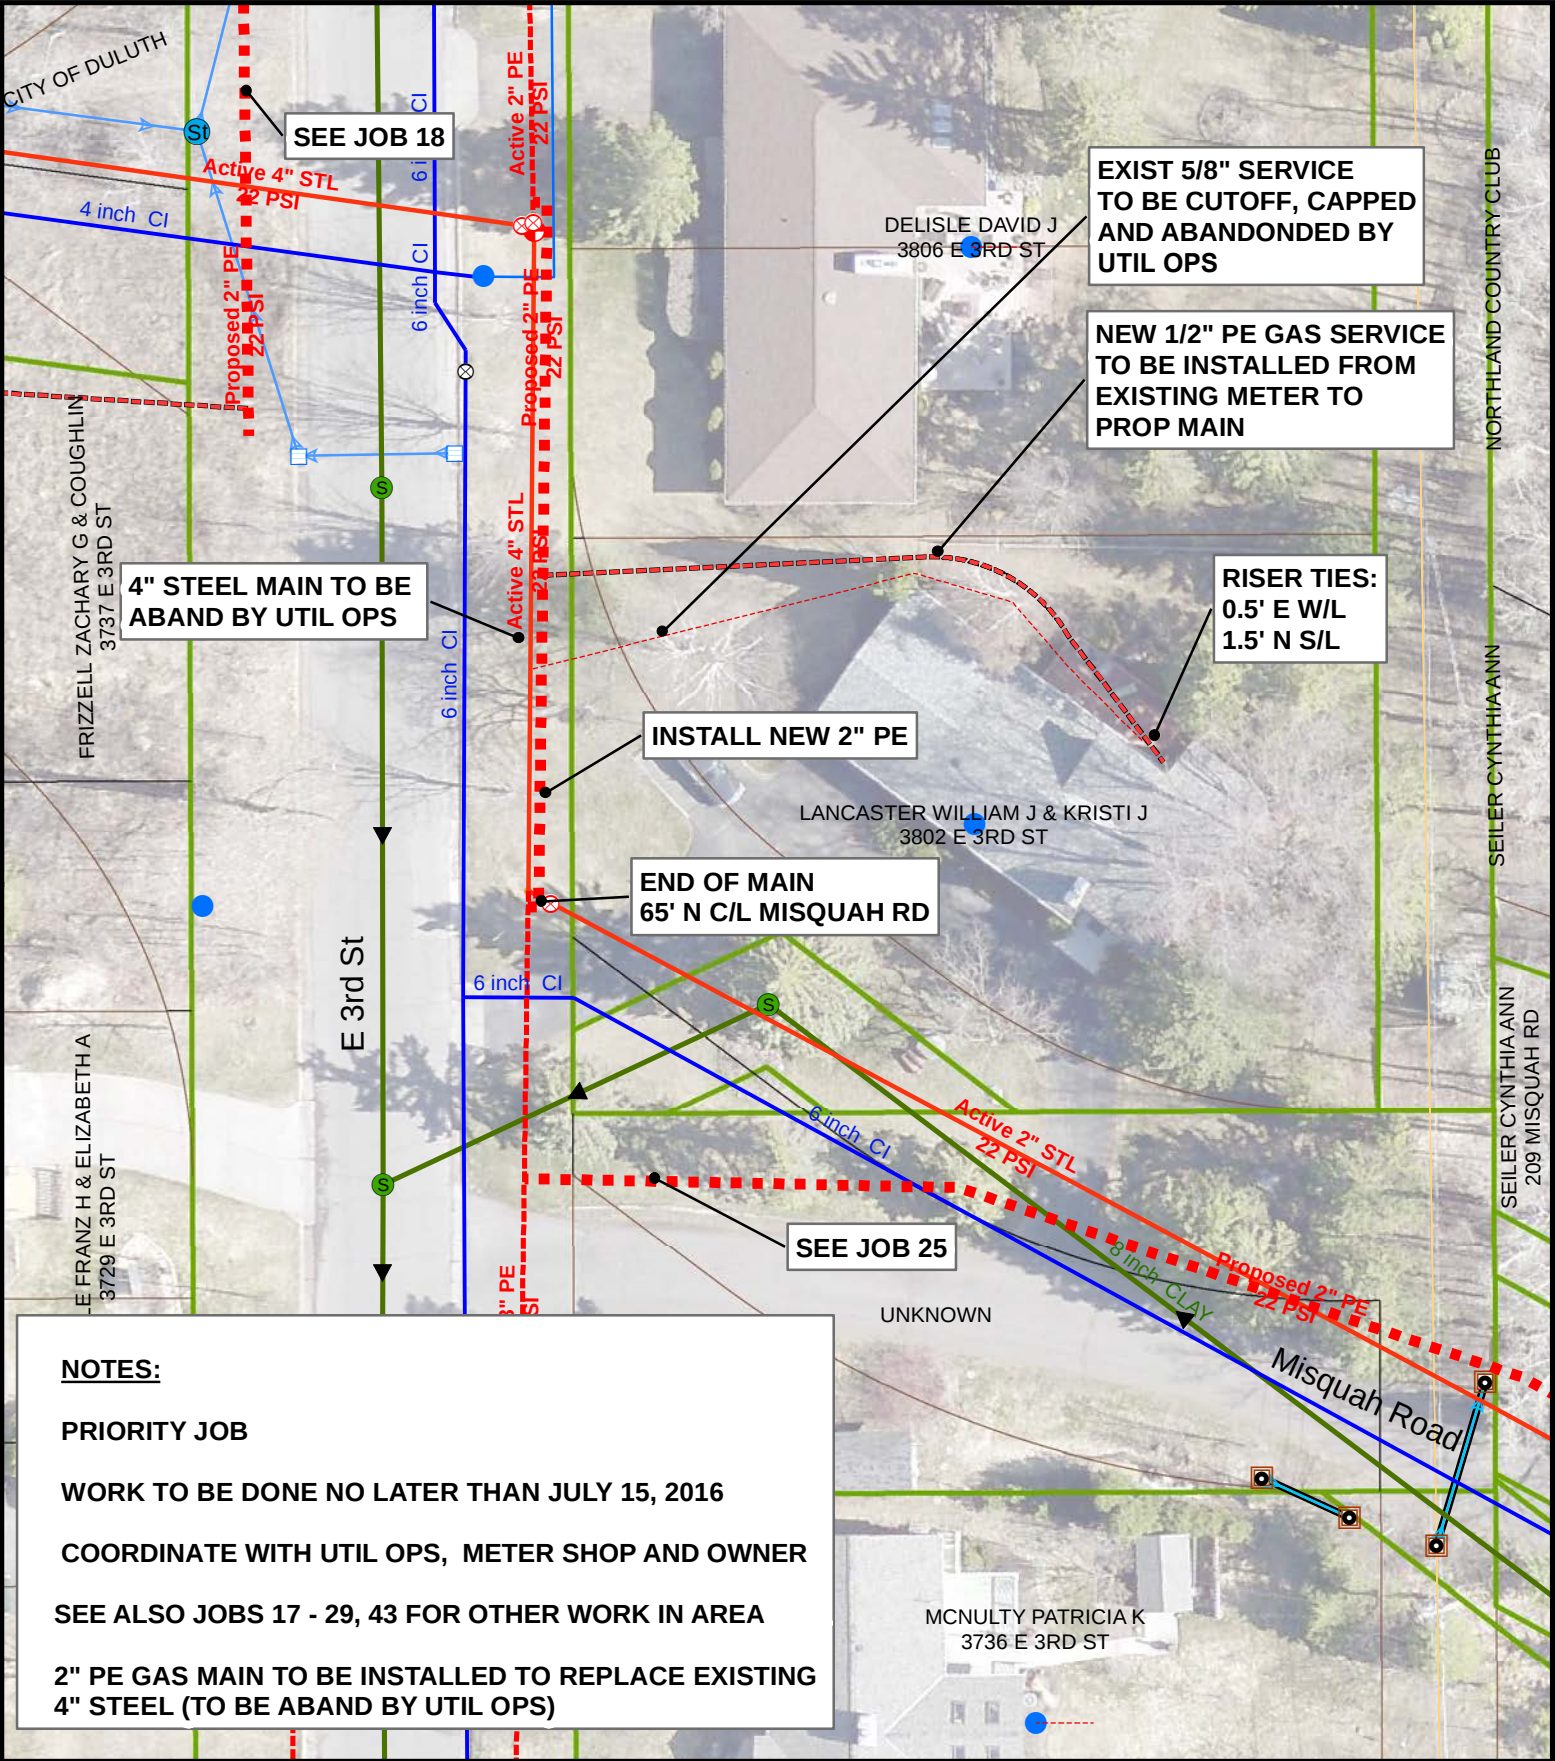

NOTES:

PRIORITY JOB

WORK TO BE DONE NO LATER THAN JULY 15, 2016

COORDINATE WITH UTIL OPS, METER SHOP AND OWNER

SEE ALSO JOBS 17 - 29, 43 FOR OTHER WORK IN AREA

2" PE GAS MAIN TO BE INSTALLED TO REPLACE EXISTING 4" STEEL (TO BE ABAND BY UTIL OPS)

DATE COMPLETED:

INSPECTOR:

EXCESS FLOW VALVE: YES APPL #: 2016017 EAM #: 428370 ZONE: 3

PLAN OF: STEEL SERVICE REPLACEMENT AND MAIN REPLACEMENT

LOCATION: 3802 E 3RD ST


FROM: 65' N C/L MISQUAH RD TO: NORTHERNLY 125'


DEPARTMENT OF PUBLIC WORKS AND UTILITIES

JOB NO: 1480-028


DRAWN BY: SRE

DATE: 2/1/2016

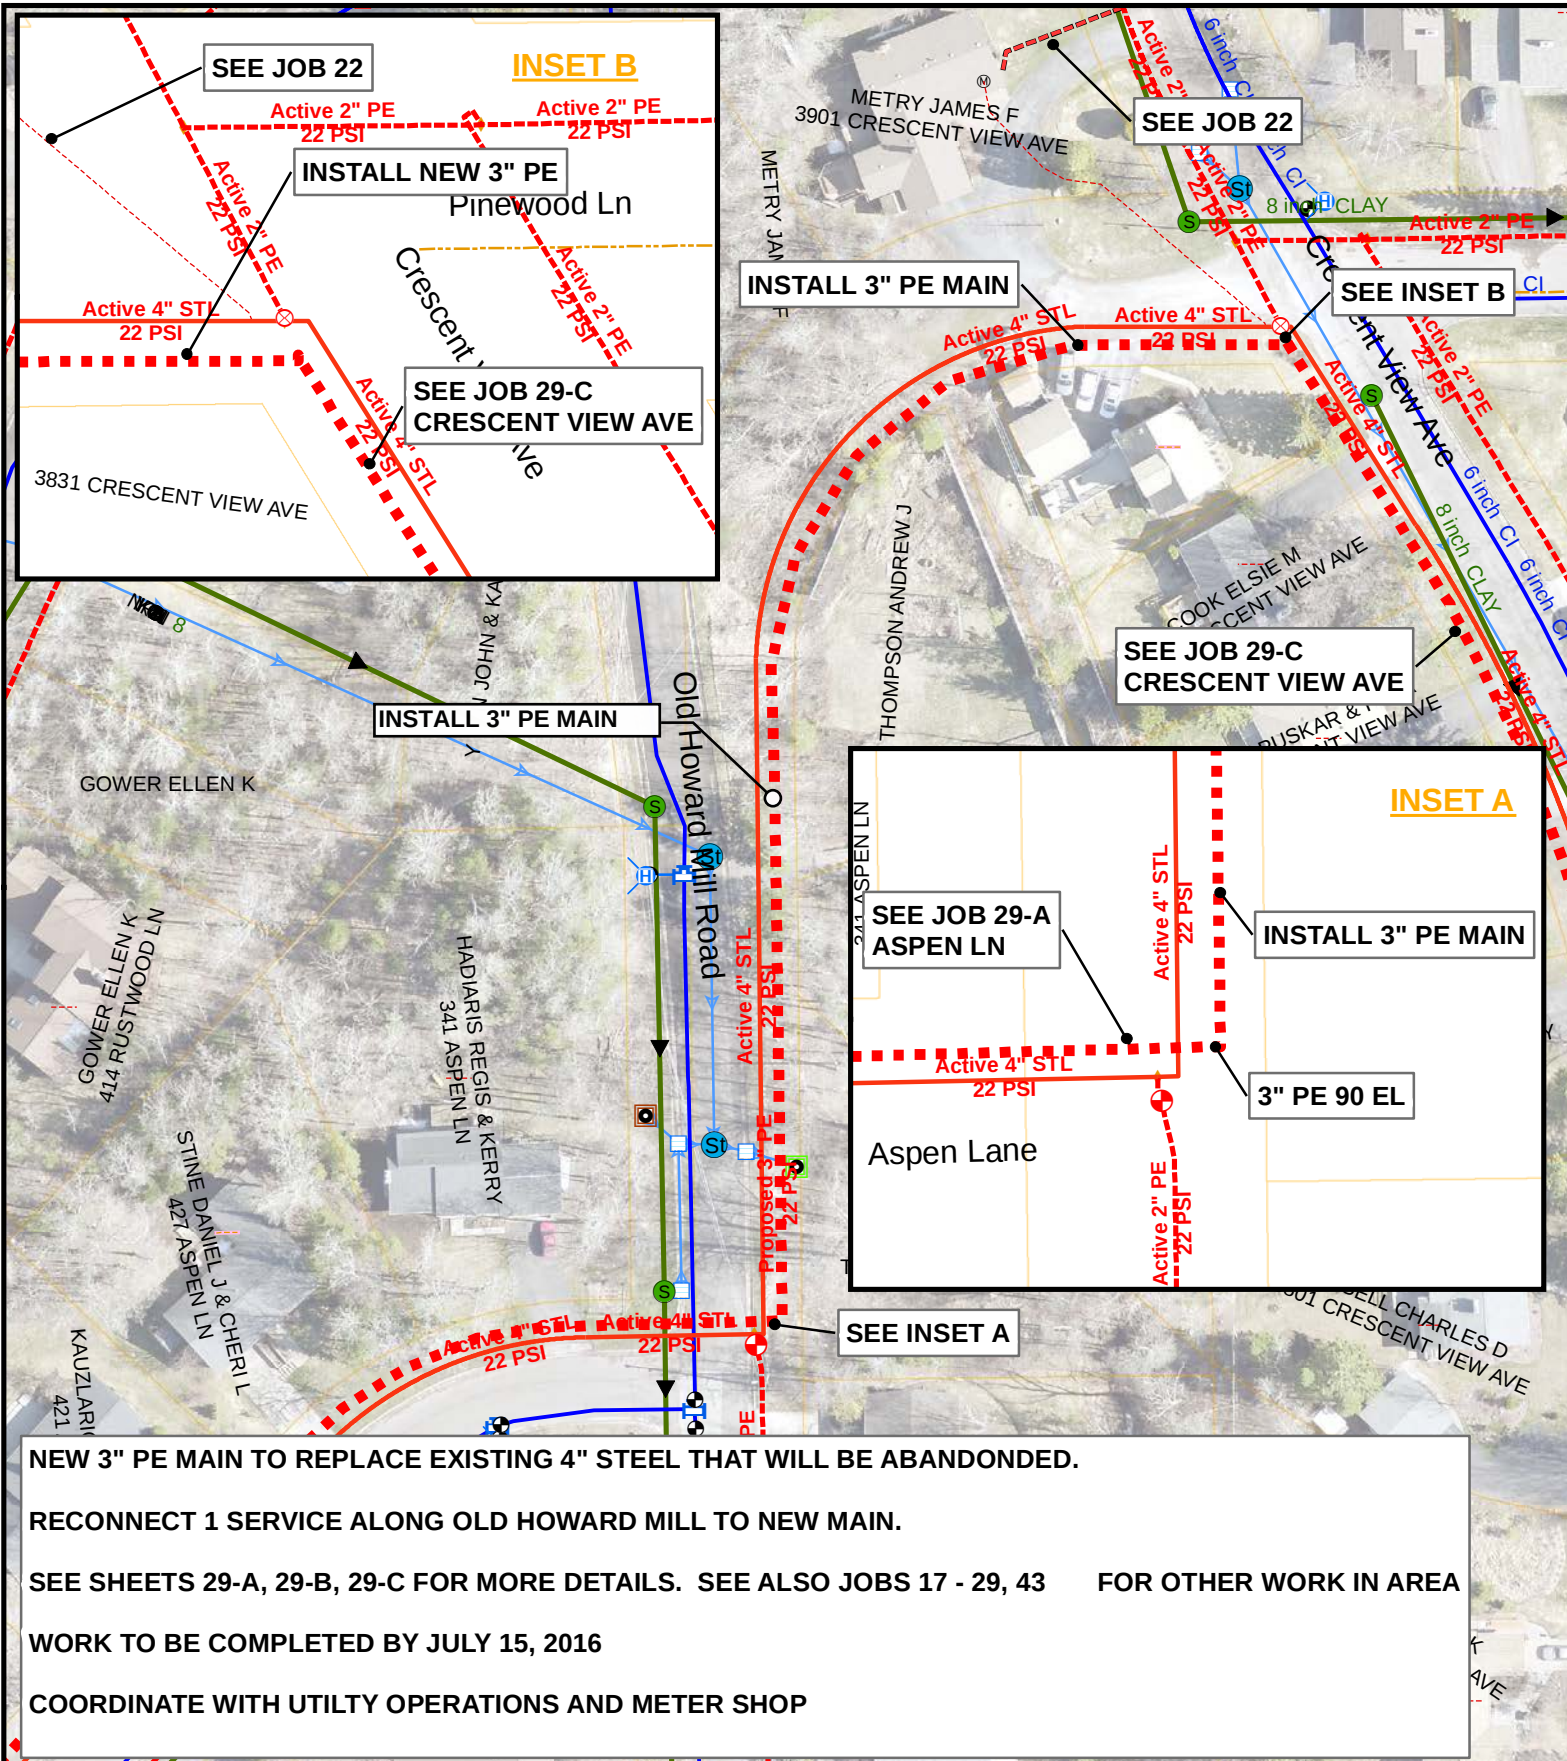


DATE COMPLETED:	INSPECTOR:
	

EXCESS FLOW VALVE: <u>NA</u>	APPL #: <u>NA</u>	EAM #: <u>414728</u>	ZONE: <u>3</u>
PLAN OF: <u>INSTALL NEW 3" PE - RECONNECT 1 SERVICE</u>			
LOCATION: <u>OLD HOWARD MILL RD</u>			
FROM: <u>ASPEN LN</u> TO: <u>CRESCENT VIEW AVE</u>			
DEPARTMENT OF PUBLIC WORKS AND UTILITIES			
		JOB NO: <u>1480-029B</u>	
		DRAWN BY: <u>SRE</u>	
		DATE: <u>2/2/2016</u>	

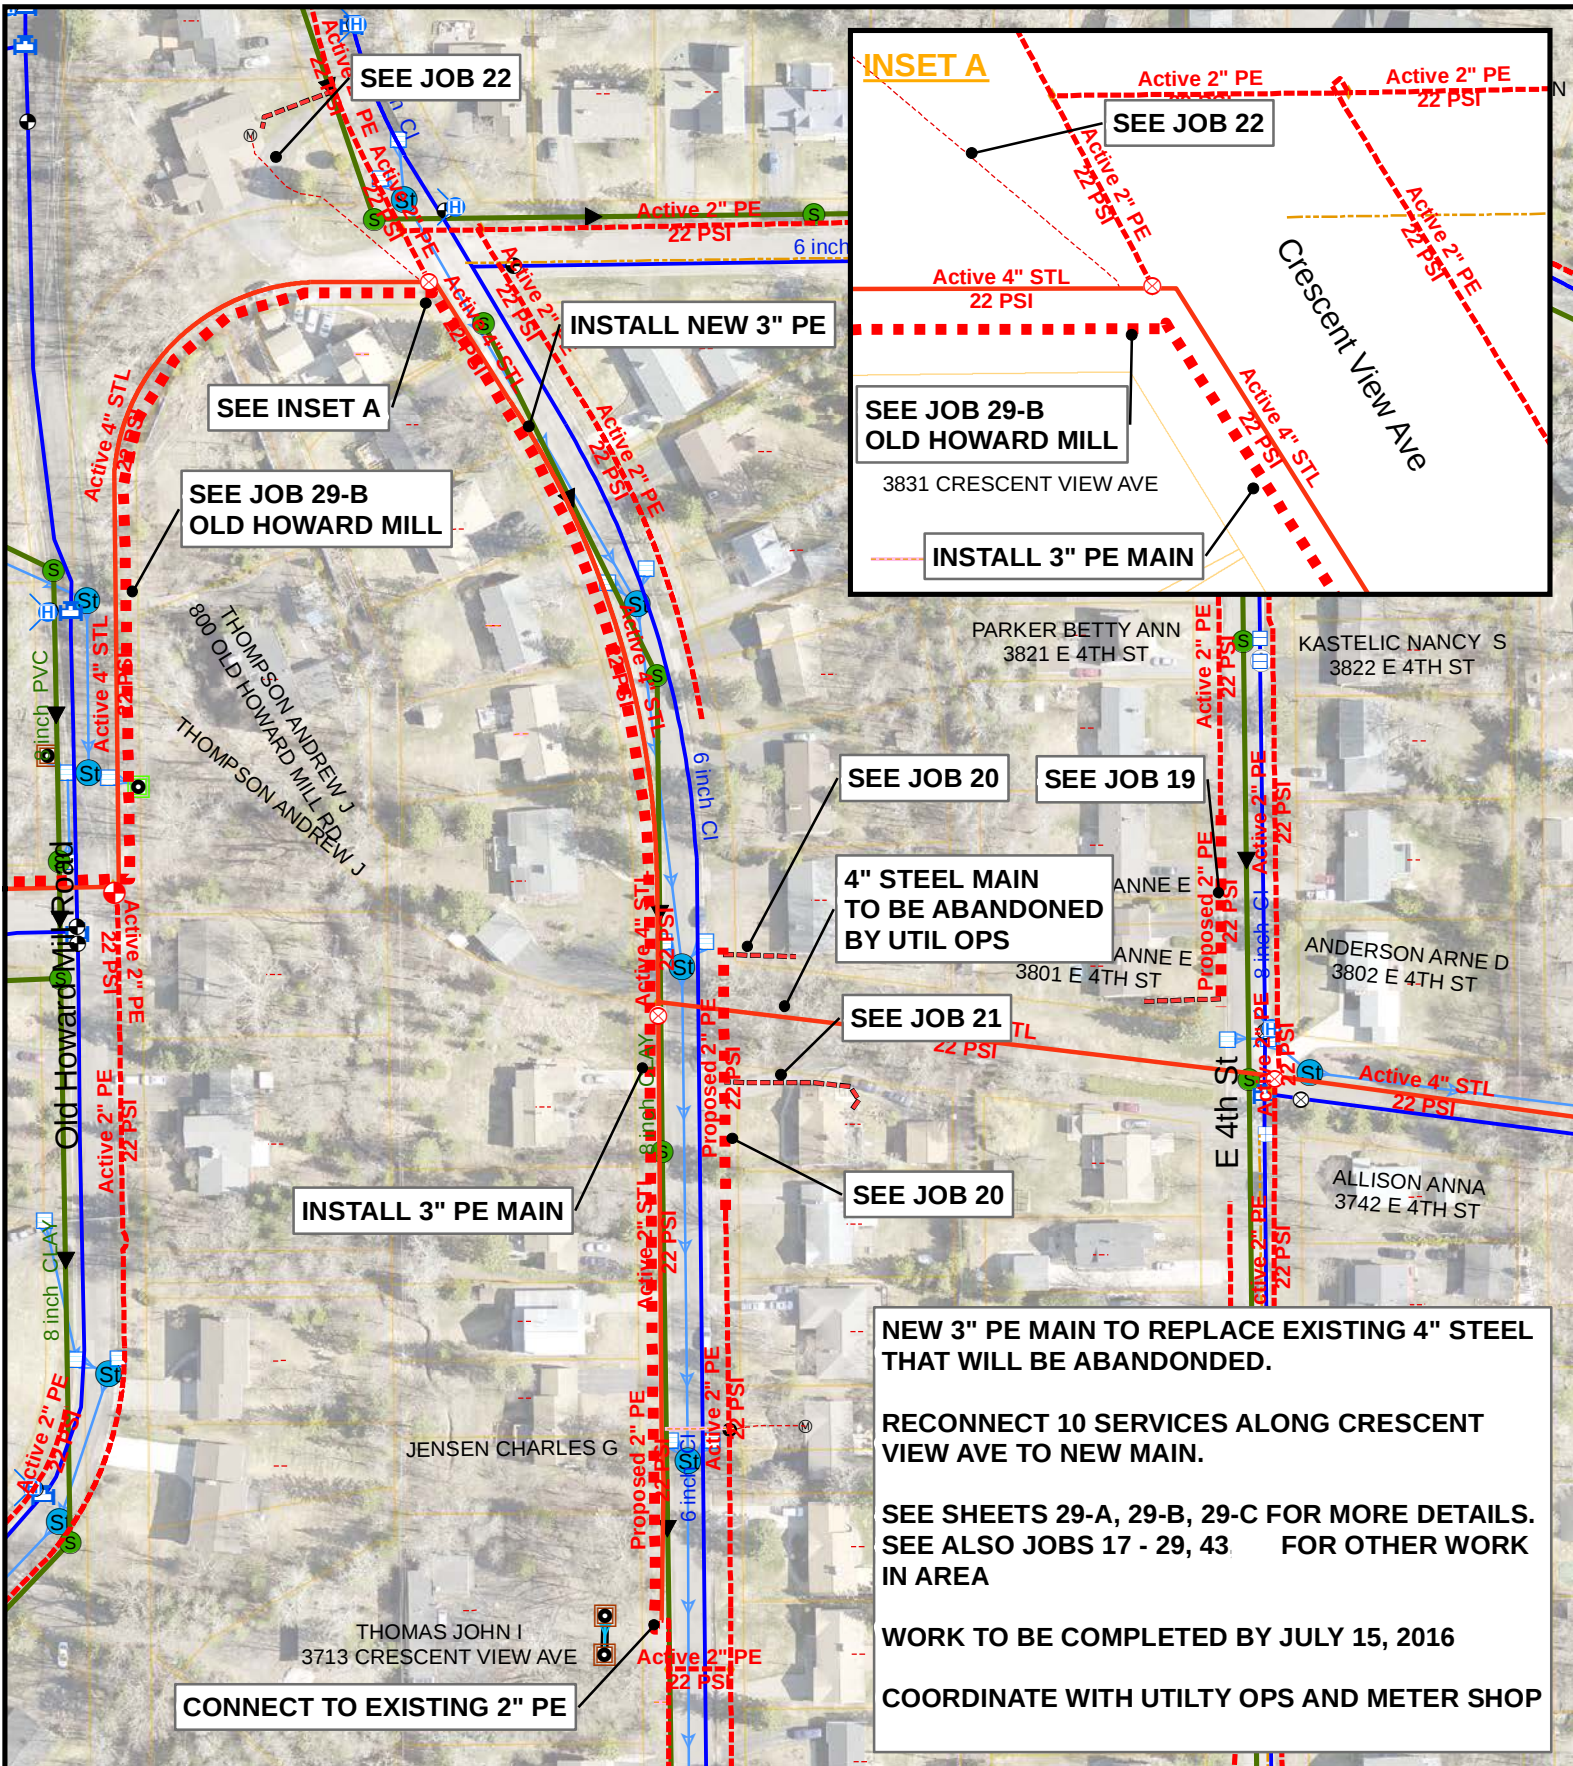

DATE COMPLETED:

INSPECTOR:



EXCESS FLOW VALVE: NA APPL #: NA EAM #: 414728 ZONE: 3

PLAN OF: INSTALL NEW 3" PE - RECONNECT 10 SERVICES

LOCATION: CRESCENT VIEW AVE

FROM: PINEWOOD LANE TO: SOUTHERNLY 915


DEPARTMENT OF PUBLIC WORKS AND UTILITIES




JOB NO: 1480-029C

DRAWN BY: SRE


DATE: 2/2/2016

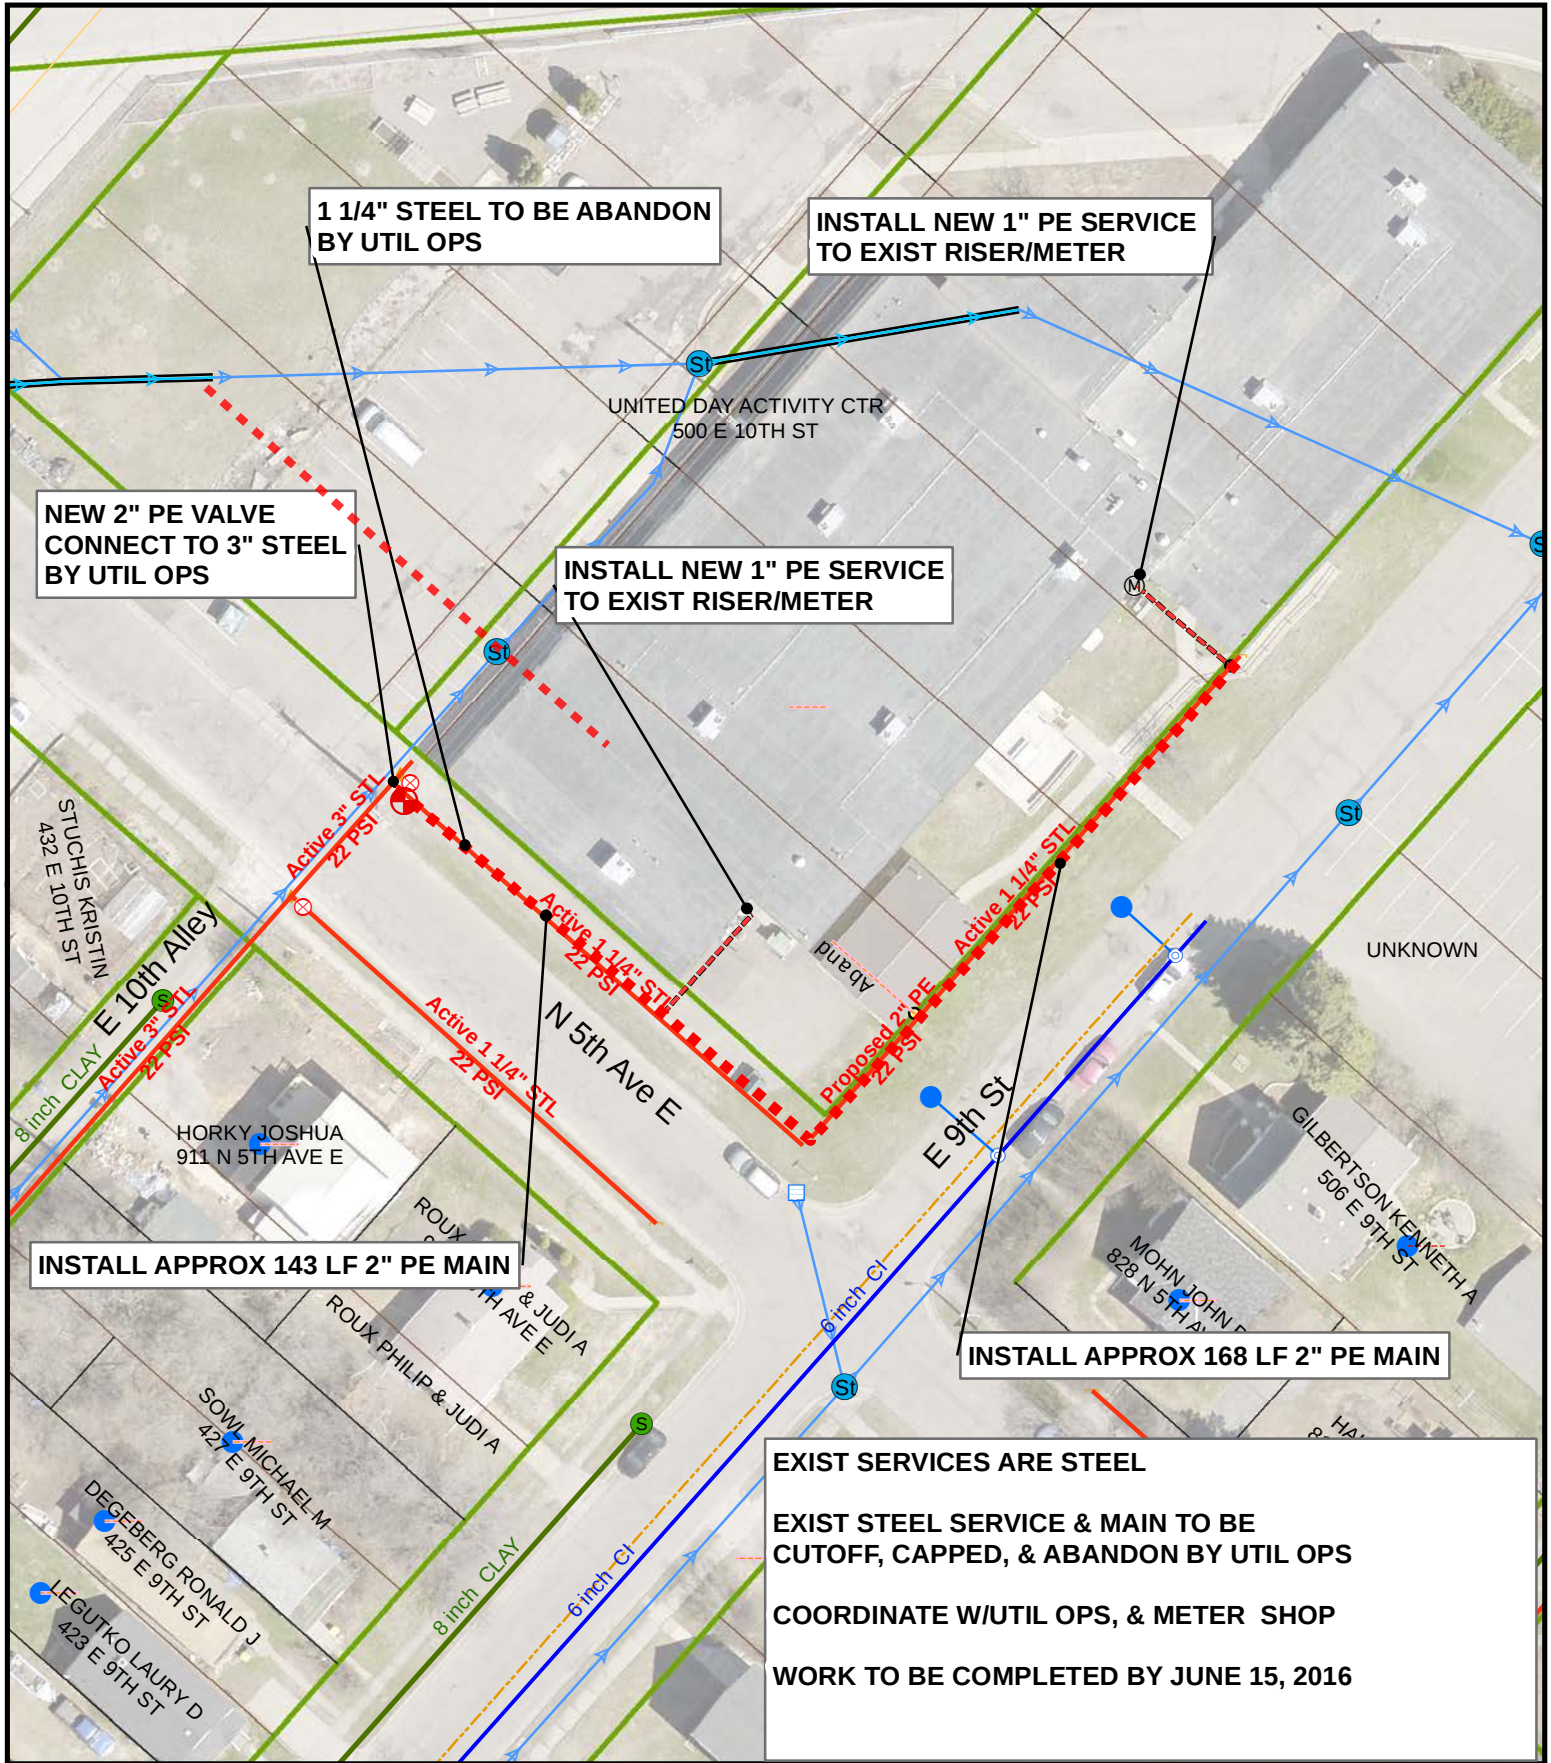



DATE COMPLETED:		INSPECTOR:	
			
EXCESS FLOW VALVE: <u>YES</u> APPL #: <u>2016033</u> EAM #: <u>428370</u> ZONE: <u>4</u> PLAN OF: <u>INSTALL NEW 2" GAS MAIN AND 2-1" PE SERVICES</u> LOCATION: <u>500 E 10TH ST</u> FROM: _____ TO: _____ DEPARTMENT OF PUBLIC WORKS AND UTILITIES			
		 JOB NO: <u>1480-033</u> DRAWN BY: <u>MHW</u> DATE: <u>2/4/2016</u>	

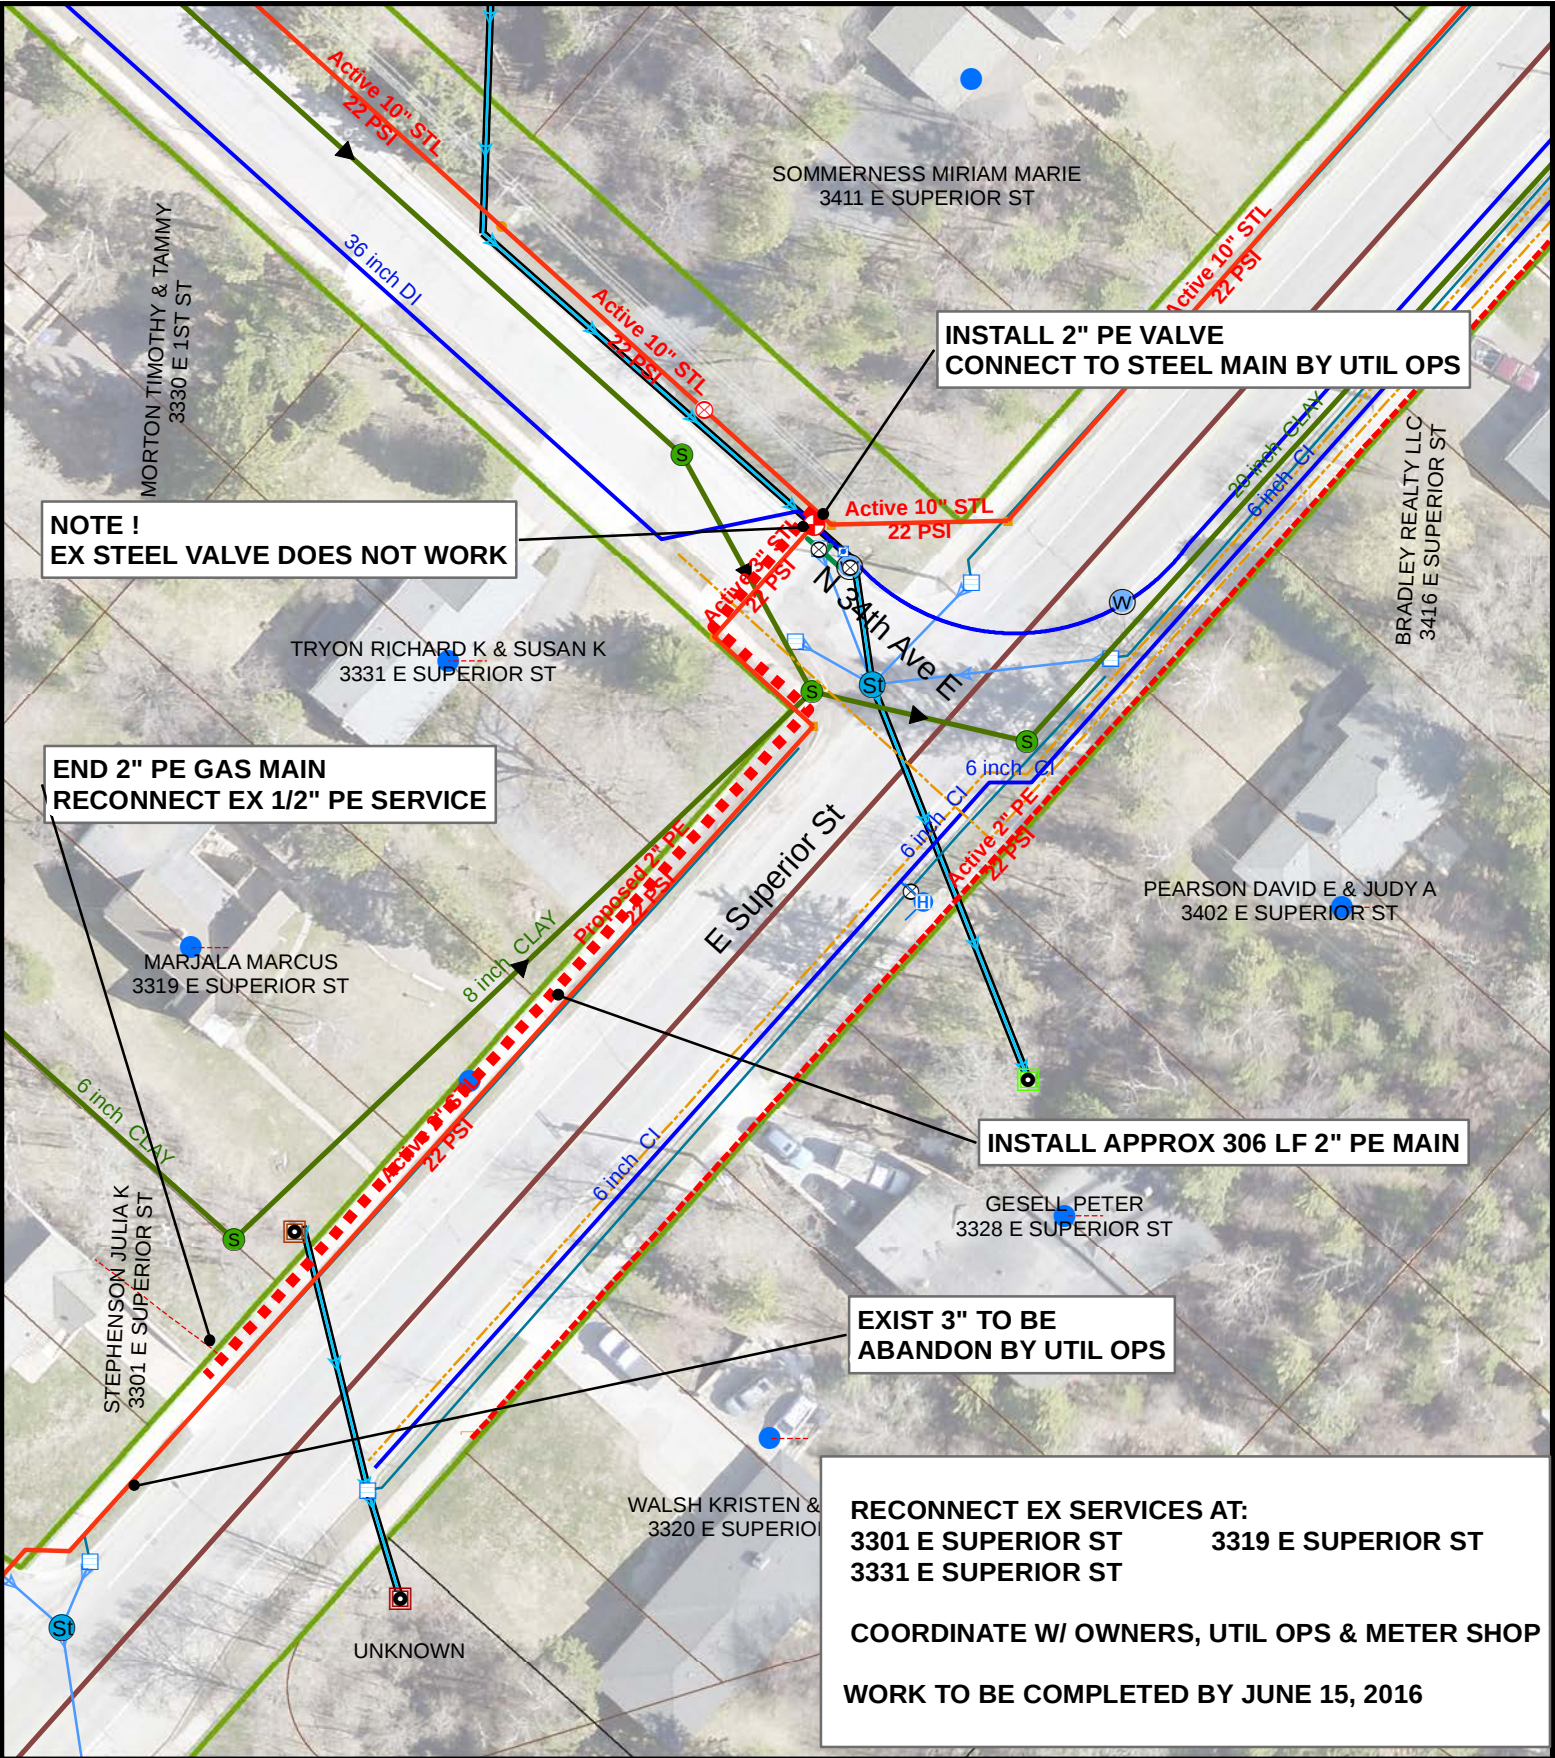



DATE COMPLETED:		INSPECTOR:	
			
EXCESS FLOW VALVE: <u>N/A</u> APPL #: <u>N/A</u> EAM #: <u>428370</u> ZONE: <u>4</u> PLAN OF: <u>INSTALL NEW 2" PE GAS MAIN</u> LOCATION: <u>E SUPERIOR ST AND N 34TH AVE E</u> FROM: <u>N 34TH AVE E</u> TO: <u>255' W OF N 34TH AVE E</u> DEPARTMENT OF PUBLIC WORKS AND UTILITIES			
		JOB NO: <u>1480-035</u>	
		DRAWN BY: <u>MHW</u>	
		DATE: <u>3/2/2016</u>	

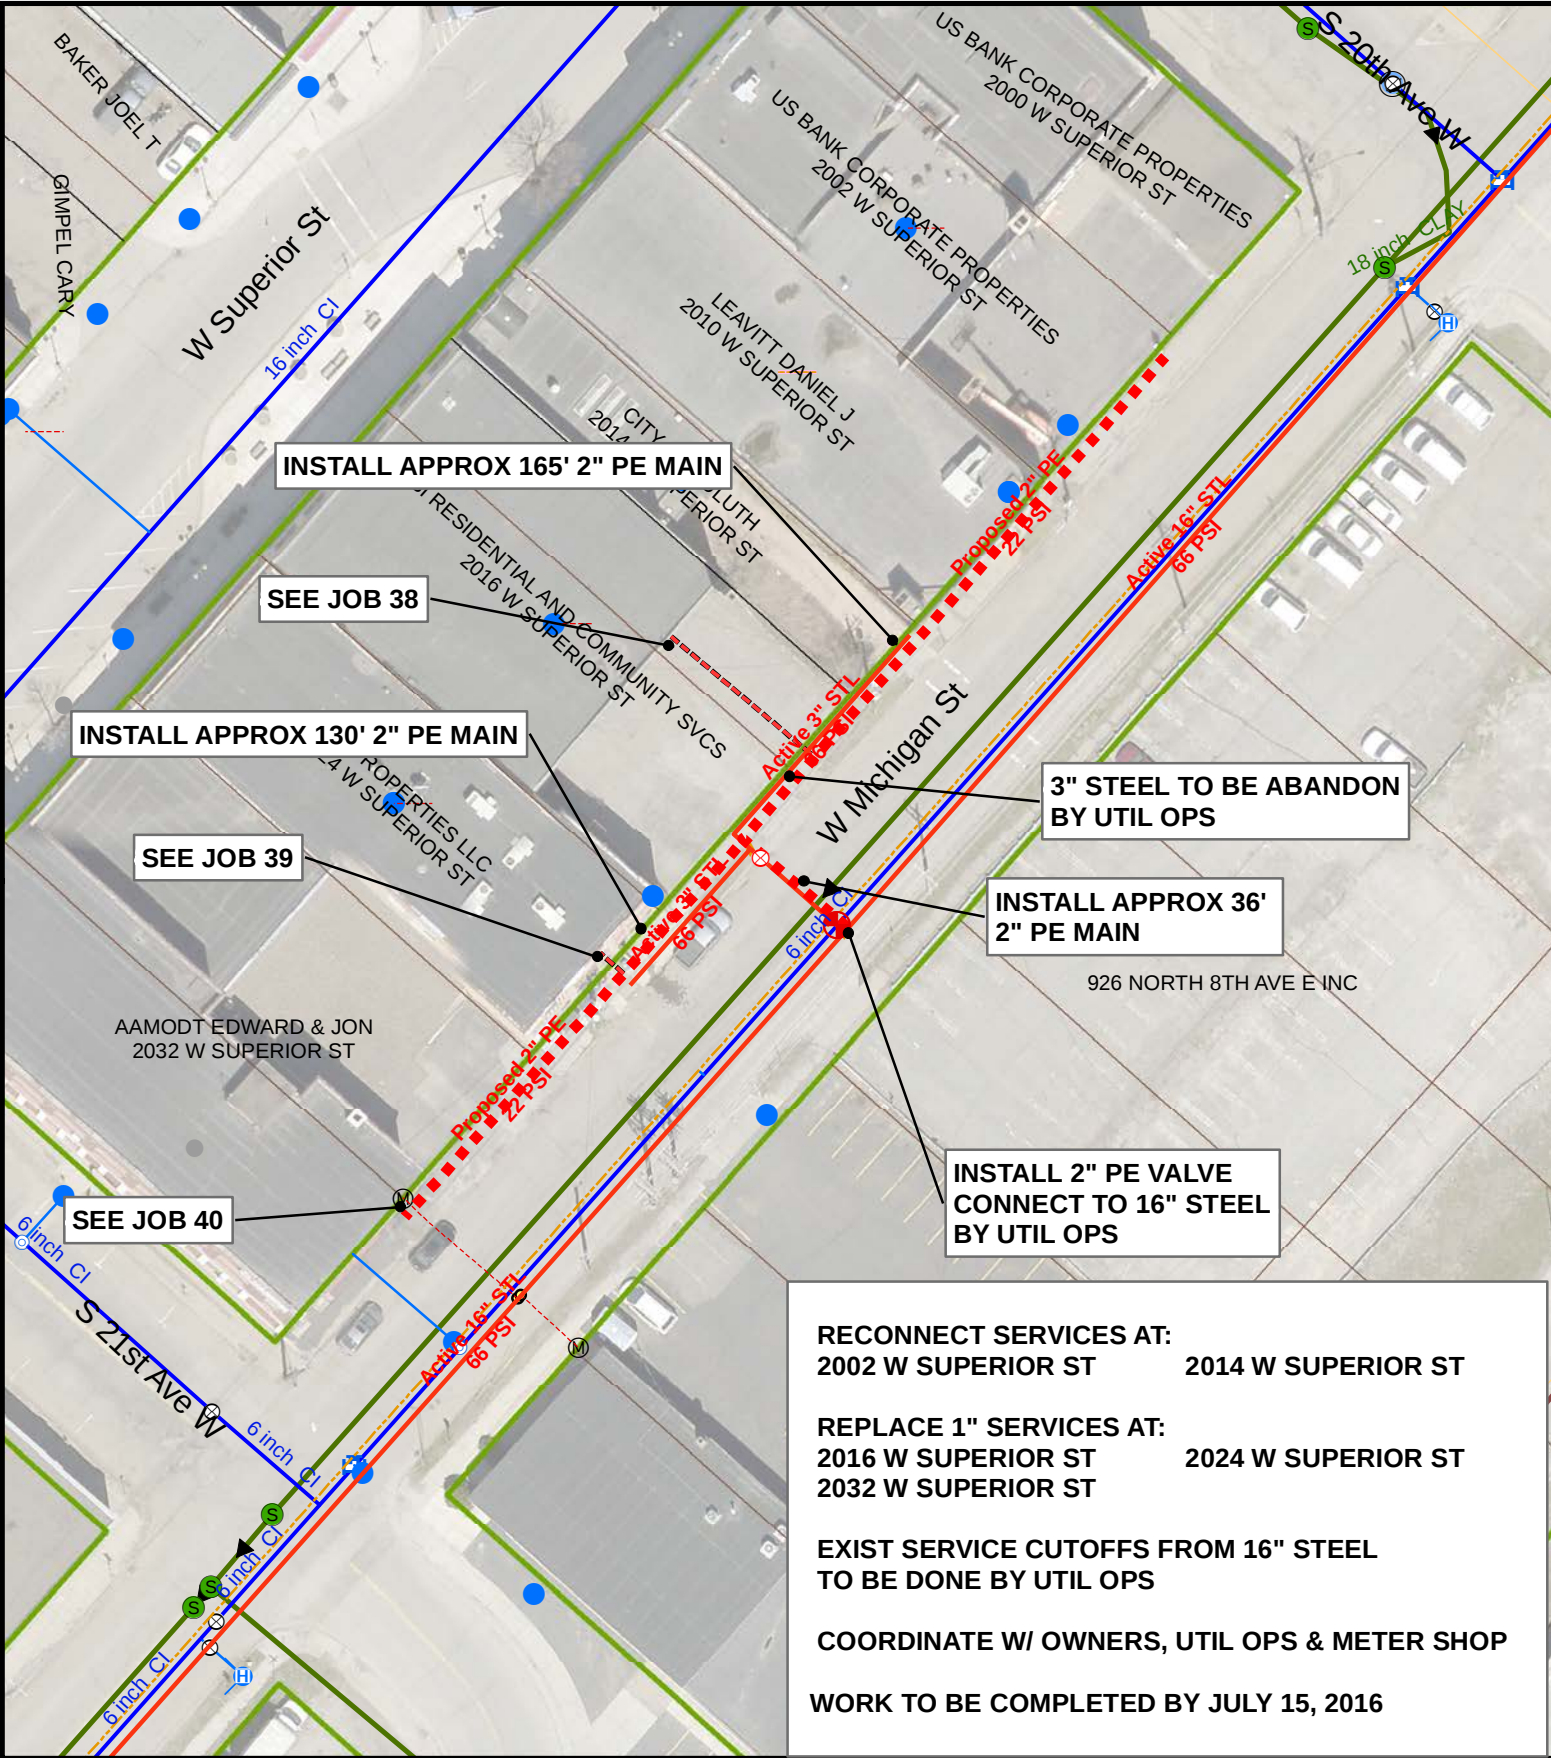


DATE COMPLETED:		INSPECTOR:	
			
EXCESS FLOW VALVE: <u>N/A</u> APPL #: <u>N/A</u> EAM #: <u>428370</u> ZONE: <u>5</u> PLAN OF: <u>INSTALL NEW 2" PE GAS MAIN</u> LOCATION: <u>W MICHIGAN ST</u> FROM: <u>S 20TH AVE W</u> TO: <u>S 21ST AVE W</u> DEPARTMENT OF PUBLIC WORKS AND UTILITIES			
		JOB NO: <u>1480-037</u>	
		DRAWN BY: <u>MHW</u>	
		DATE: <u>2/3/2016</u>	

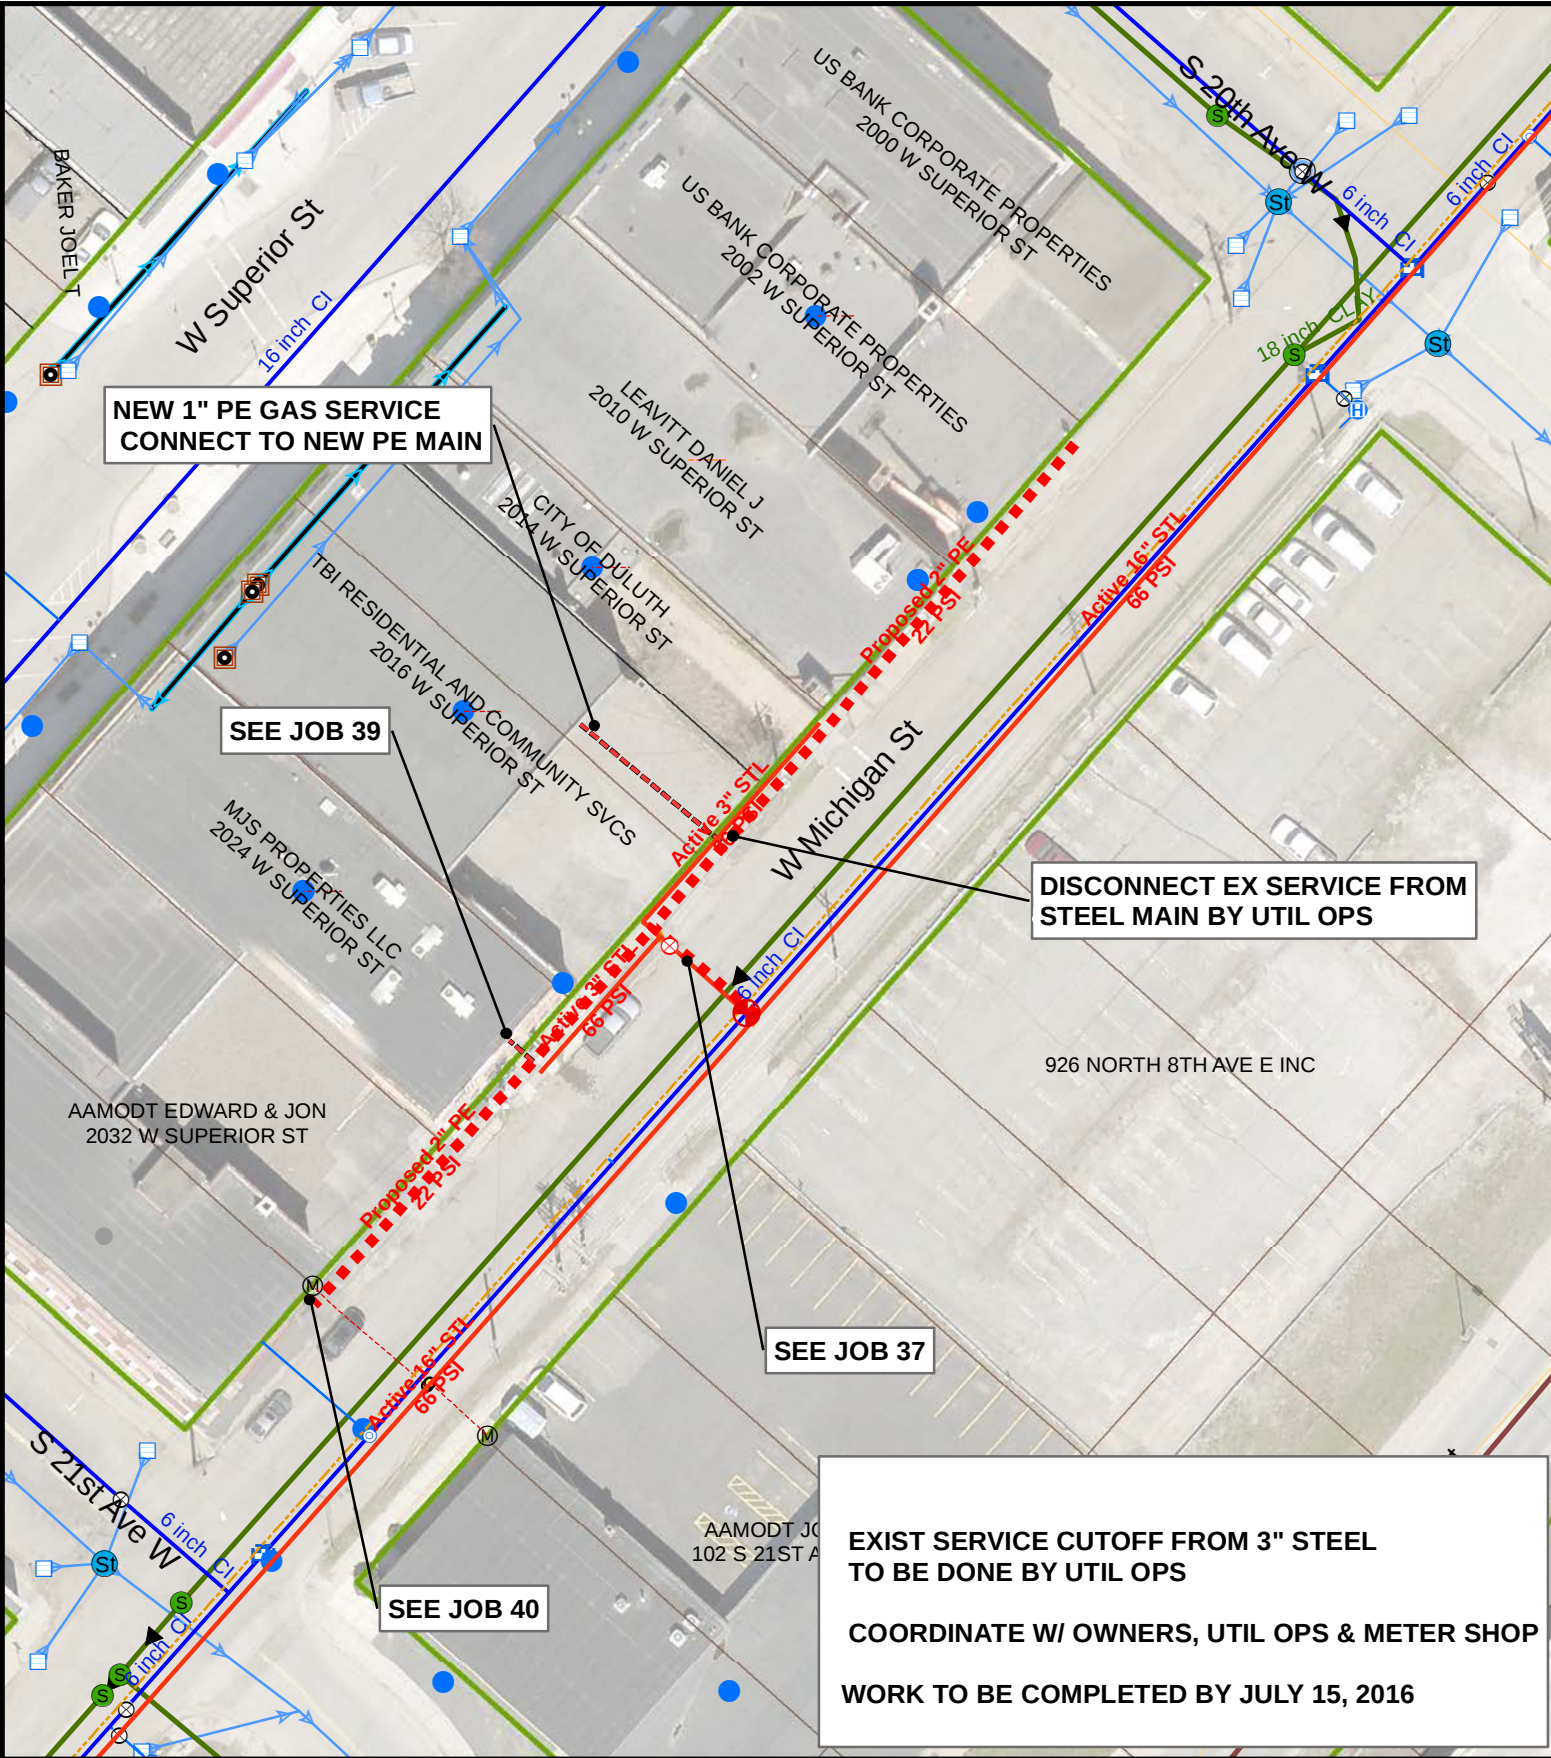



DATE COMPLETED:		INSPECTOR:		
		 NTS		
EXCESS FLOW VALVE: <u>N/A</u> APPL #: <u>N/A</u> EAM #: <u>428370</u> ZONE: <u>5</u> PLAN OF: <u>REPLACE NEW 1" PE GAS SERVICE</u> LOCATION: <u>2016 W SUPERIOR ST</u> FROM: _____ TO: _____ DEPARTMENT OF PUBLIC WORKS AND UTILITIES				 JOB NO: <u>1480-038</u> DRAWN BY: <u>MHW</u> DATE: <u>3/2/2016</u>

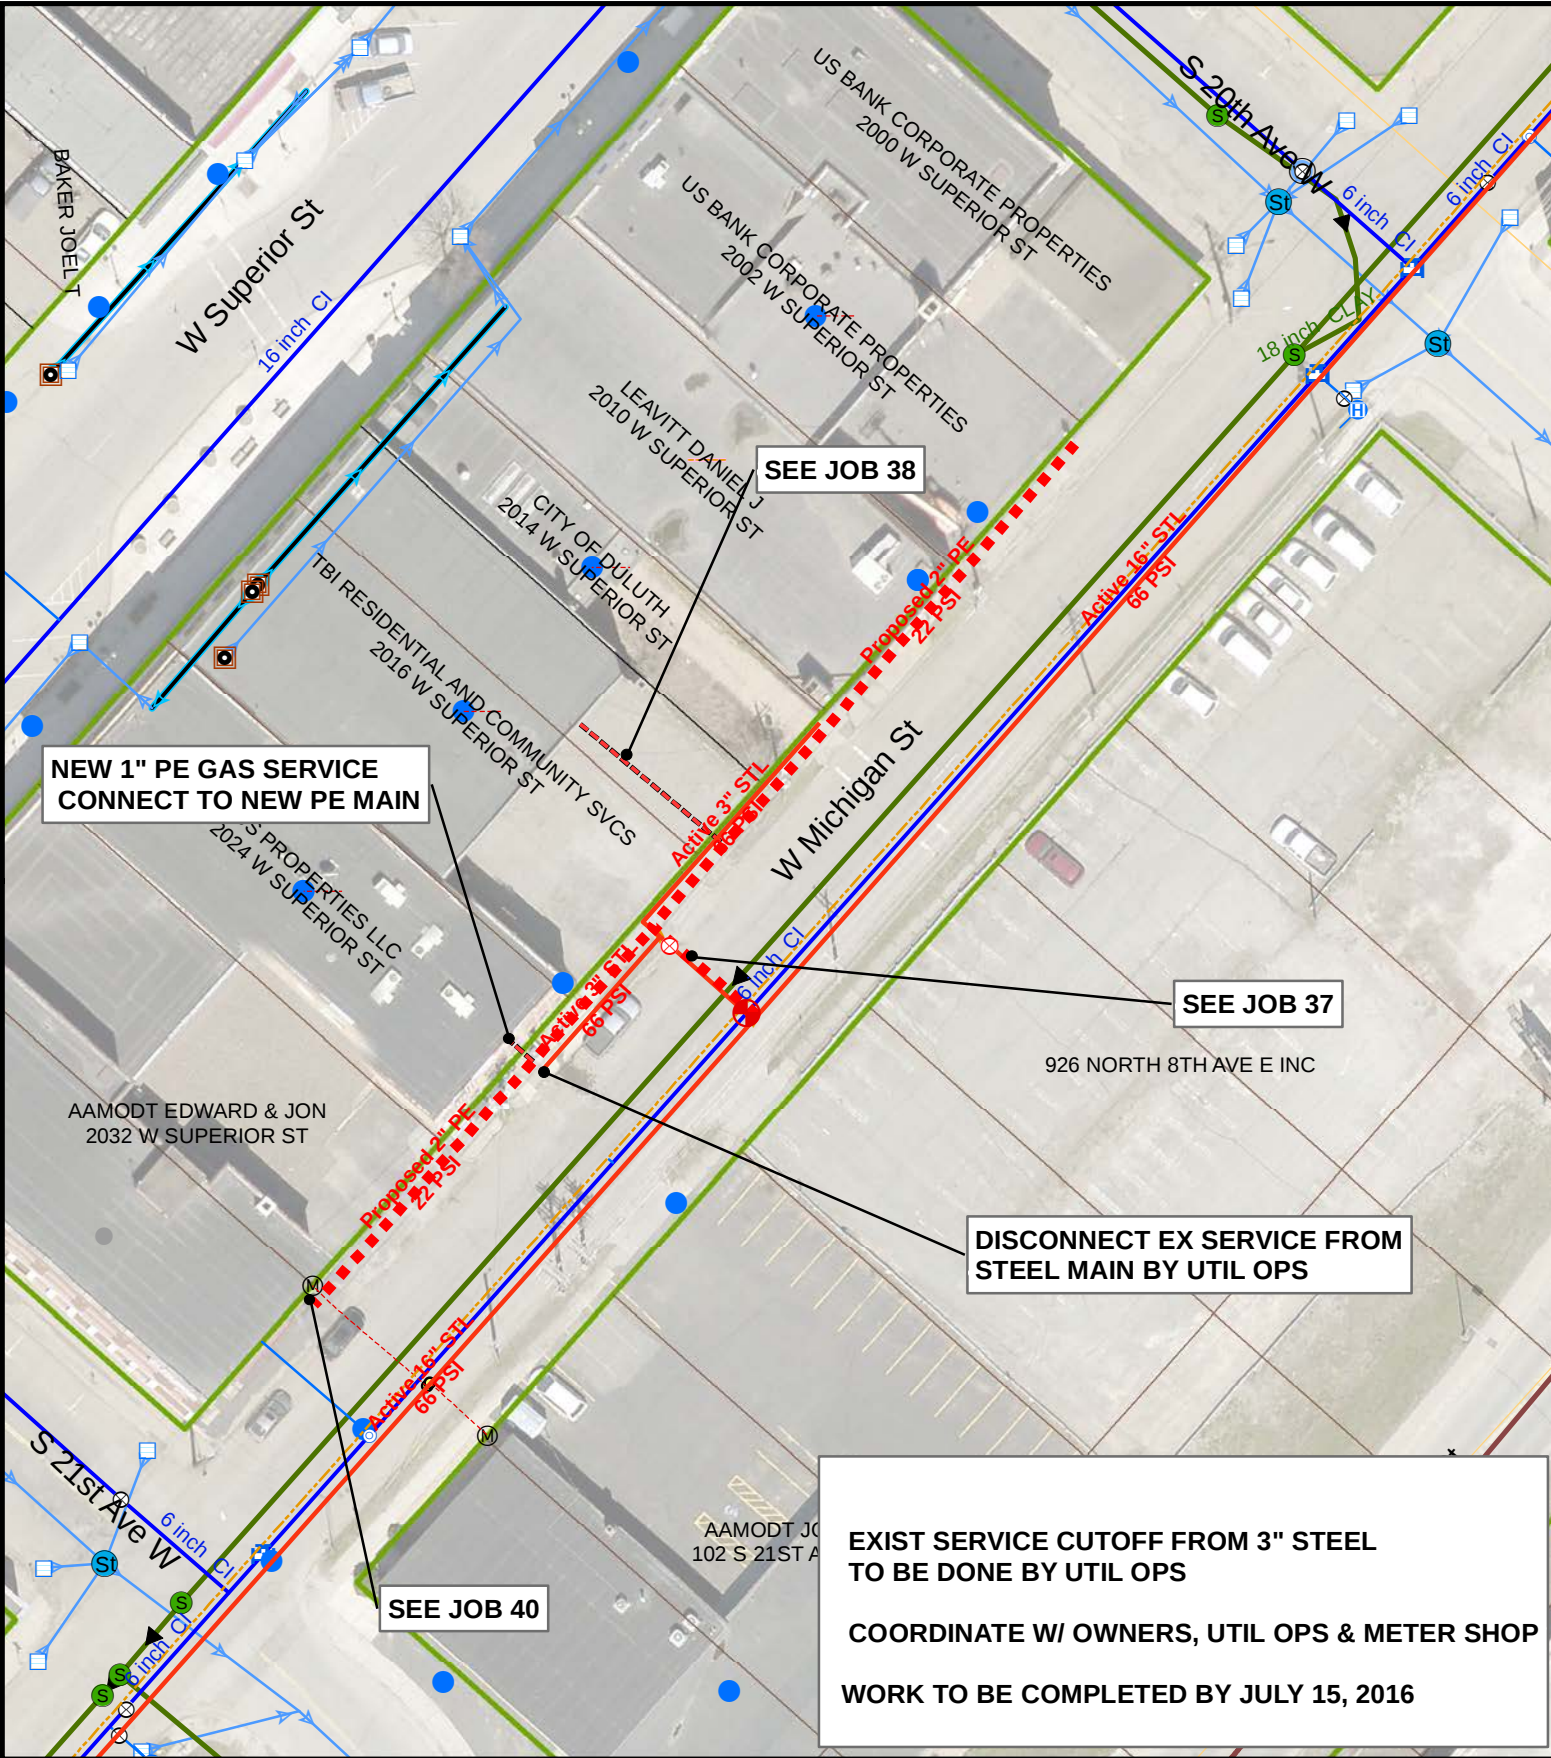


DATE COMPLETED:		INSPECTOR:	
EXCESS FLOW VALVE: <u>N/A</u> APPL #: <u>N/A</u> EAM #: <u>428370</u> ZONE: <u>5</u> PLAN OF: <u>REPLACE NEW 1" PE GAS SERVICE</u> LOCATION: <u>2024 W SUPERIOR ST</u> FROM: _____ TO: _____ DEPARTMENT OF PUBLIC WORKS AND UTILITIES			
		JOB NO: <u>1480-039</u>	
		DRAWN BY: <u>MHW</u>	
		DATE: <u>3/2/2016</u>	

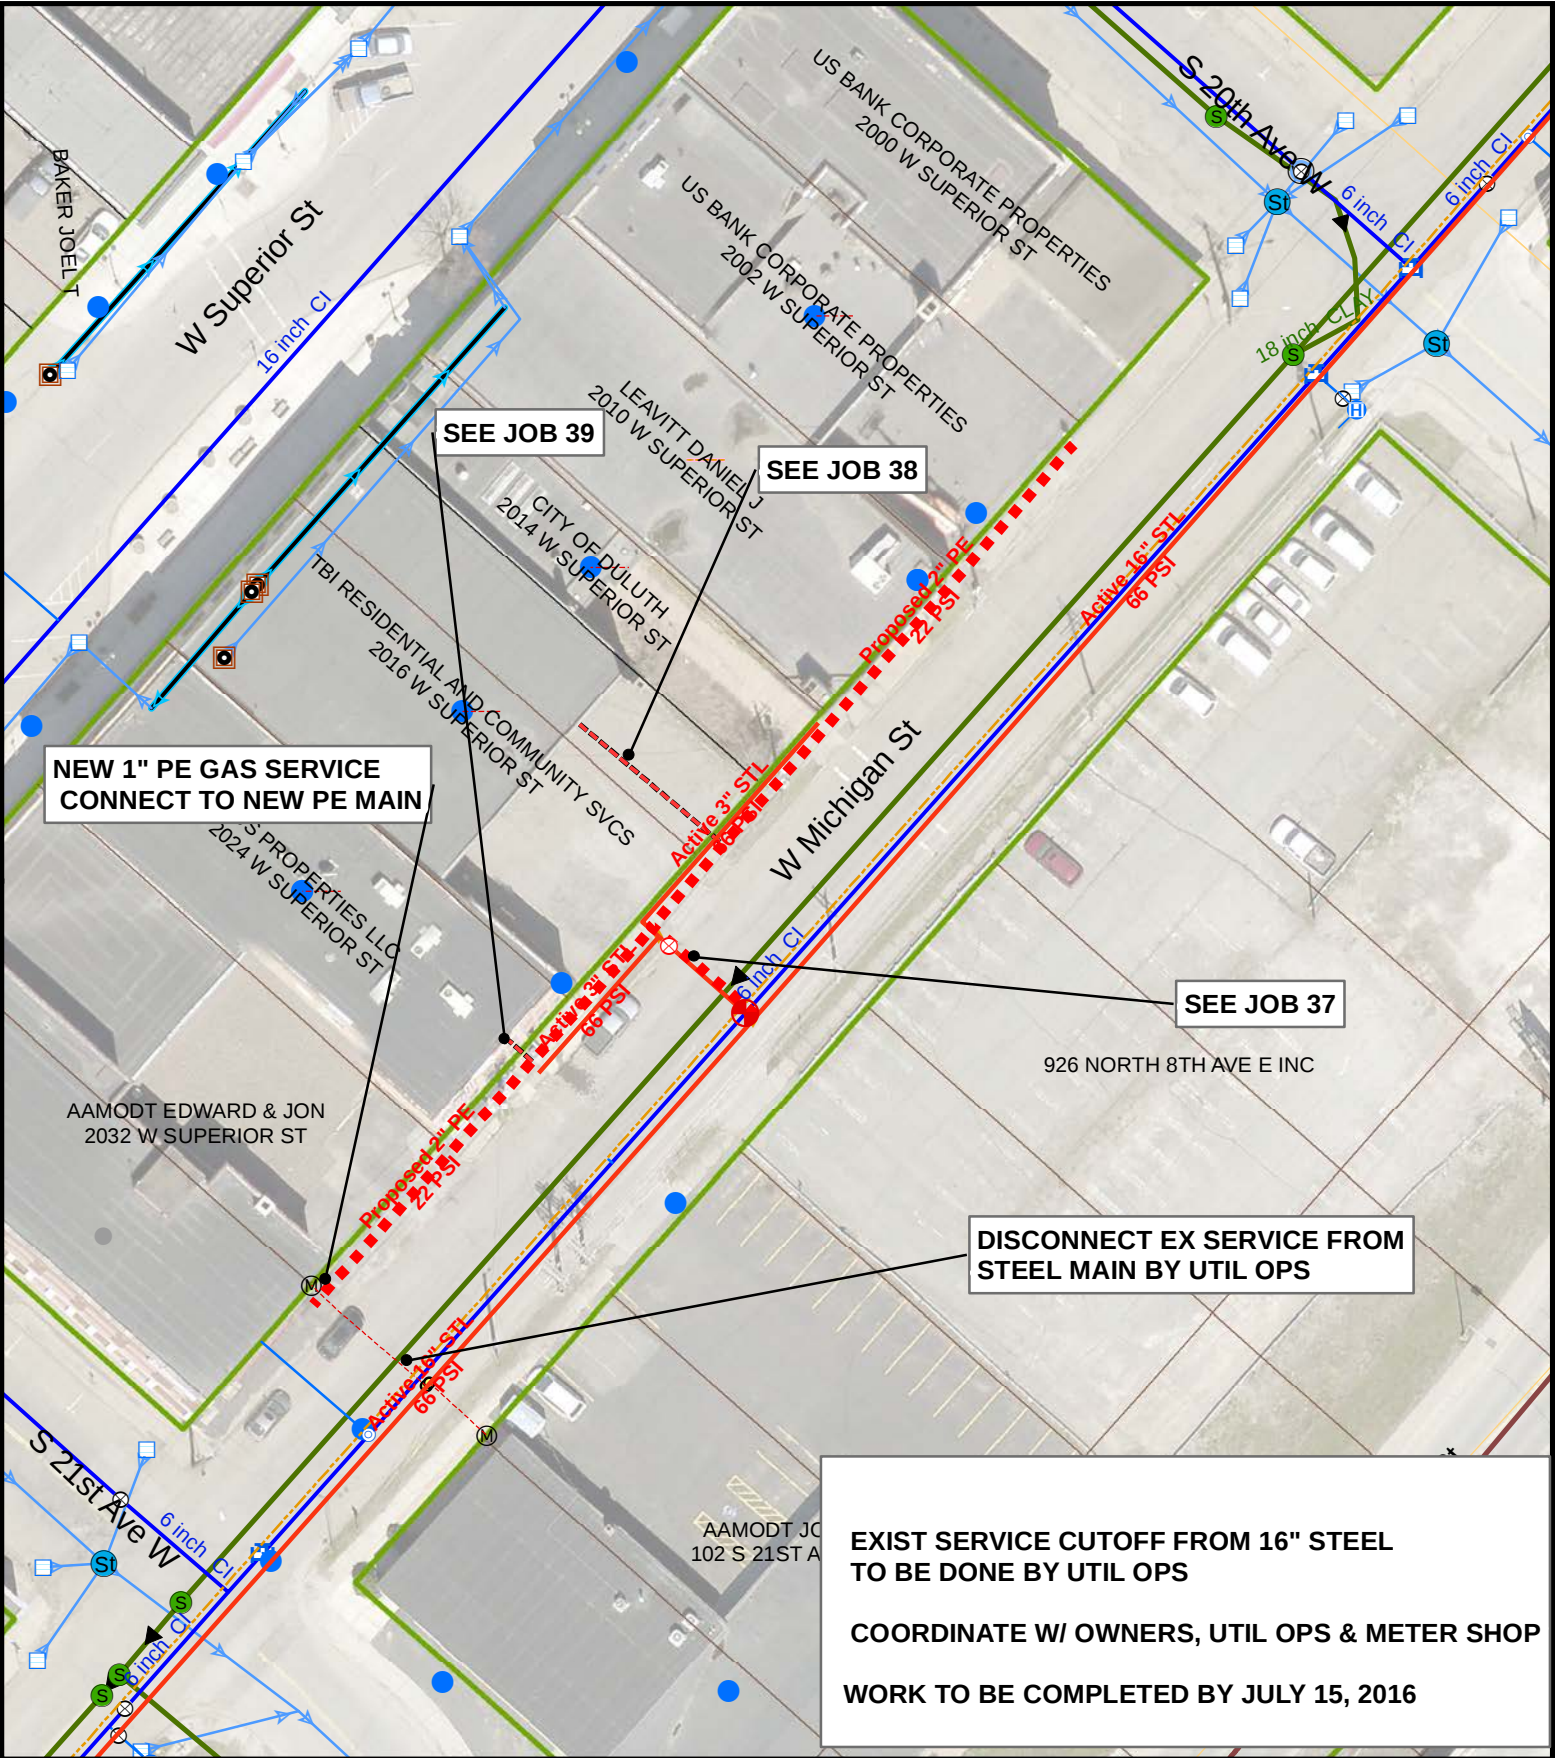


DATE COMPLETED:		INSPECTOR:		
				
EXCESS FLOW VALVE: <u>N/A</u> APPL #: <u>N/A</u> EAM #: <u>428370</u> ZONE: <u>5</u> PLAN OF: <u>REPLACE NEW 1" PE GAS SERVICE</u> LOCATION: <u>2032 W SUPERIOR ST</u> FROM: _____ TO: _____ DEPARTMENT OF PUBLIC WORKS AND UTILITIES				 JOB NO: <u>1480-040</u> DRAWN BY: <u>MHW</u> DATE: <u>3/2/2016</u>

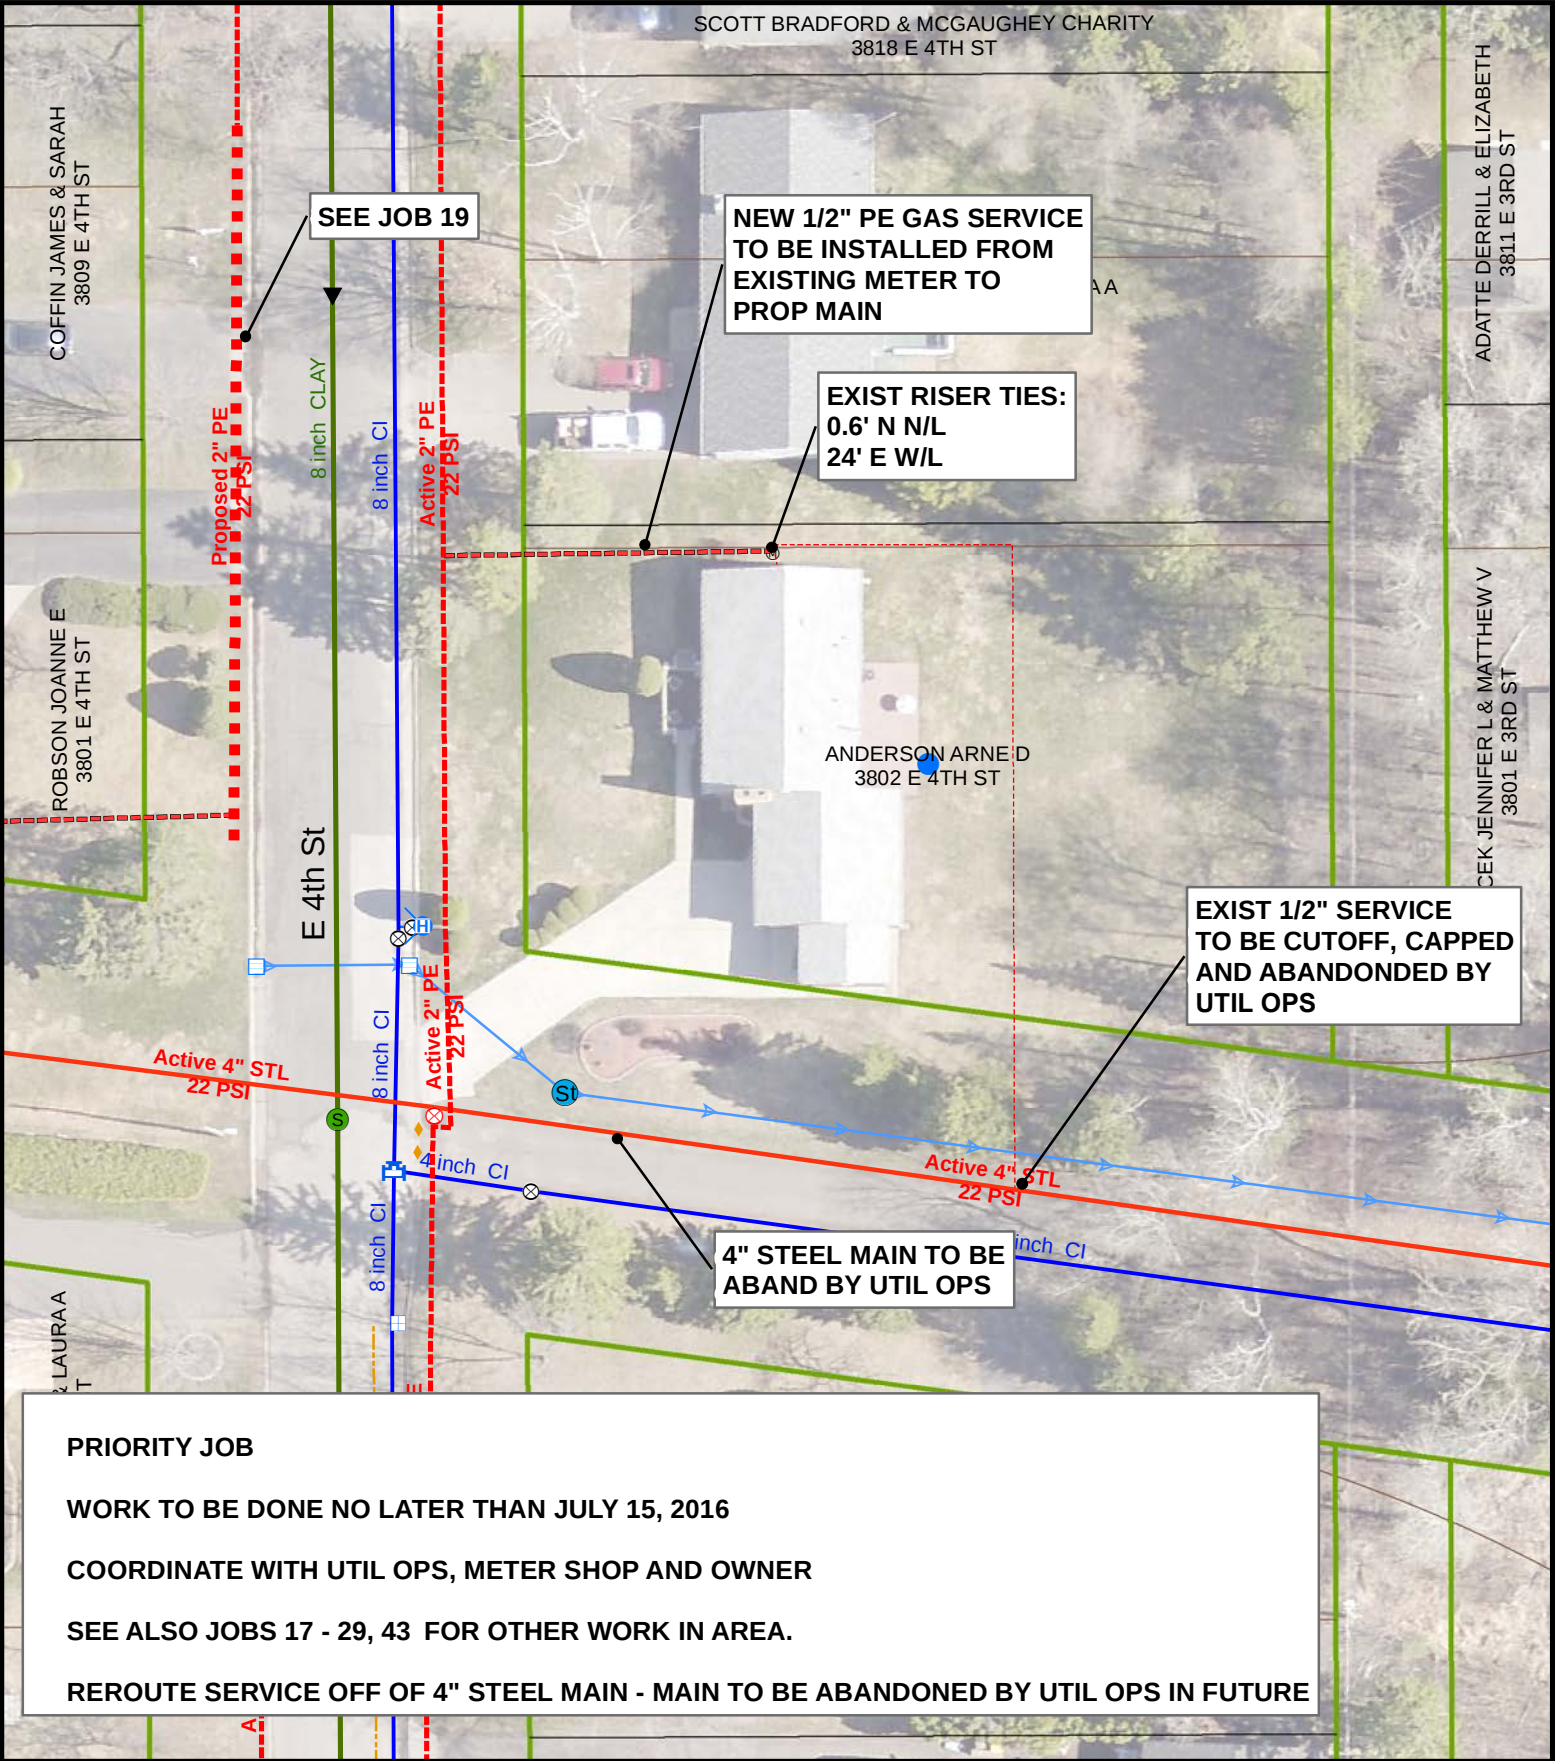

DATE COMPLETED:		INSPECTOR:	
EXCESS FLOW VALVE: <u>YES</u> APPL #: <u>2016030</u> EAM #: <u>428370</u> ZONE: <u>3</u> PLAN OF: <u>1/2" PE GAS SERVICE RELOCATION</u> LOCATION: <u>3802 E 4TH ST</u> FROM: _____ TO: _____ DEPARTMENT OF PUBLIC WORKS AND UTILITIES			
		JOB NO: <u>1480-043</u> DRAWN BY: <u>SRE</u> DATE: <u>2/2/2016</u>	

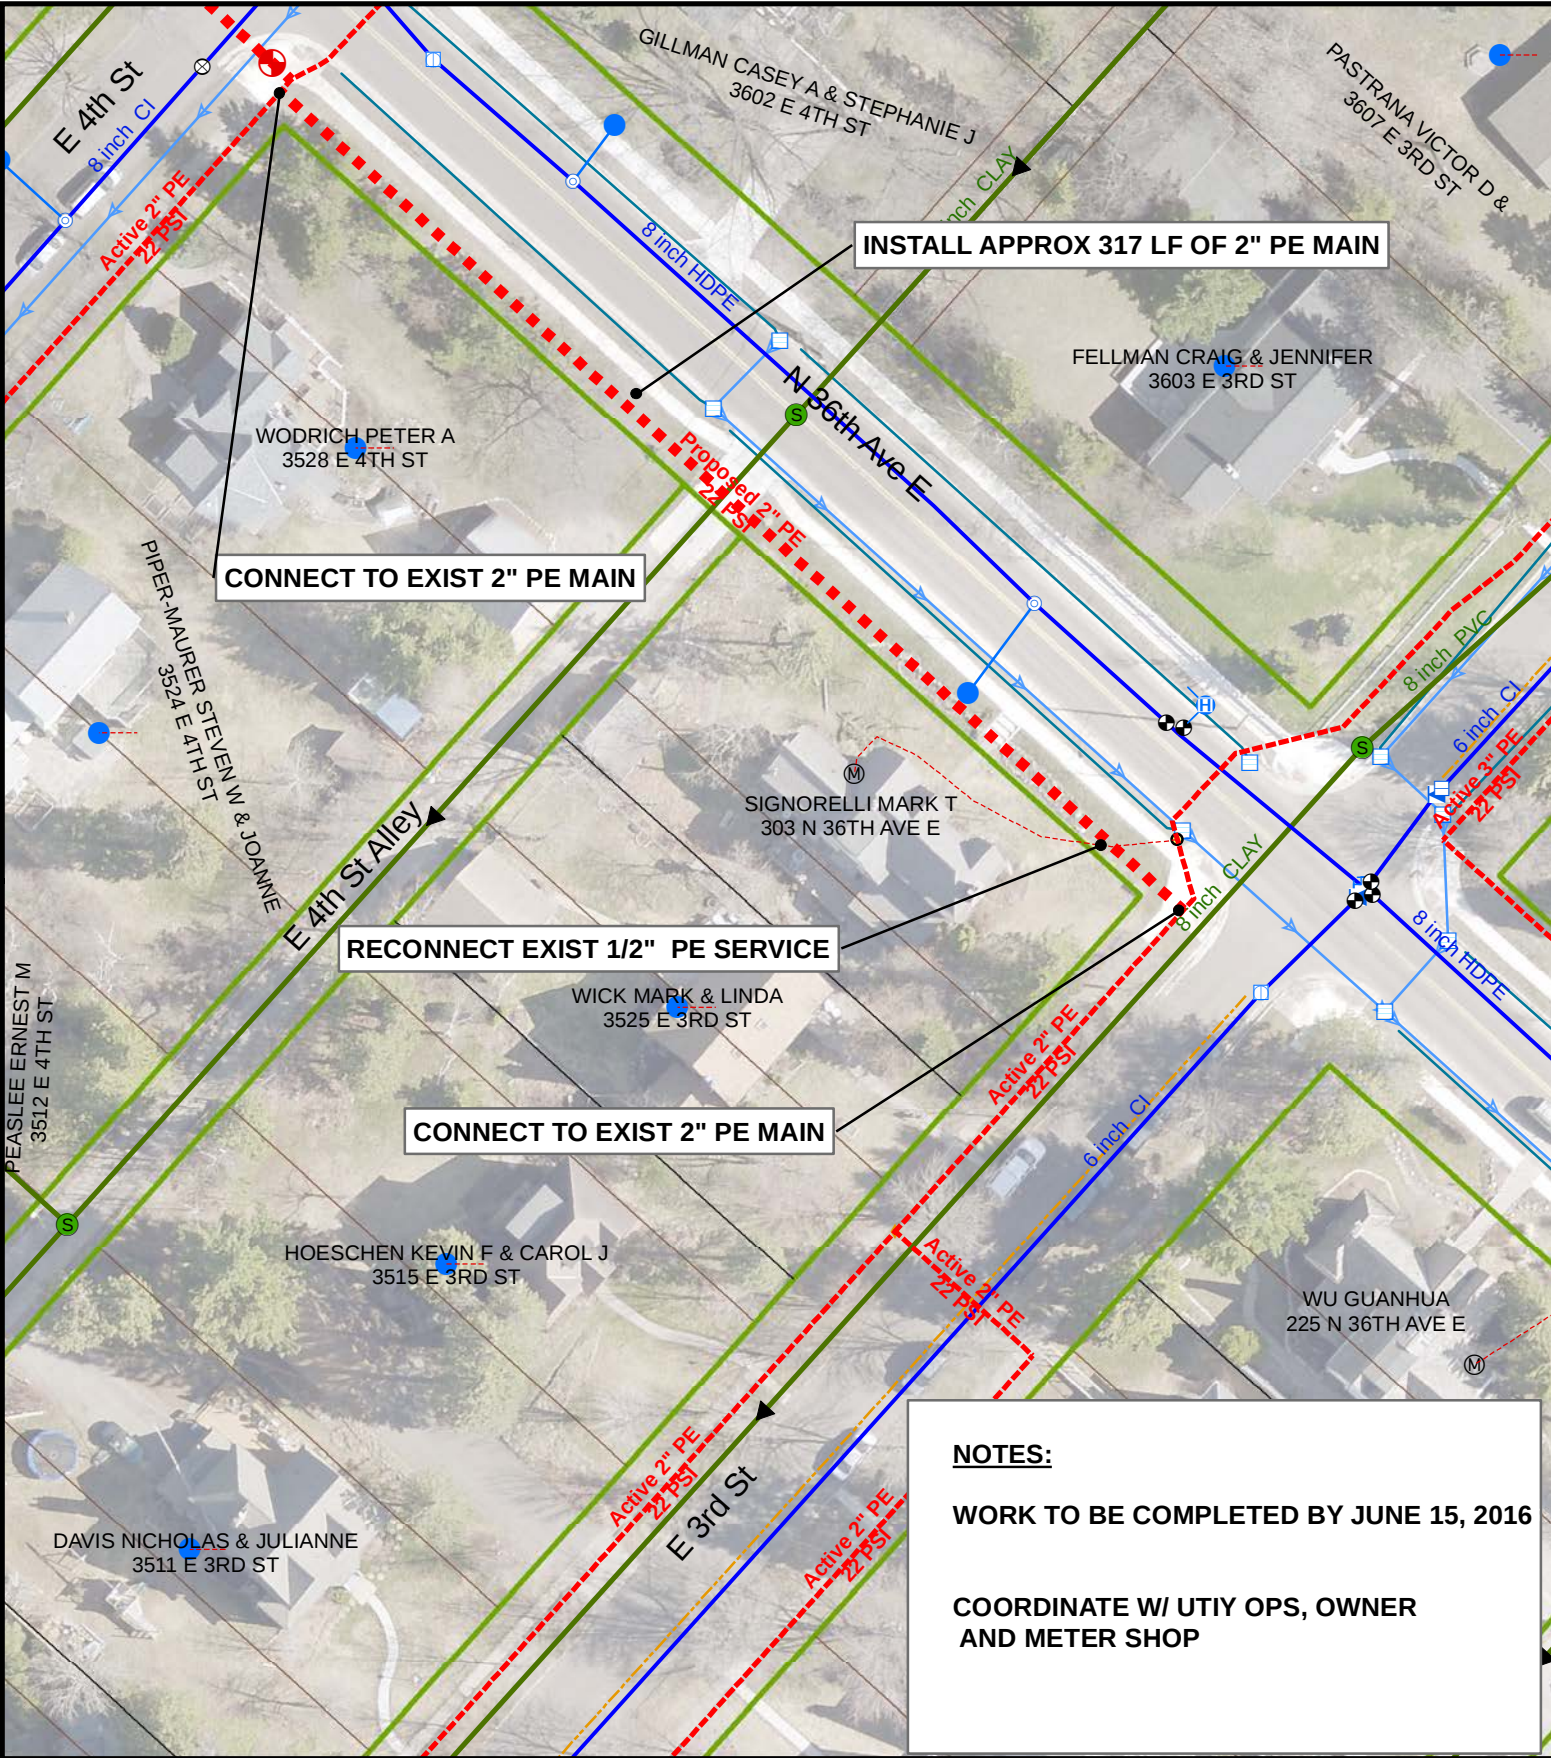

DATE COMPLETED:		INSPECTOR:	
			
EXCESS FLOW VALVE: <u>NA</u> APPL #: <u>N/A</u> EAM #: <u>428370</u> ZONE: <u>3</u> PLAN OF: <u>INSTALL NEW 2" PE GAS MAIN</u> LOCATION: <u>N 36TH AVE E</u> FROM: <u>E 3RD ST</u> TO: <u>E 4TH ST</u>			
DEPARTMENT OF PUBLIC WORKS AND UTILITIES		 JOB NO: <u>1480-045</u> DRAWN BY: <u>MHW</u> DATE: <u>2/9/2016</u>	

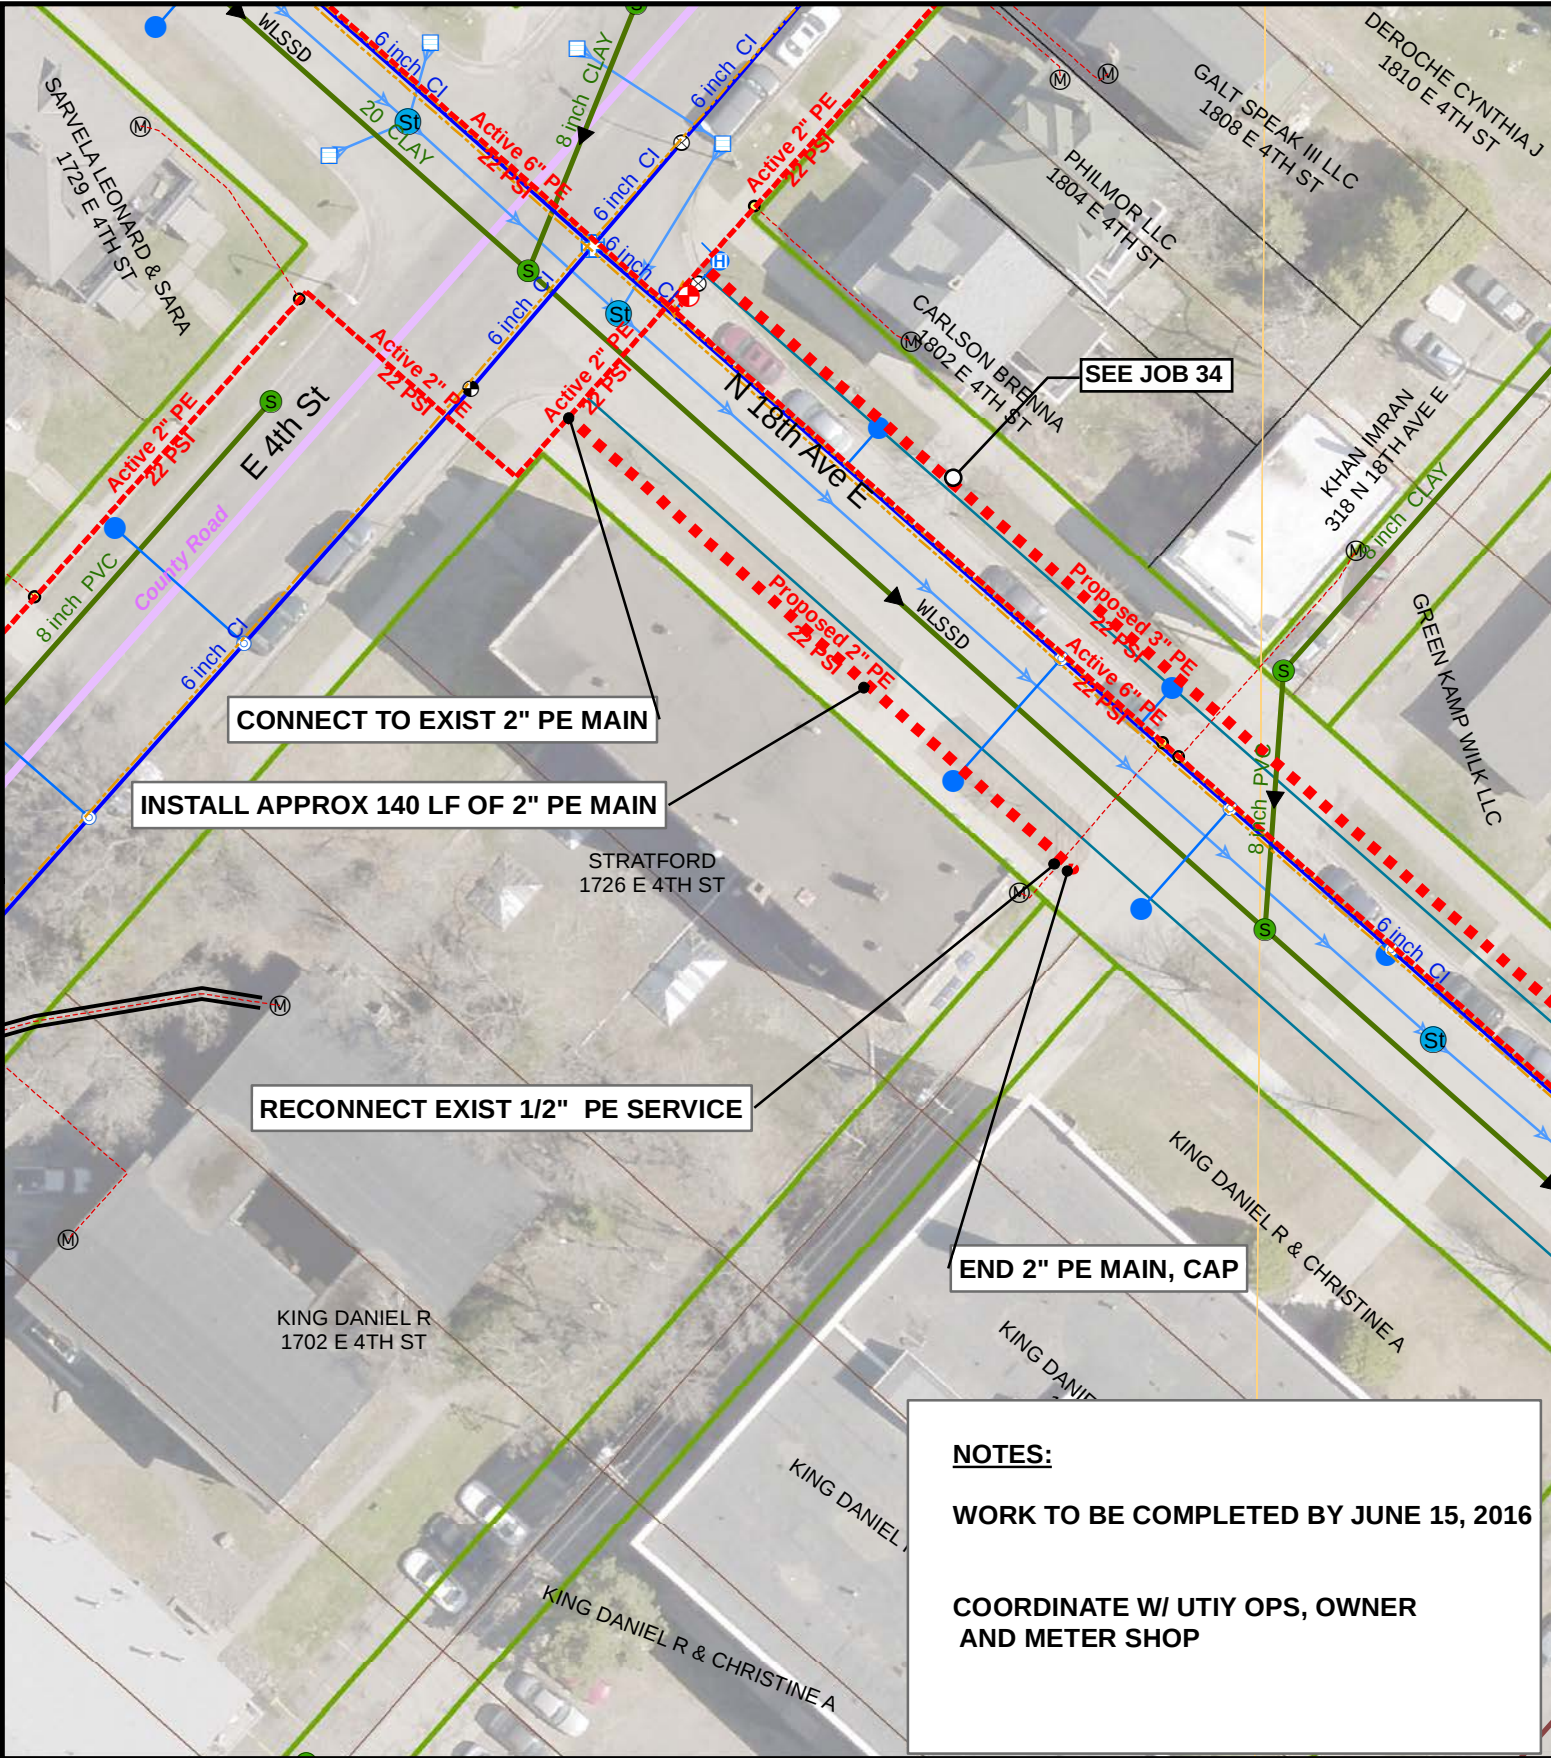


NOTES:


WORK TO BE COMPLETED BY JUNE 15, 2016

COORDINATE W/ UTIY OPS, OWNER
AND METER SHOP

DATE COMPLETED:		INSPECTOR:	
			
EXCESS FLOW VALVE: <u>NA</u> APPL #: <u>N/A</u> EAM #: <u>428370</u> ZONE: <u>4</u> PLAN OF: <u>INSTALL NEW 2" PE GAS MAIN</u> LOCATION: <u>N 18TH AVE E</u> FROM: <u>E 4TH ST</u> TO: <u>140' SOUTH</u> DEPARTMENT OF PUBLIC WORKS AND UTILITIES			
		 JOB NO: <u>1480-046</u> DRAWN BY: <u>MHW</u> DATE: <u>2/9/2016</u>	

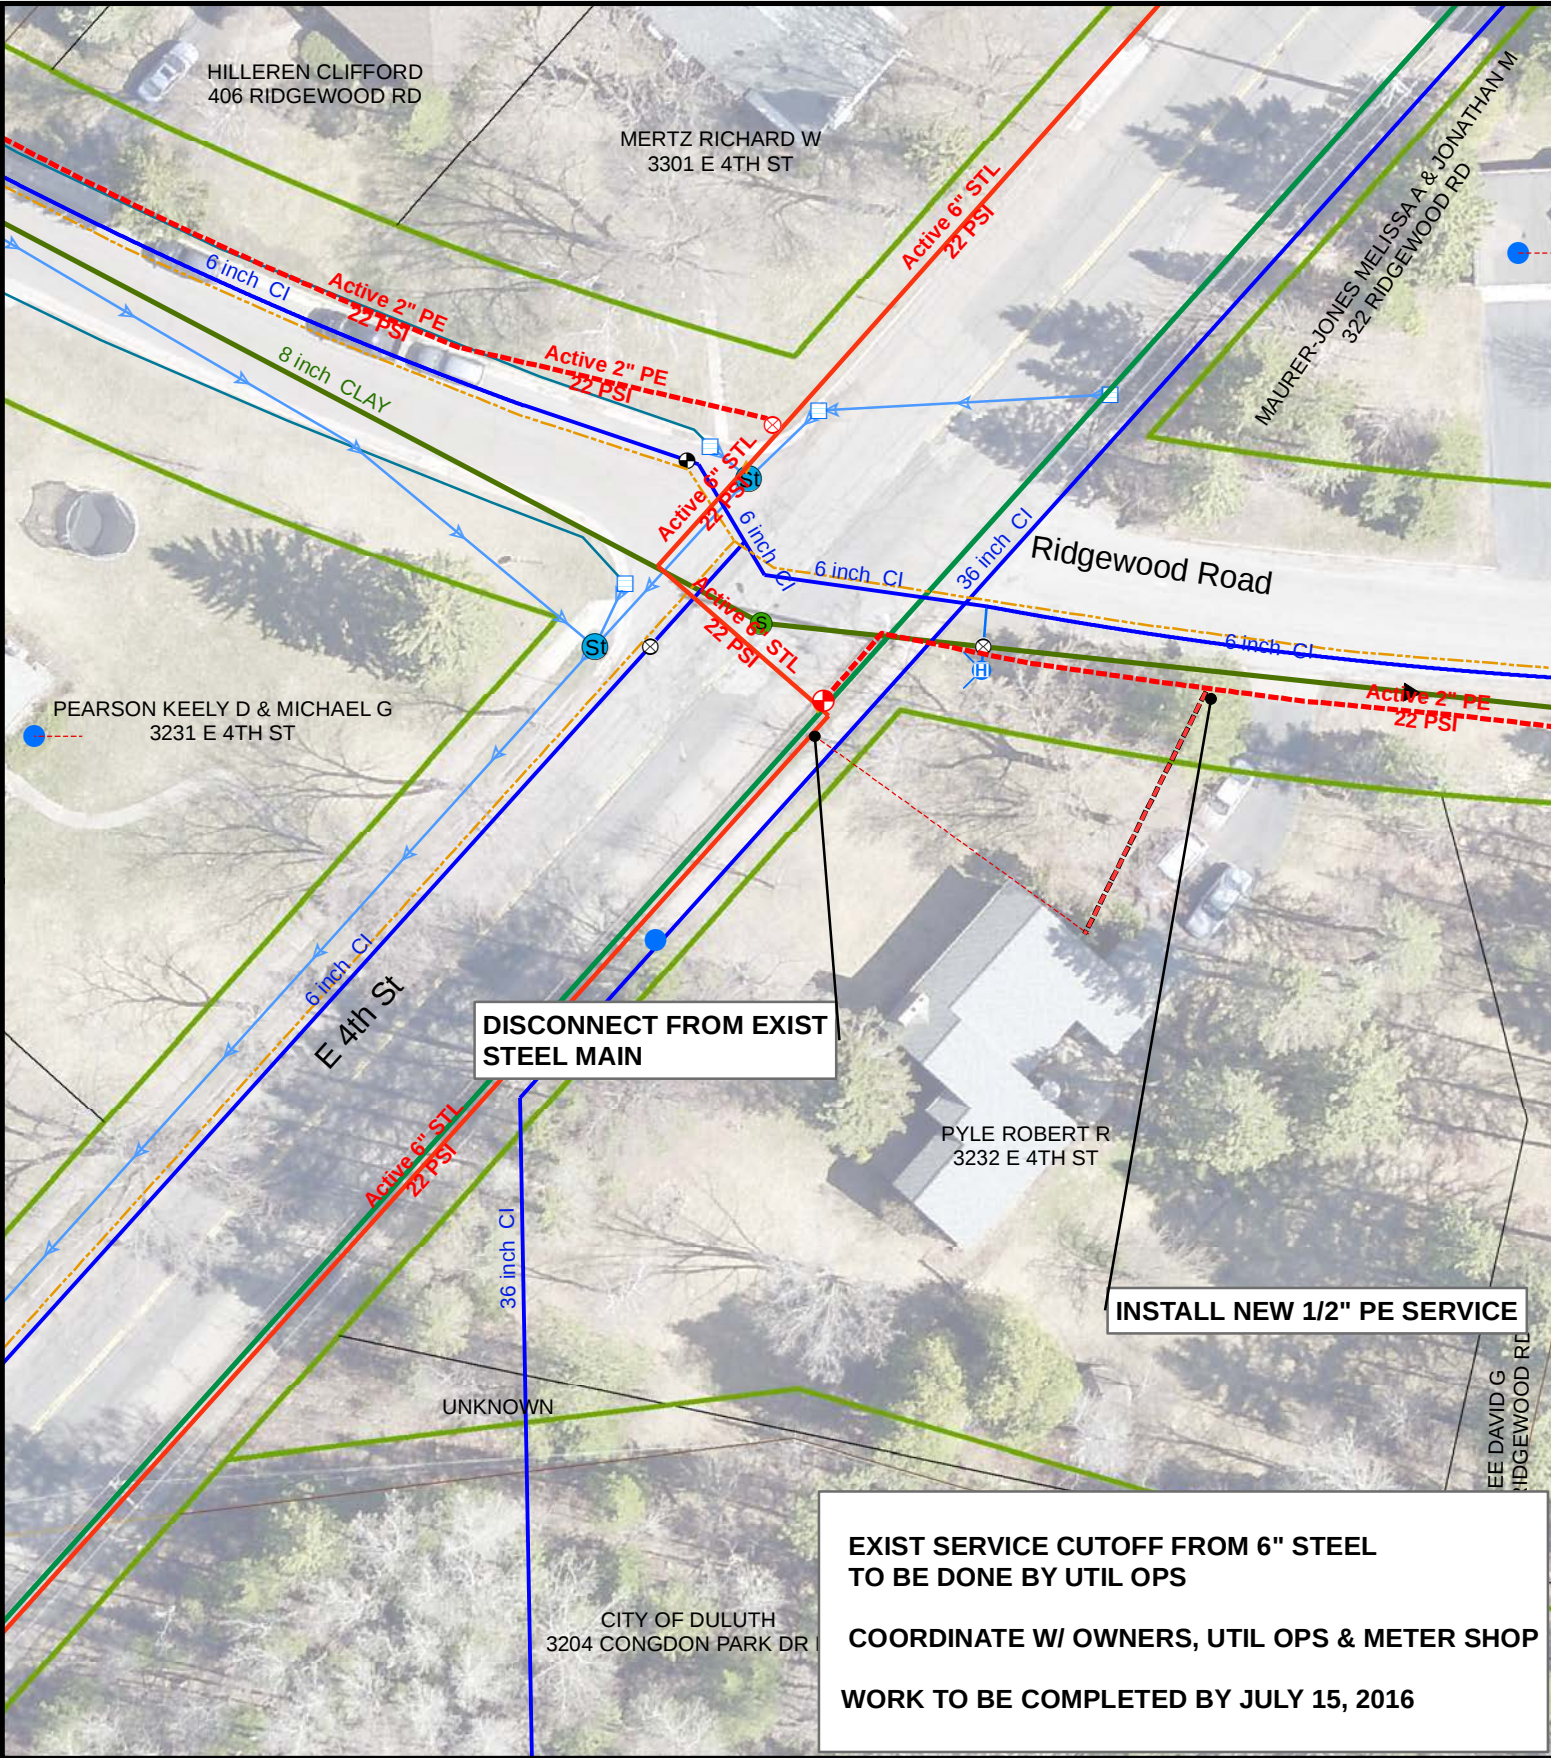

DATE COMPLETED:		INSPECTOR:	
EXCESS FLOW VALVE: <u>YES</u> APPL #: <u>N/A</u> EAM #: <u>428370</u> ZONE: <u>4</u> PLAN OF: <u>INSTALL NEW 1/2 inch PE GAS SERVICE</u> LOCATION: <u>3232 E 4TH ST</u> FROM: _____ TO: _____ DEPARTMENT OF PUBLIC WORKS AND UTILITIES			
		JOB NO: <u>1480-048</u> DRAWN BY: <u>MHW</u> DATE: <u>2/10/2016</u>	

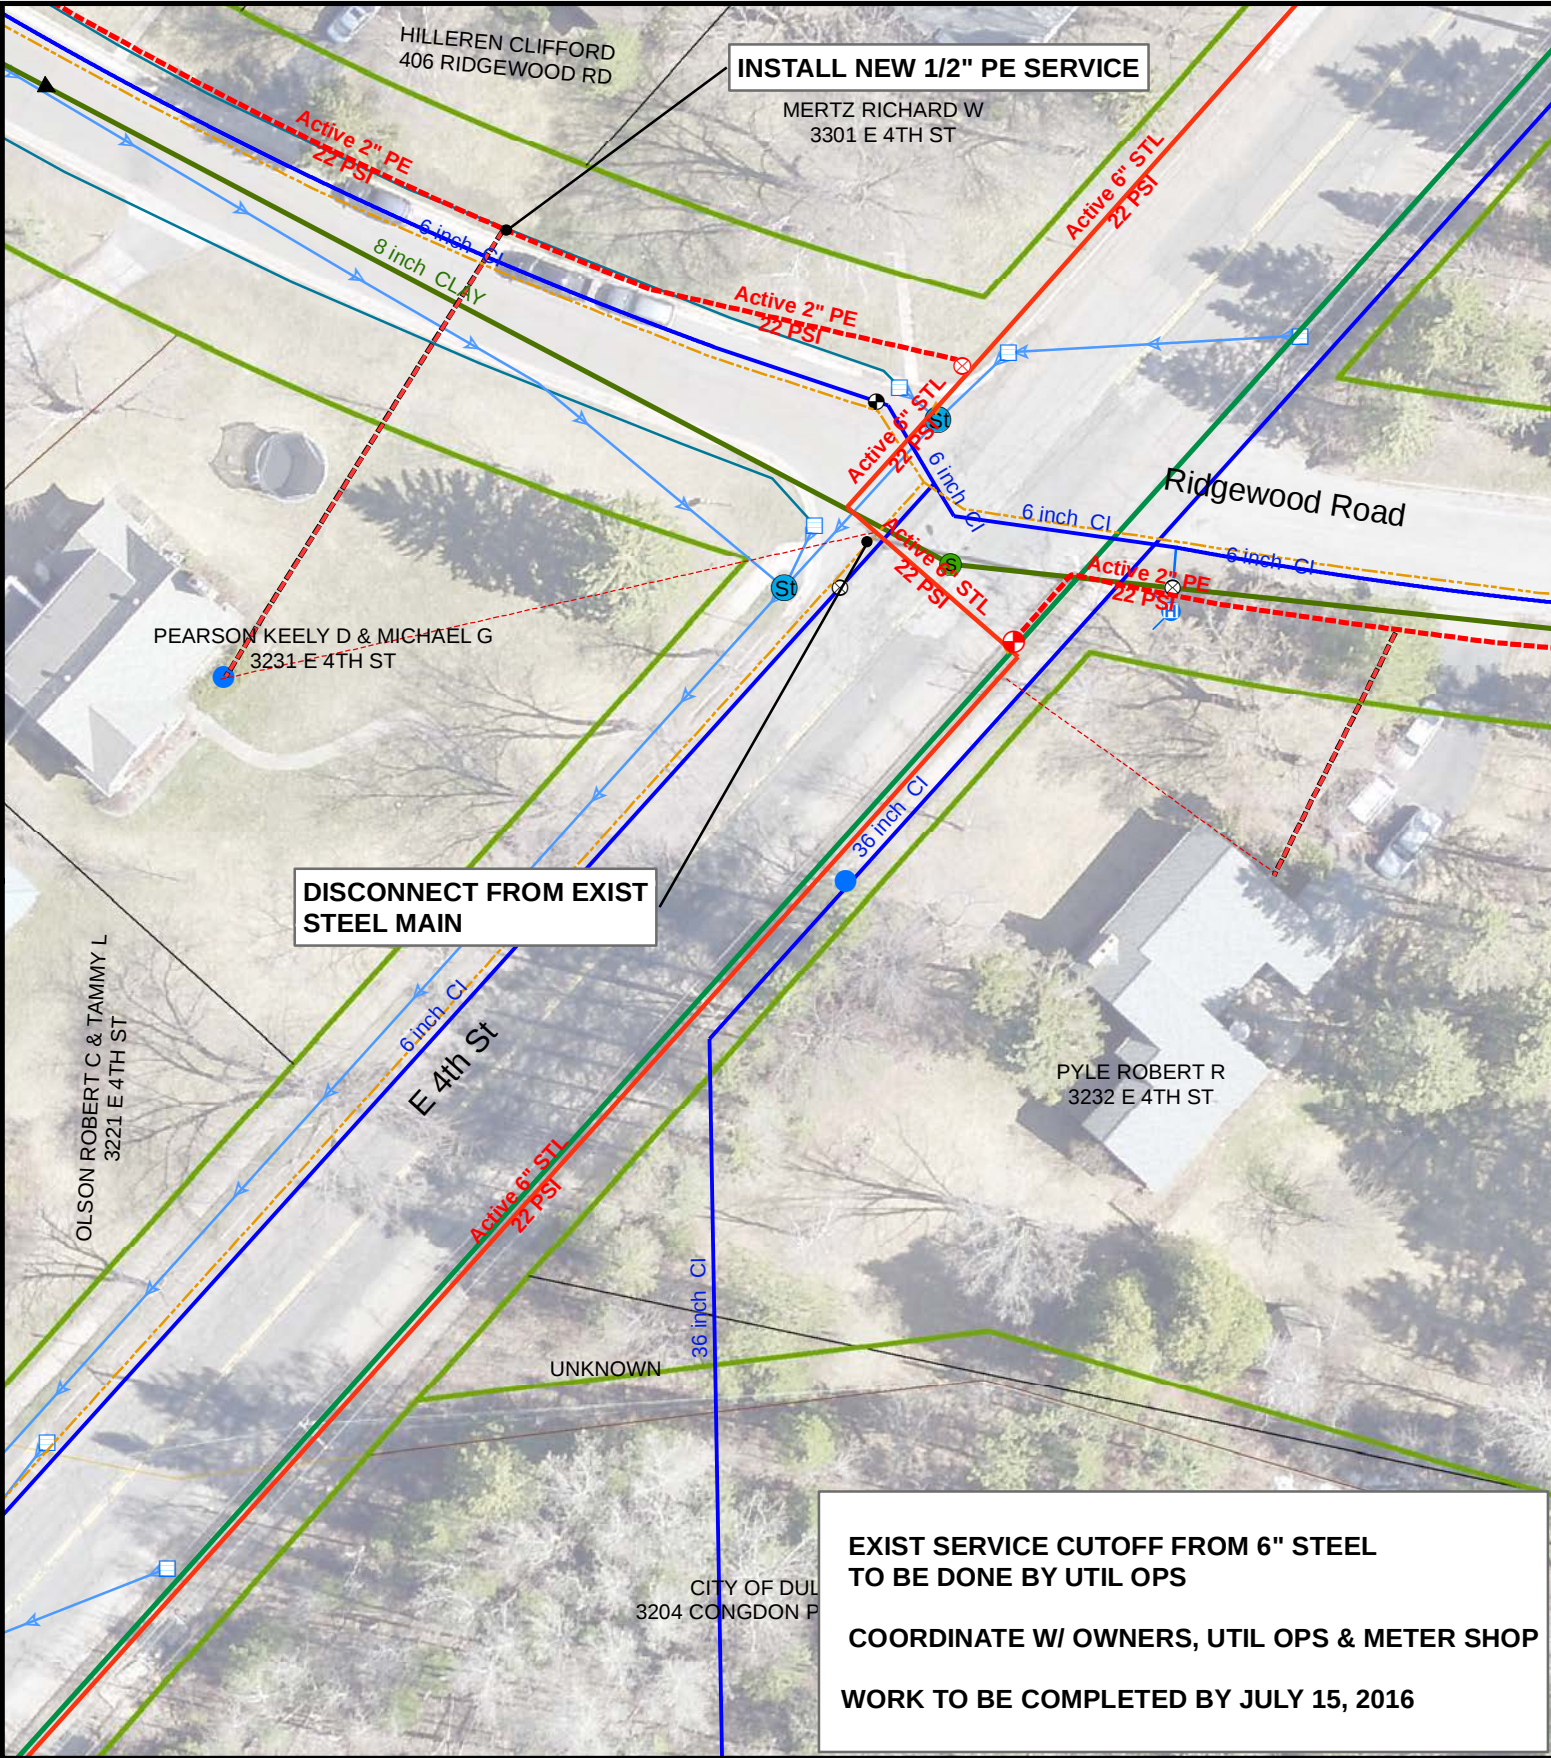

DATE COMPLETED:

INSPECTOR:

N

W

E

S

NTS

EXCESS FLOW VALVE: YES

APPL #: N/A

EAM #: 428370

ZONE: 4

PLAN OF: INSTALL NEW 1/2" PE GAS SERVICE

LOCATION: 3231 E 4TH ST

FROM: _____ TO: _____

DEPARTMENT OF PUBLIC WORKS AND UTILITIES



THE CITY OF


DULUTH

MINNESOTA


JOB NO: 1480-049

DRAWN BY: MHW

DATE: 2/10/2016

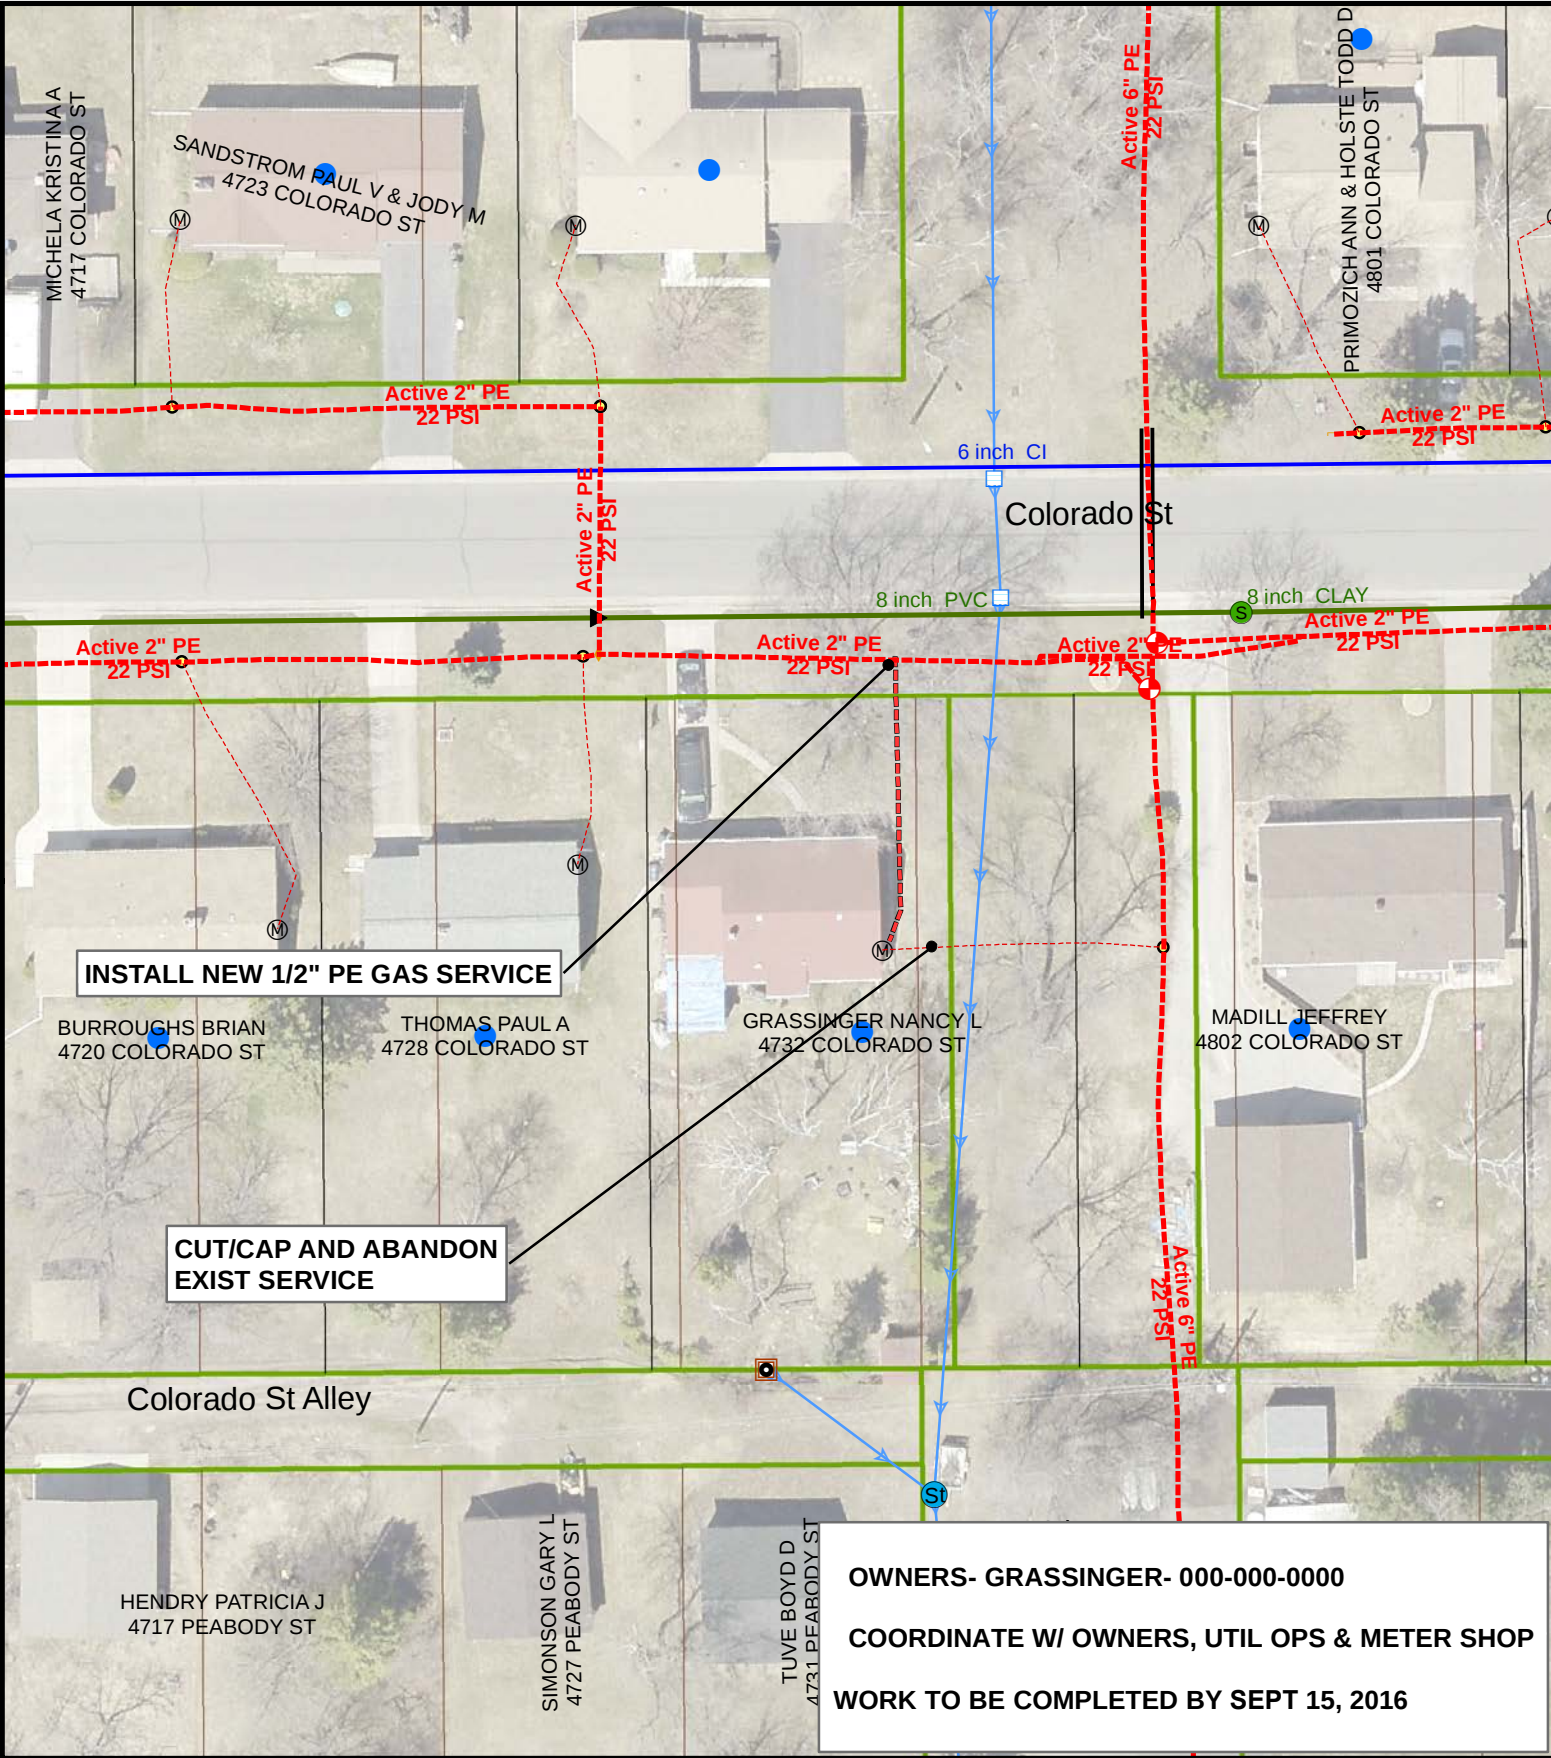

DATE COMPLETED:		INSPECTOR:	
EXCESS FLOW VALVE: <u>YES</u> APPL #: <u>N/A</u> EAM #: <u>428370</u> ZONE: <u>1</u> PLAN OF: <u>INSTALL NEW 1/2" PE GAS SERVICE</u> LOCATION: <u>4732 COLORADO ST</u> FROM: _____ TO: _____			
DEPARTMENT OF PUBLIC WORKS AND UTILITIES		JOB NO: <u>1480-052</u> DRAWN BY: <u>MHW</u> DATE: <u>2/18/2016</u>	

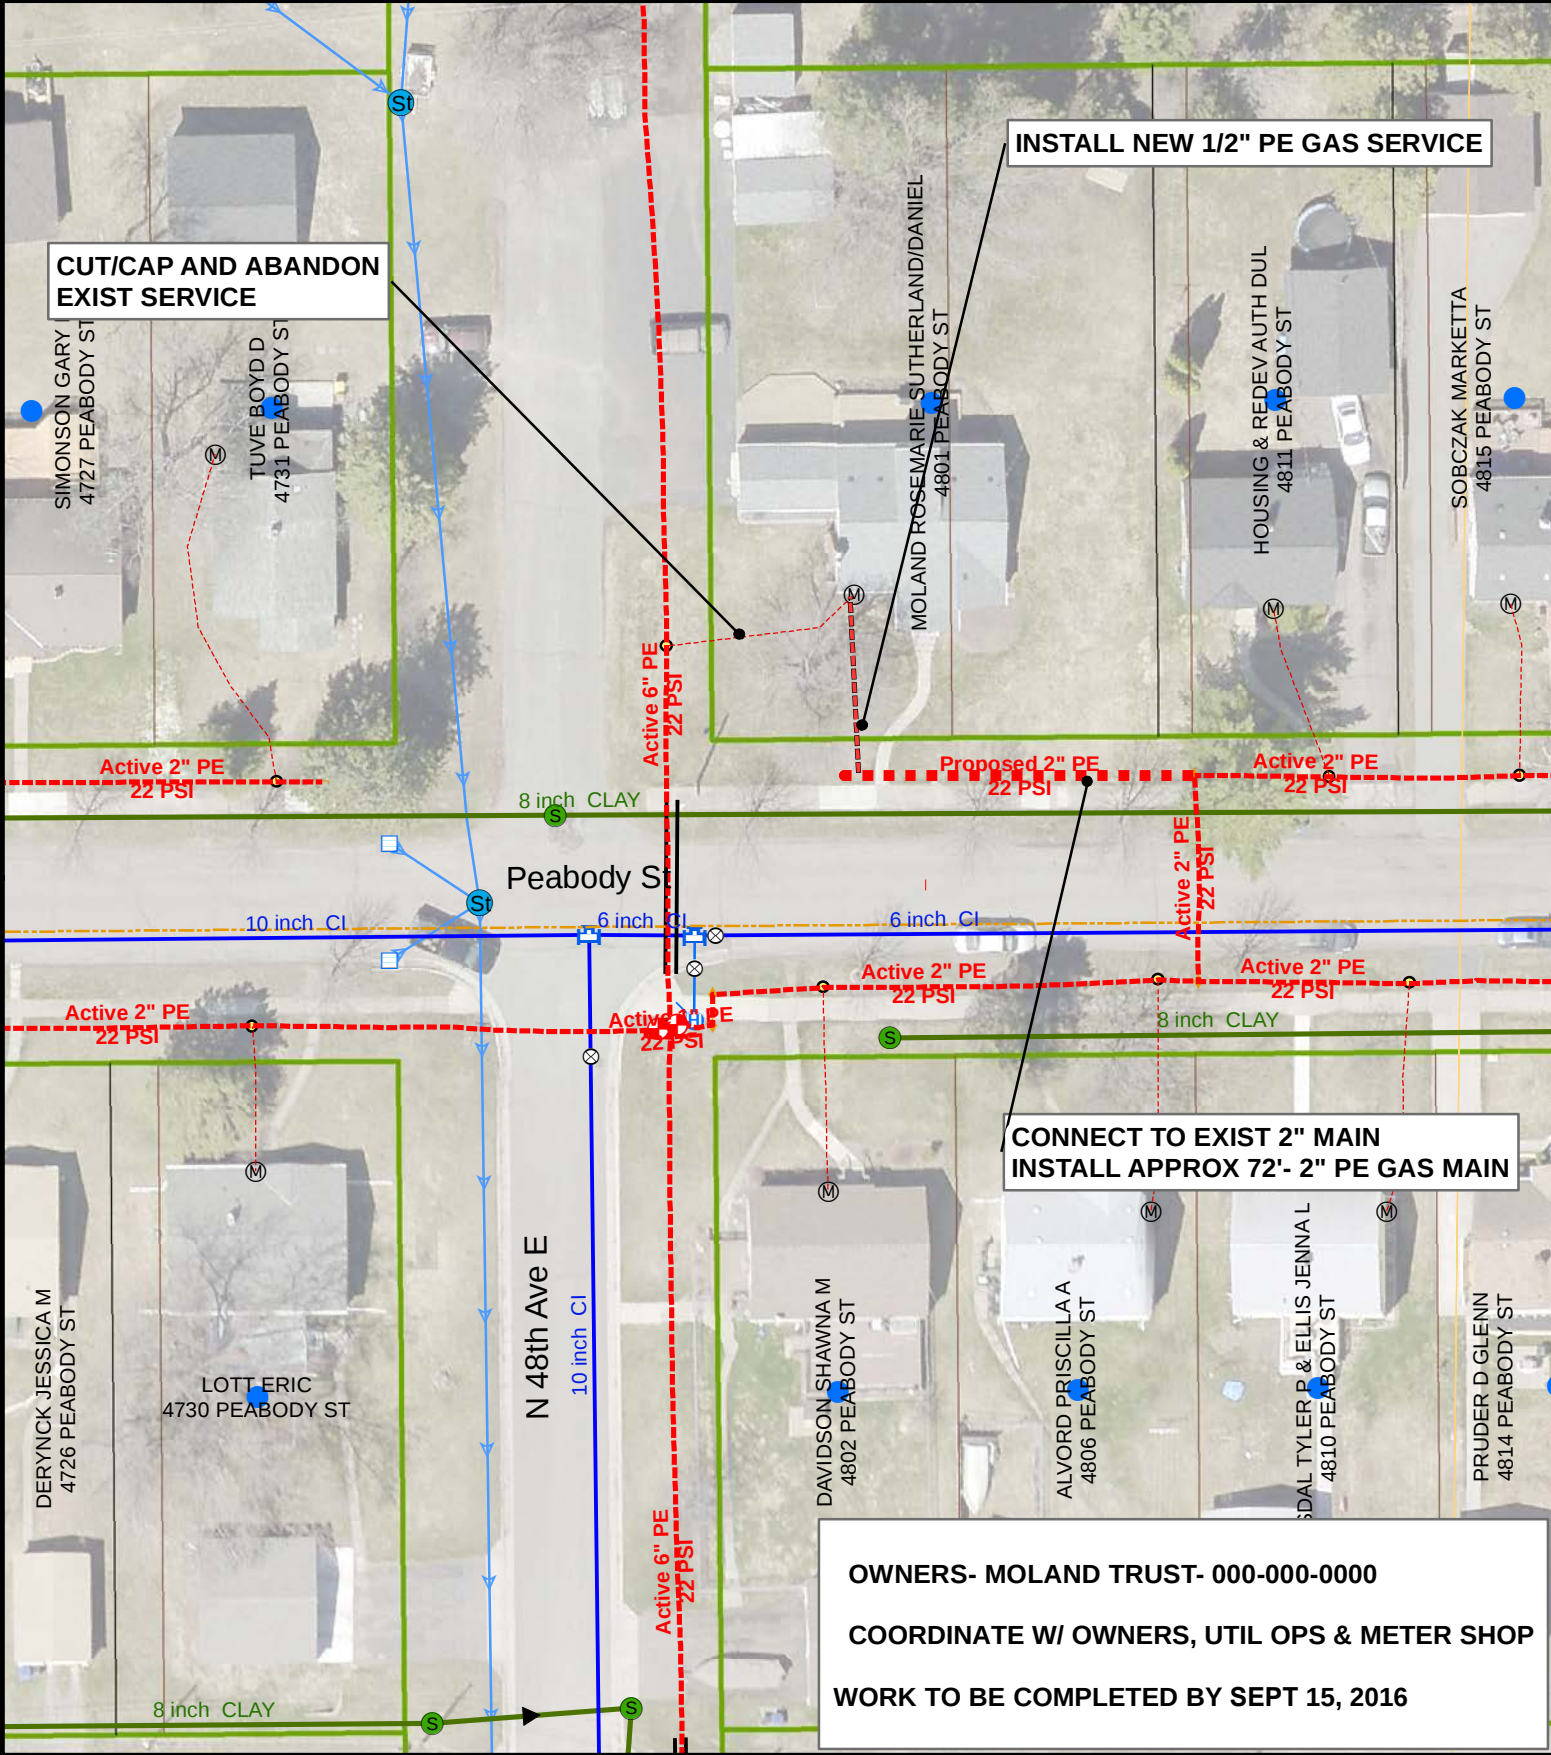

DATE COMPLETED:

INSPECTOR:

EXCESS FLOW VALVE: YES APPL #: N/A EAM #: 428370 ZONE: 1

PLAN OF: NEW 1/2" PE GAS SERVICE AND 2" MAIN EXTENSION

LOCATION: 4801 PEABODY ST


FROM: _____ TO: _____

DEPARTMENT OF PUBLIC WORKS AND UTILITIES

JOB NO: 1480-053

DRAWN BY: MHW

DATE: 2/18/2016

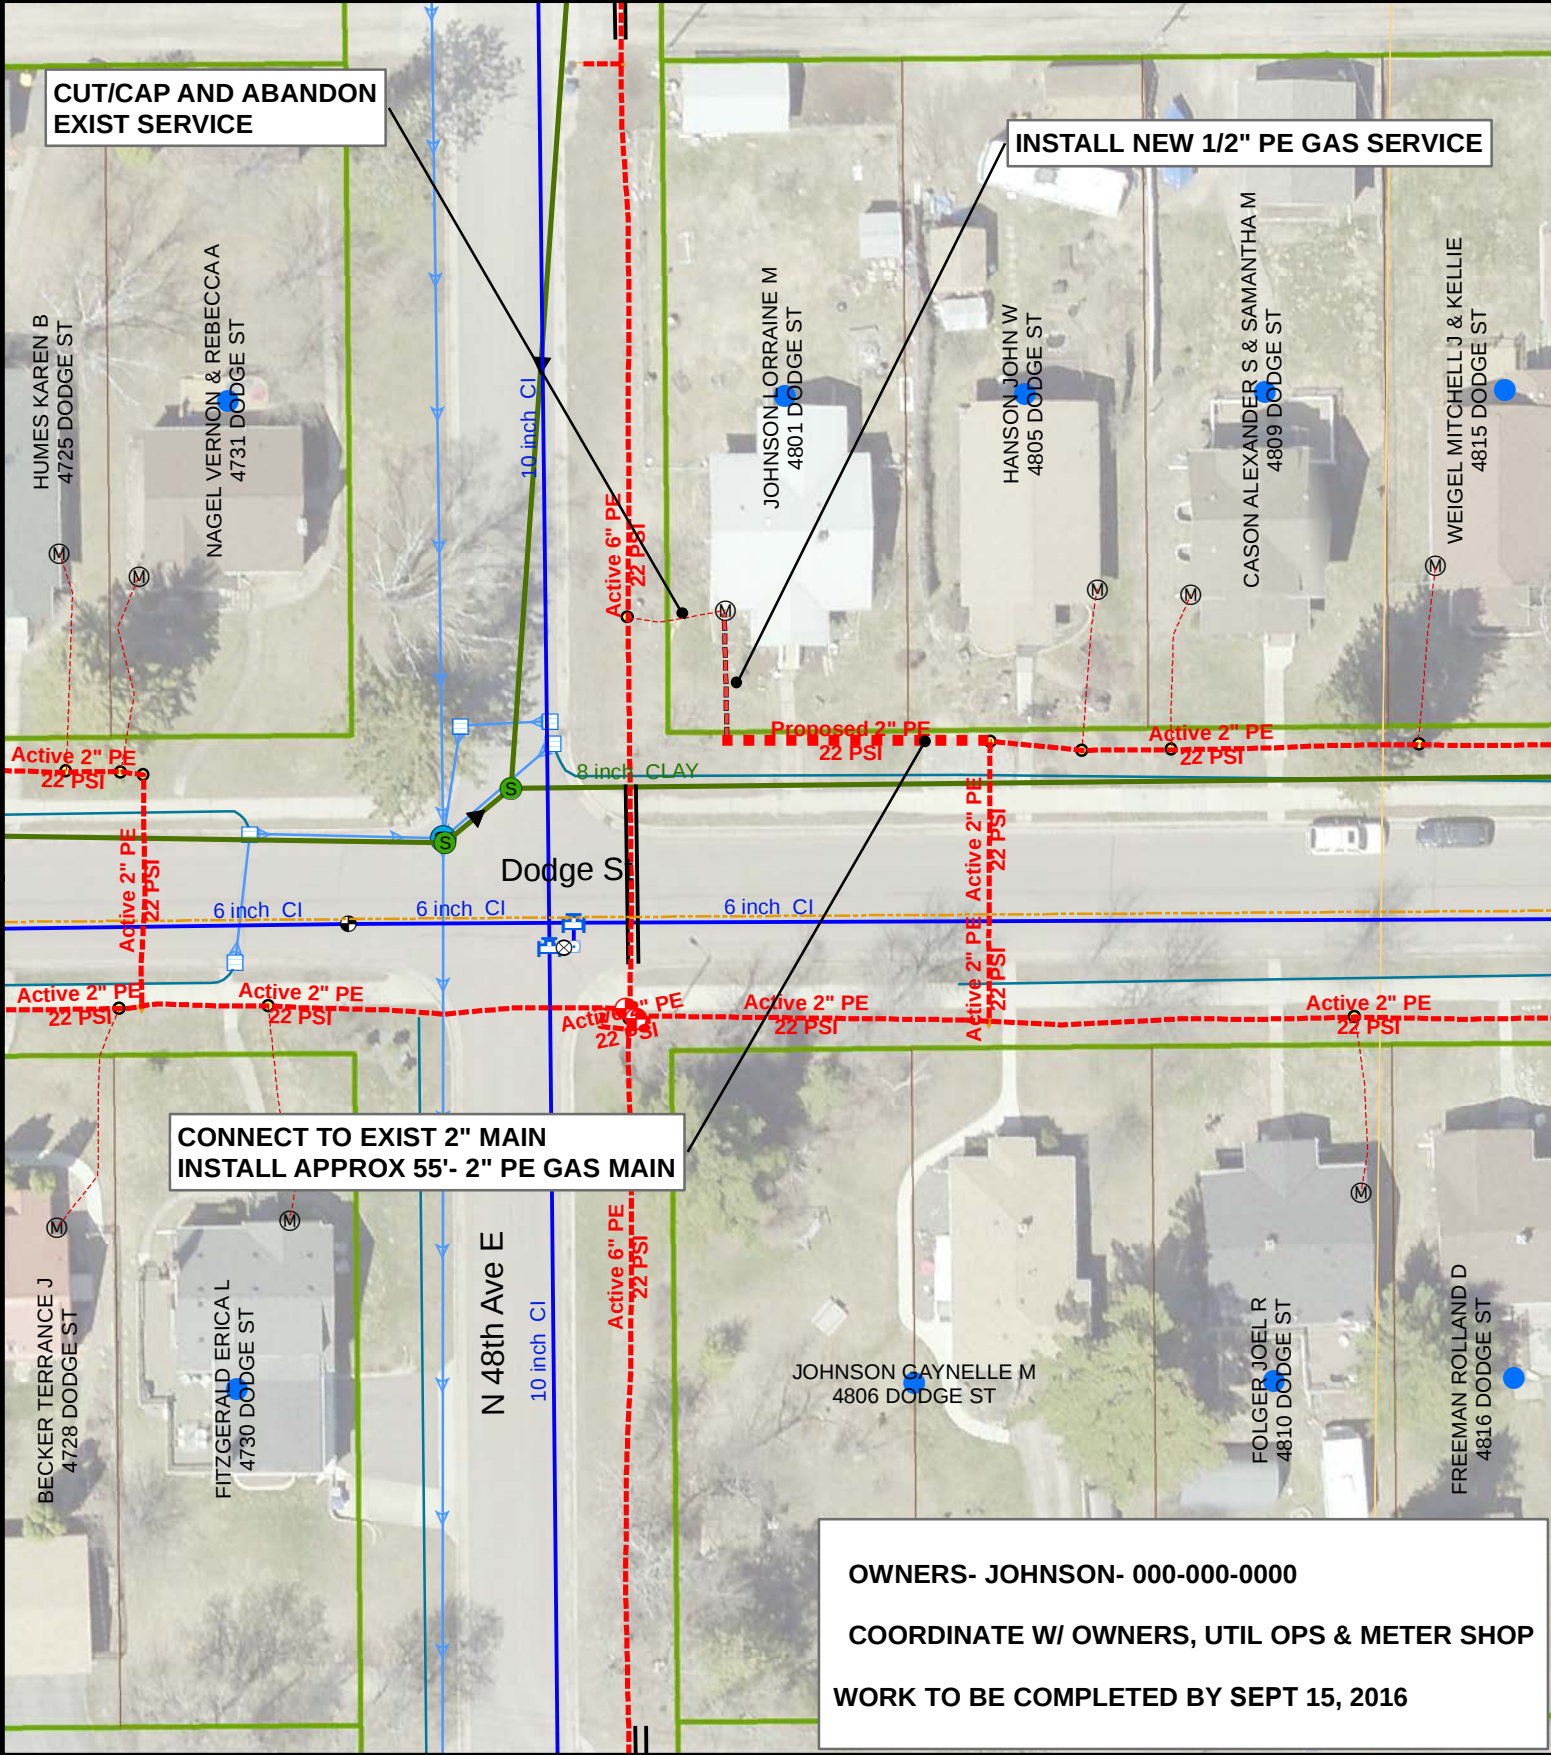

DATE COMPLETED:

INSPECTOR:

EXCESS FLOW VALVE: YES

APPL #: N/A

EAM #: 428370

ZONE: 1

PLAN OF: NEW 1/2" PE GAS SERVICE AND 2" MAIN EXTENSION

LOCATION: 4801 DODGE ST


FROM: _____ TO: _____

DEPARTMENT OF PUBLIC WORKS AND UTILITIES


JOB NO: 1480-054

DRAWN BY: MHW

DATE: 2/18/2016

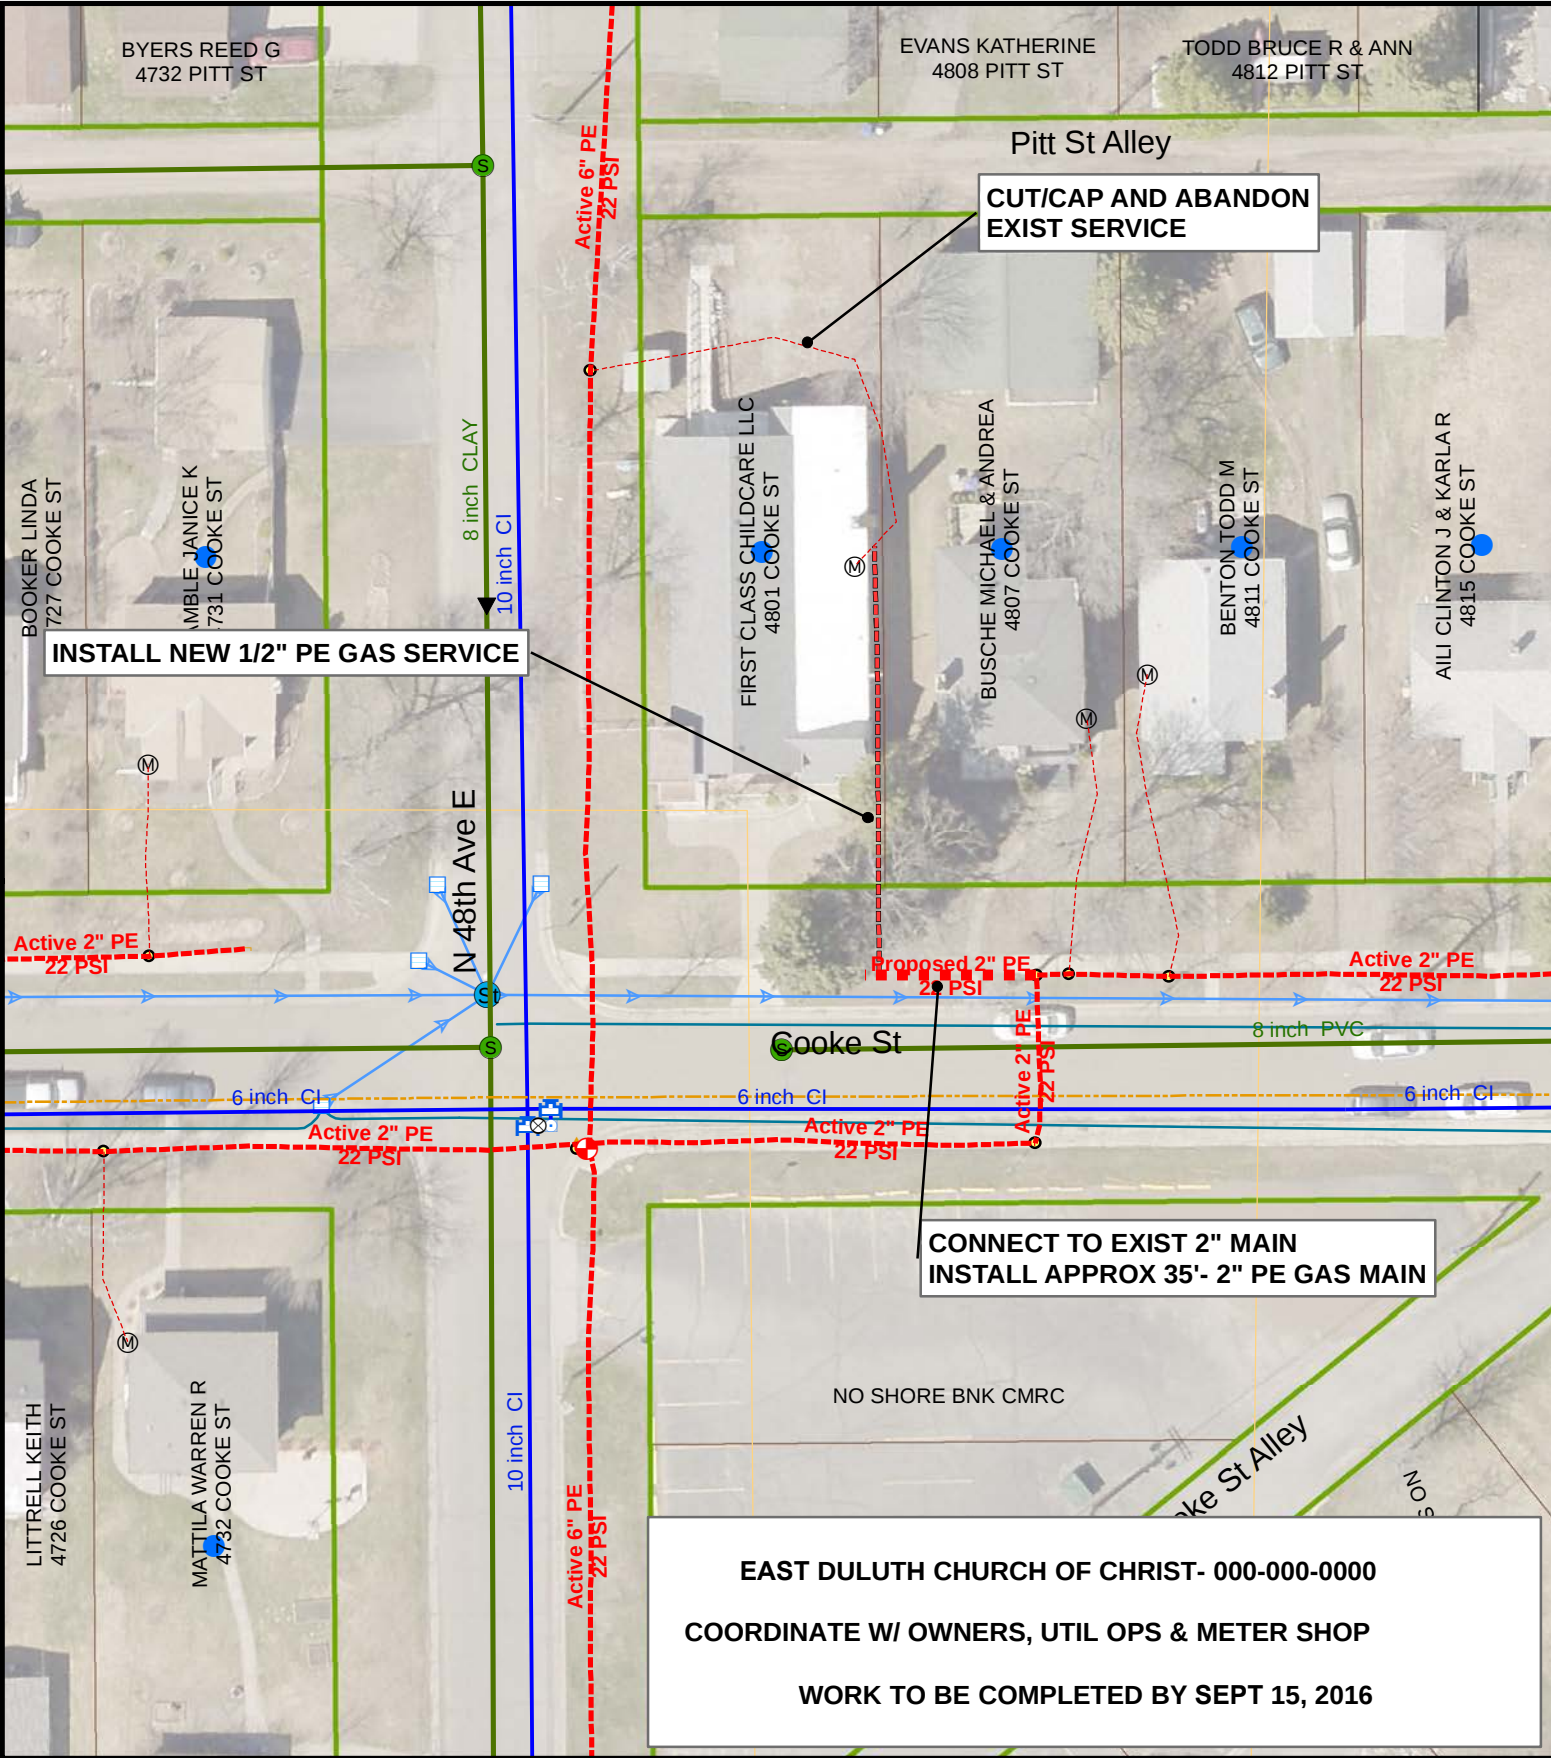

DATE COMPLETED:		INSPECTOR:	
EXCESS FLOW VALVE: <u>YES</u> APPL #: <u>N/A</u> EAM #: <u>428370</u> ZONE: <u>1</u> PLAN OF: <u>NEW 1/2" PE GAS SERVICE AND 2" MAIN EXTENSION</u> LOCATION: <u>4801 COOKE ST</u> FROM: _____ TO: _____ DEPARTMENT OF PUBLIC WORKS AND UTILITIES			
		JOB NO: <u>1480-056</u> DRAWN BY: <u>MHW</u> DATE: <u>2/18/2016</u>	

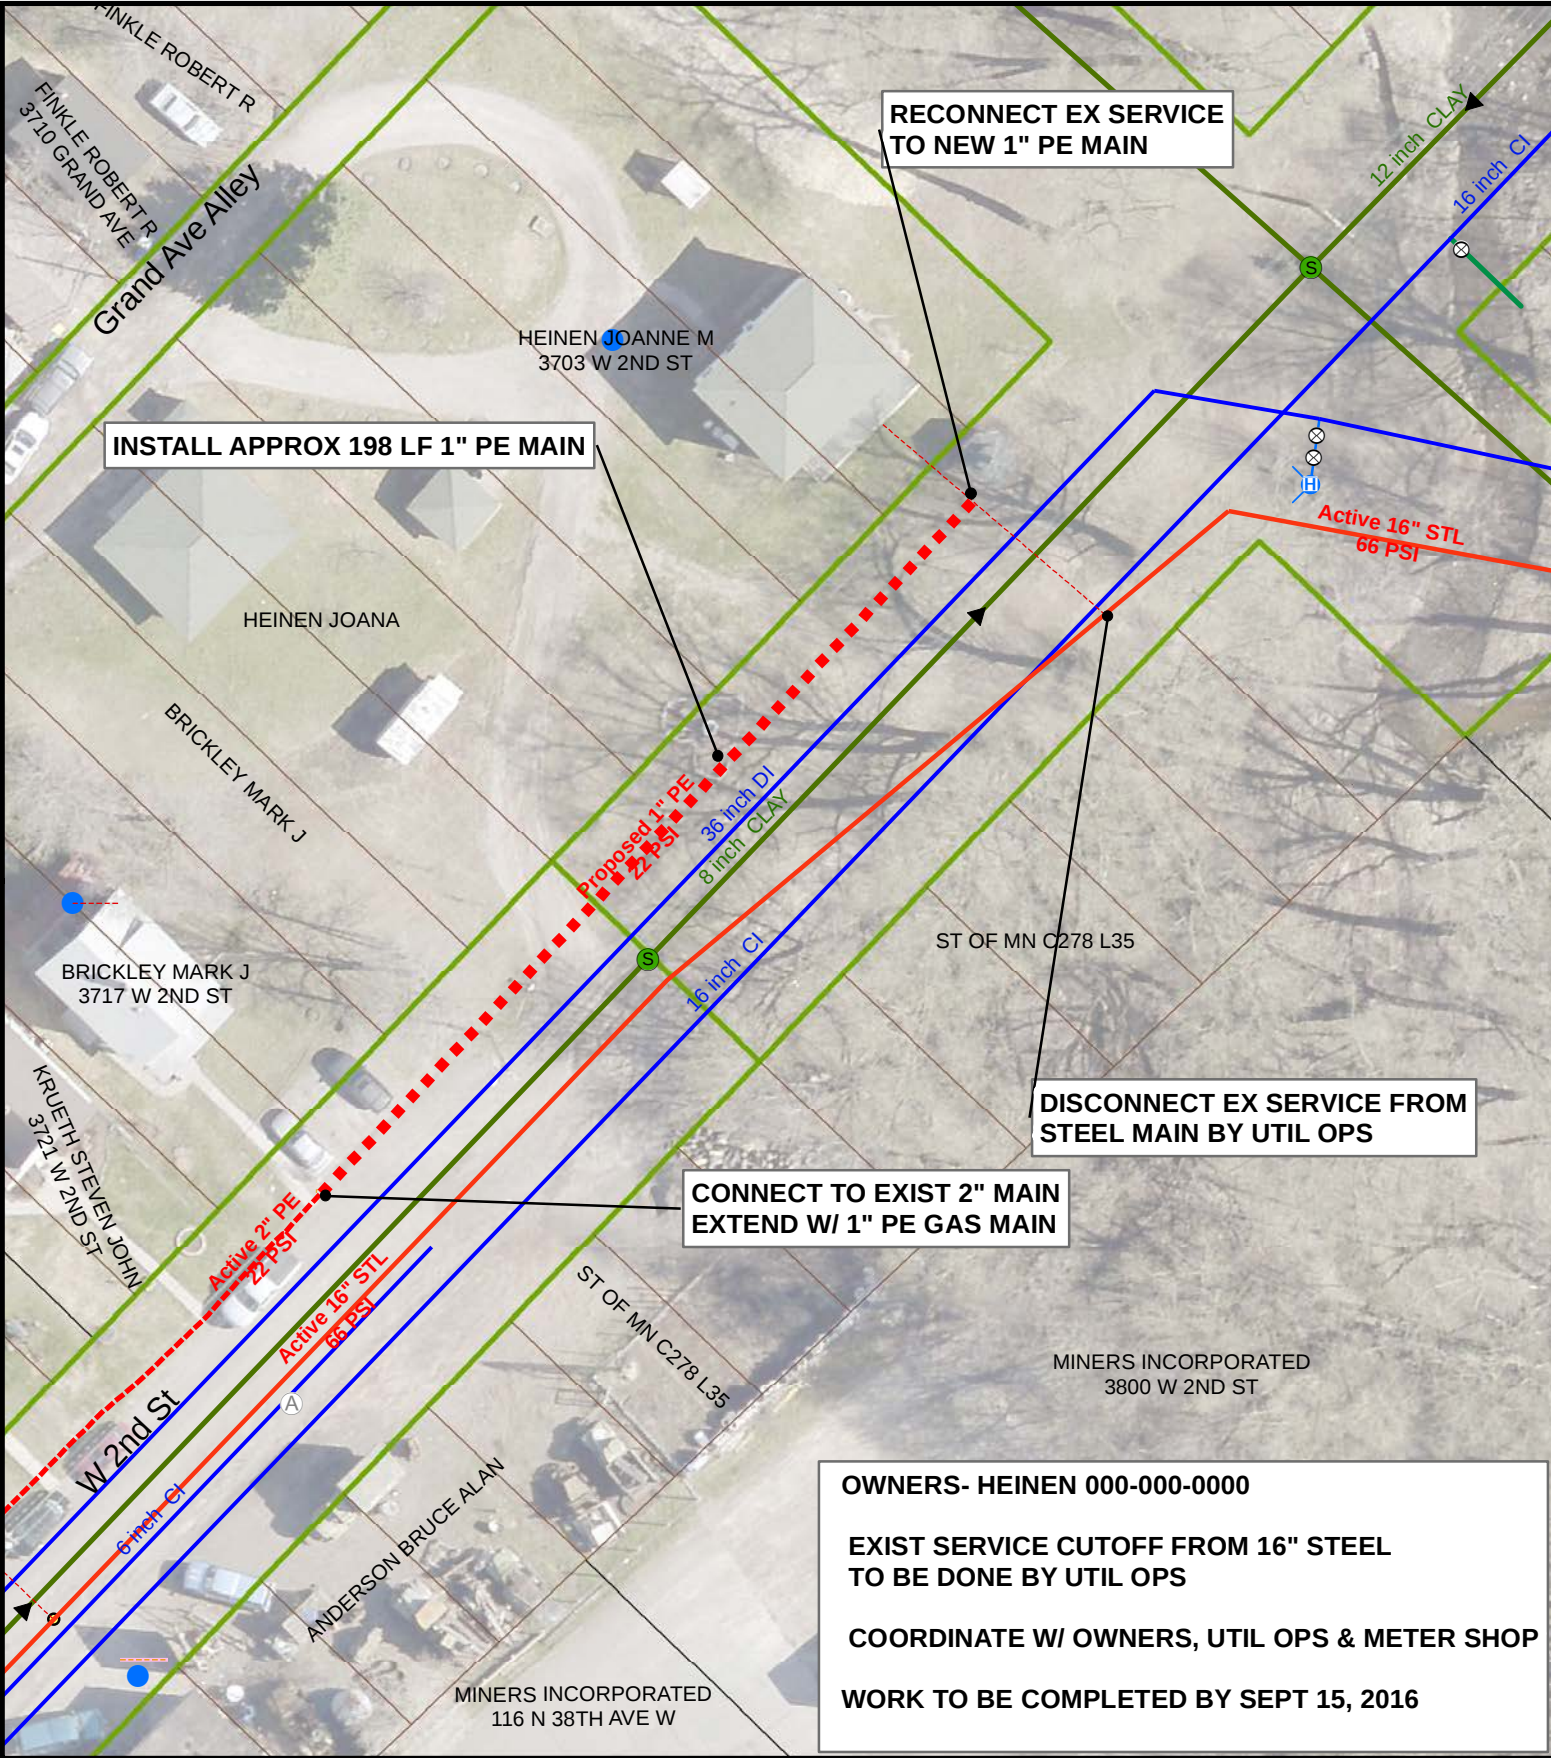

DATE COMPLETED:		INSPECTOR:	
EXCESS FLOW VALVE: <u>N/A</u> APPL #: <u>N/A</u> EAM #: <u>428370</u> ZONE: <u>5</u>			
PLAN OF: <u>INSTALL NEW 1" PE GAS MAIN</u>			
LOCATION: <u>3703 W 2ND ST</u>			
FROM: _____ TO: _____			
DEPARTMENT OF PUBLIC WORKS AND UTILITIES			
		JOB NO: <u>1480-061</u>	
		DRAWN BY: <u>MHW</u>	
		DATE: <u>2/22/2016</u>	