

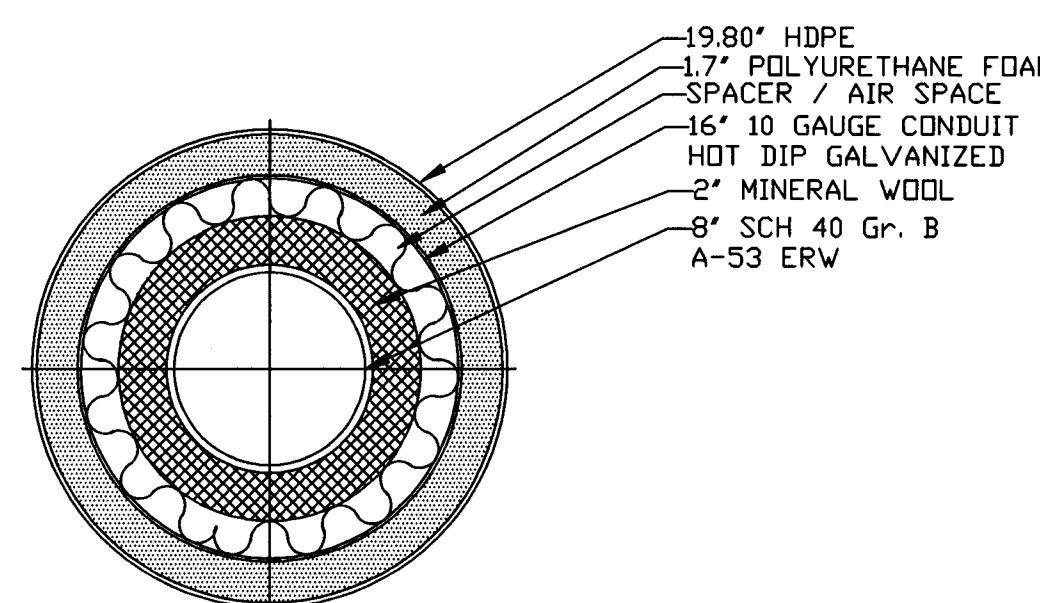

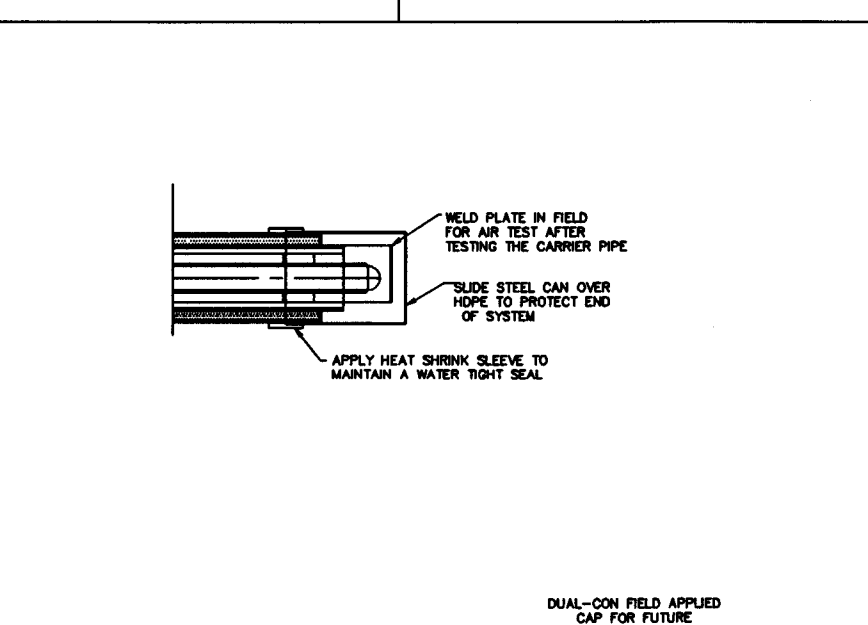
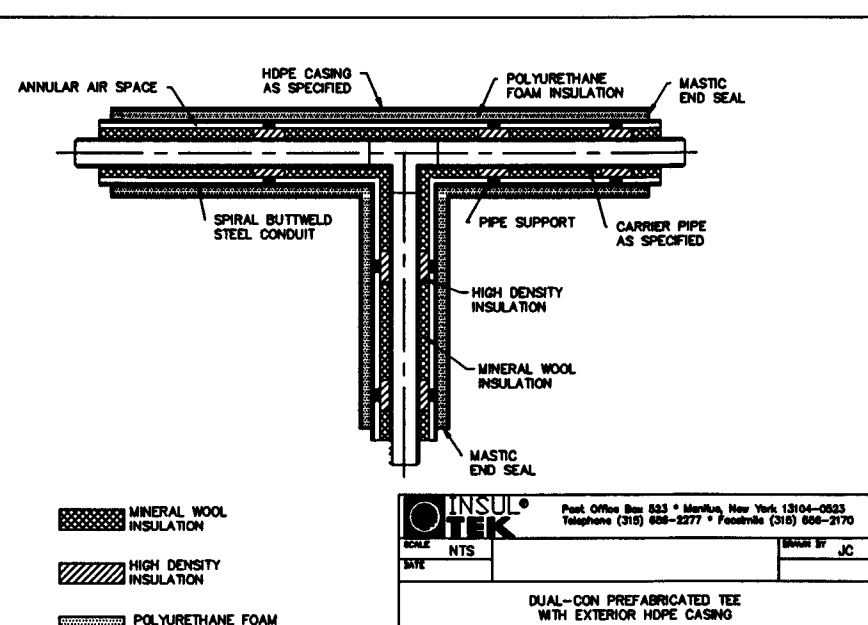
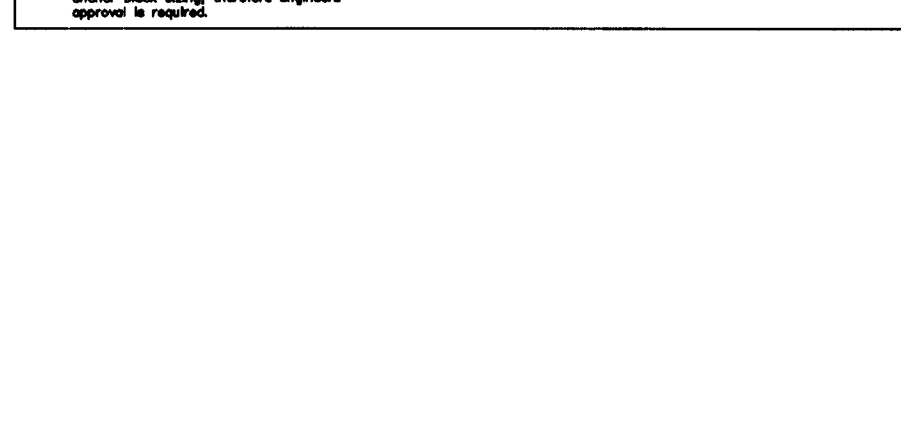
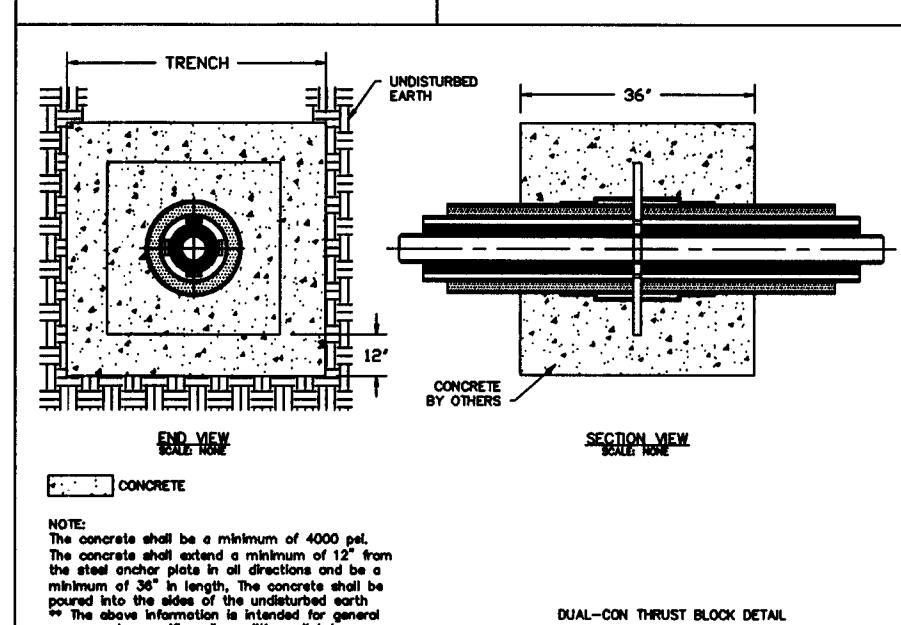
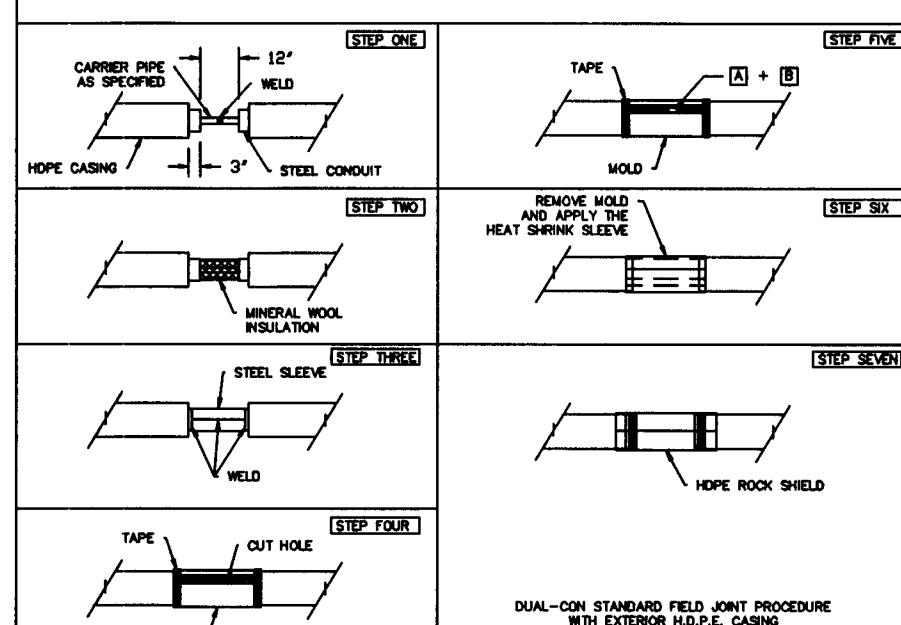
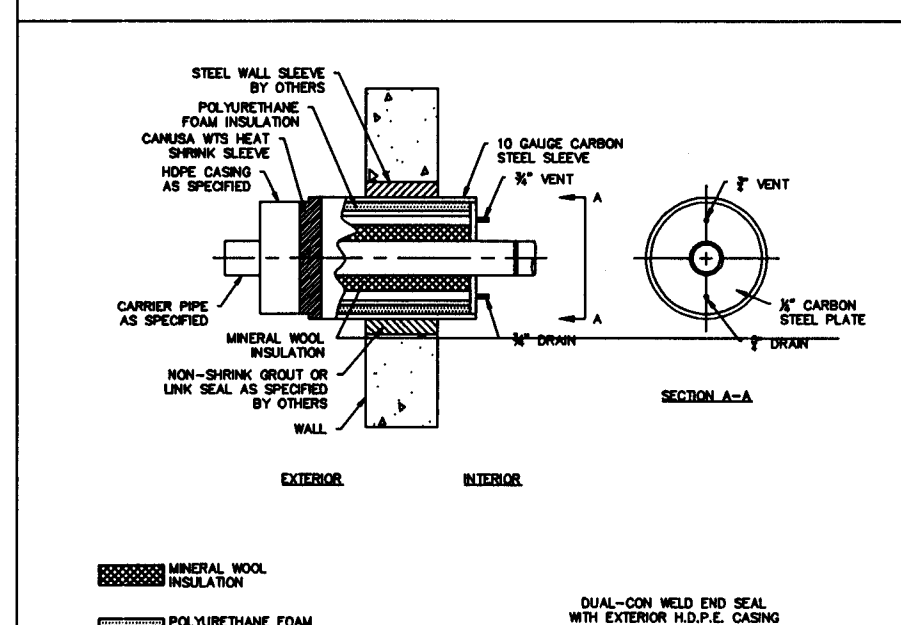
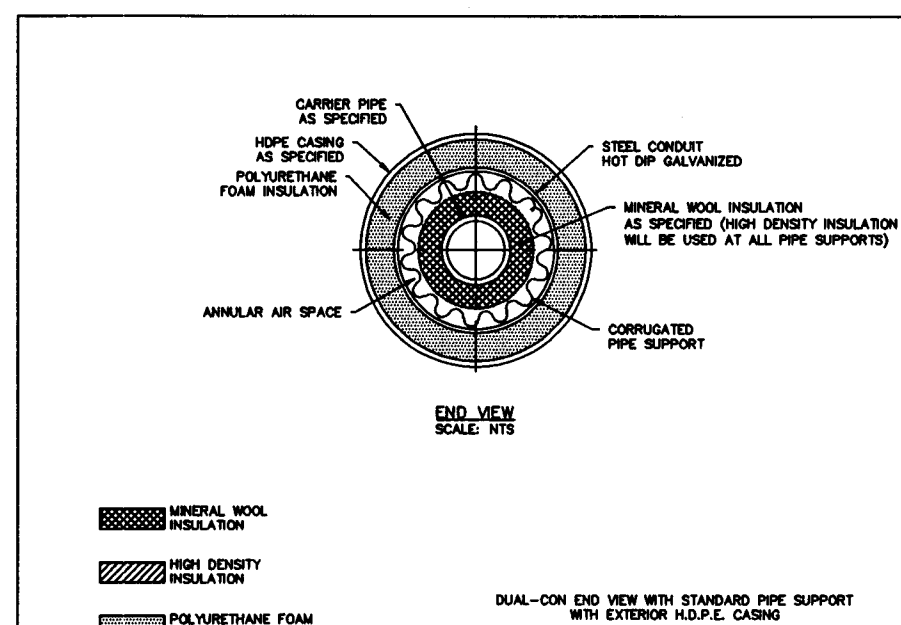
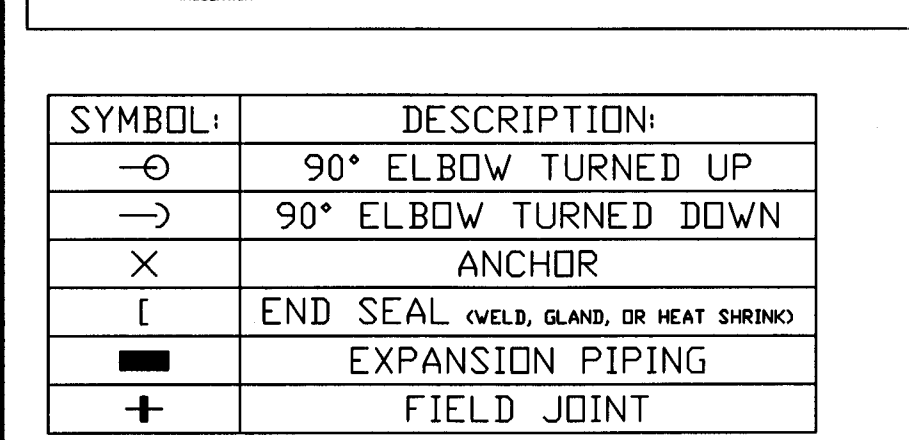
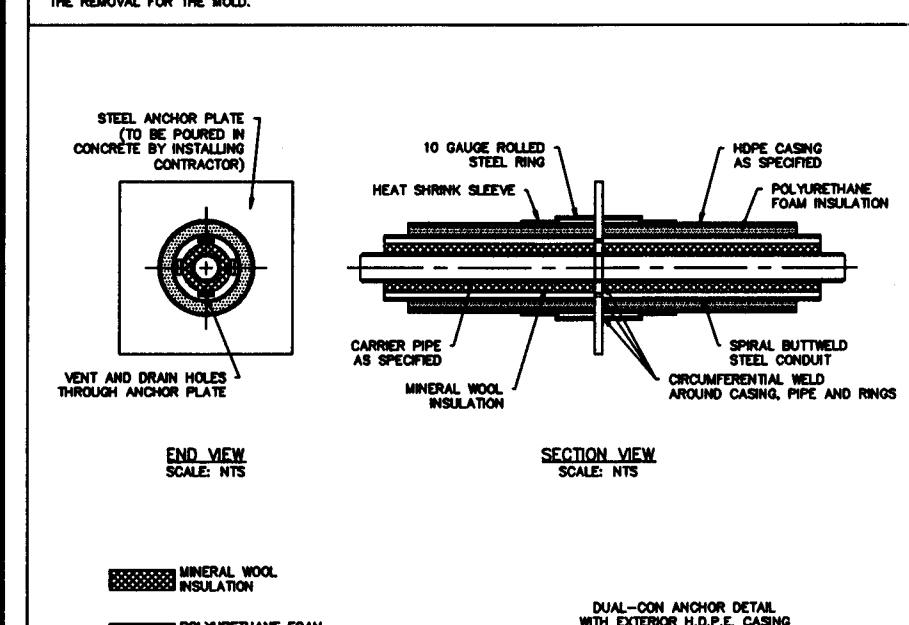
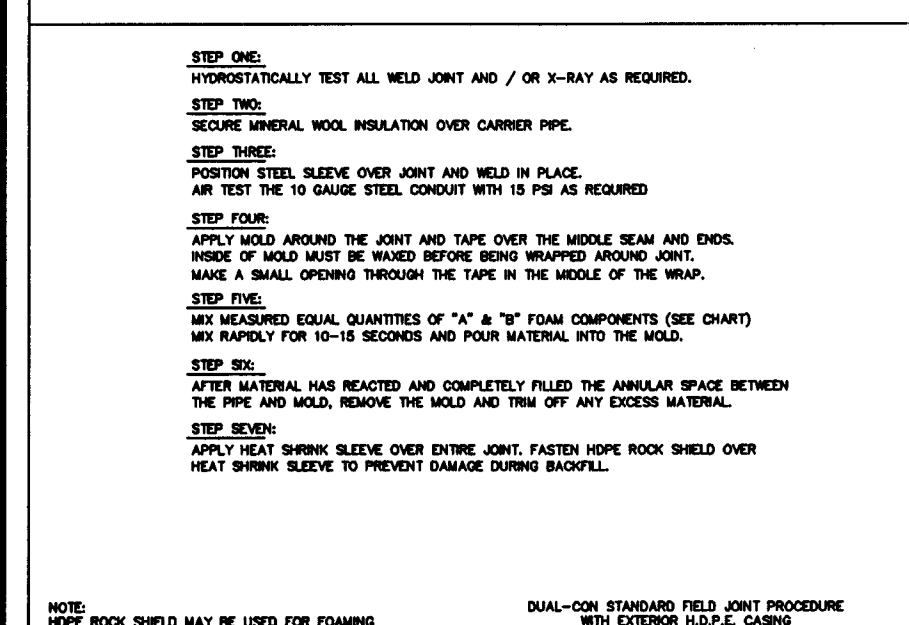
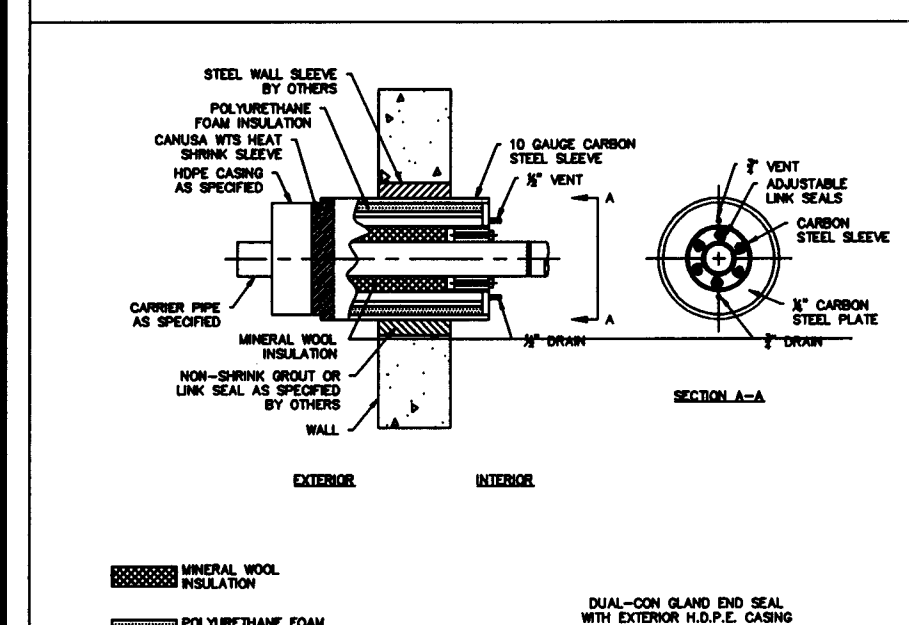



PLAIN VIEW
SCALE: 1"=10'-0"

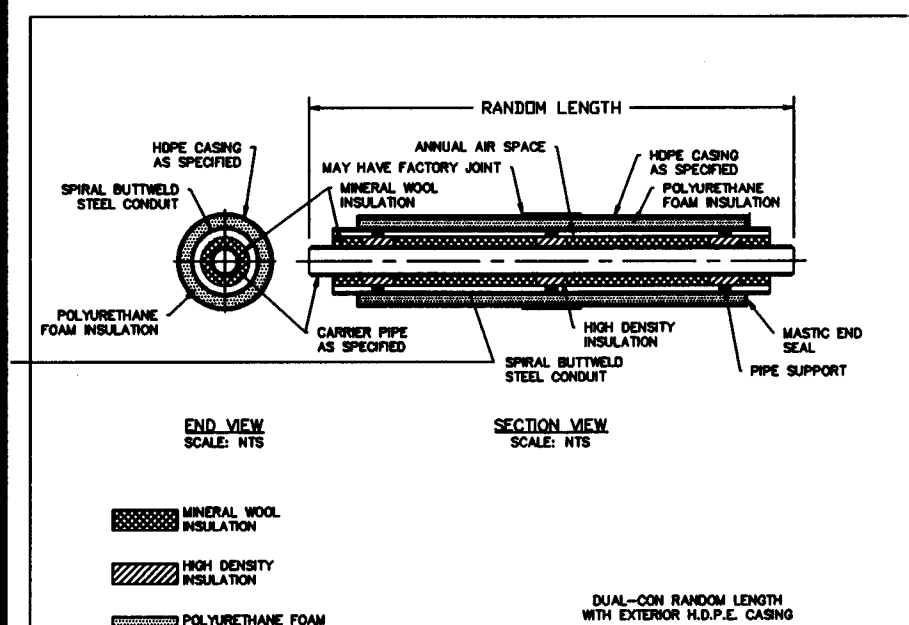

SECTION A-A
SCALE: N.T.S.

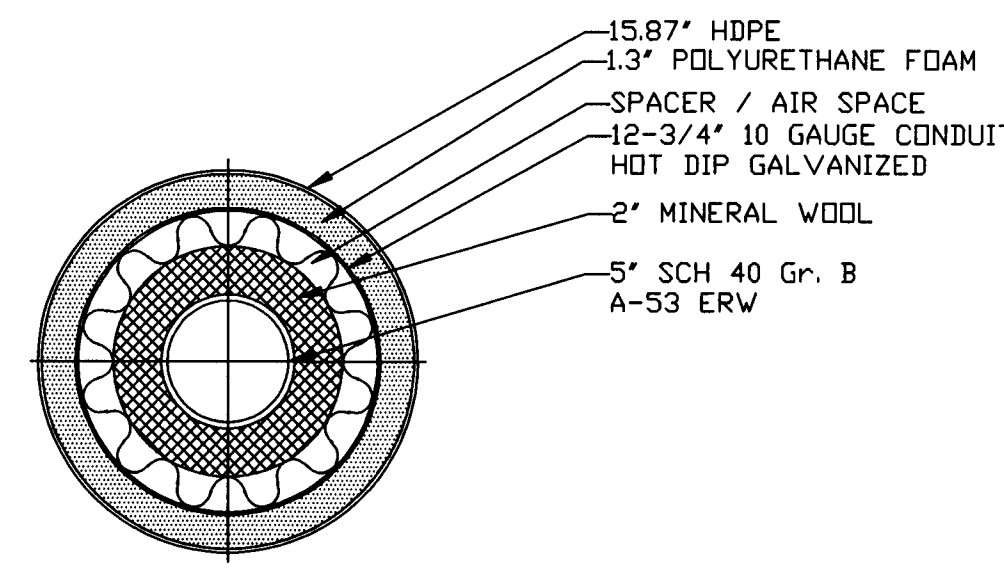

SECTION B-B
SCALE: N.T.S.

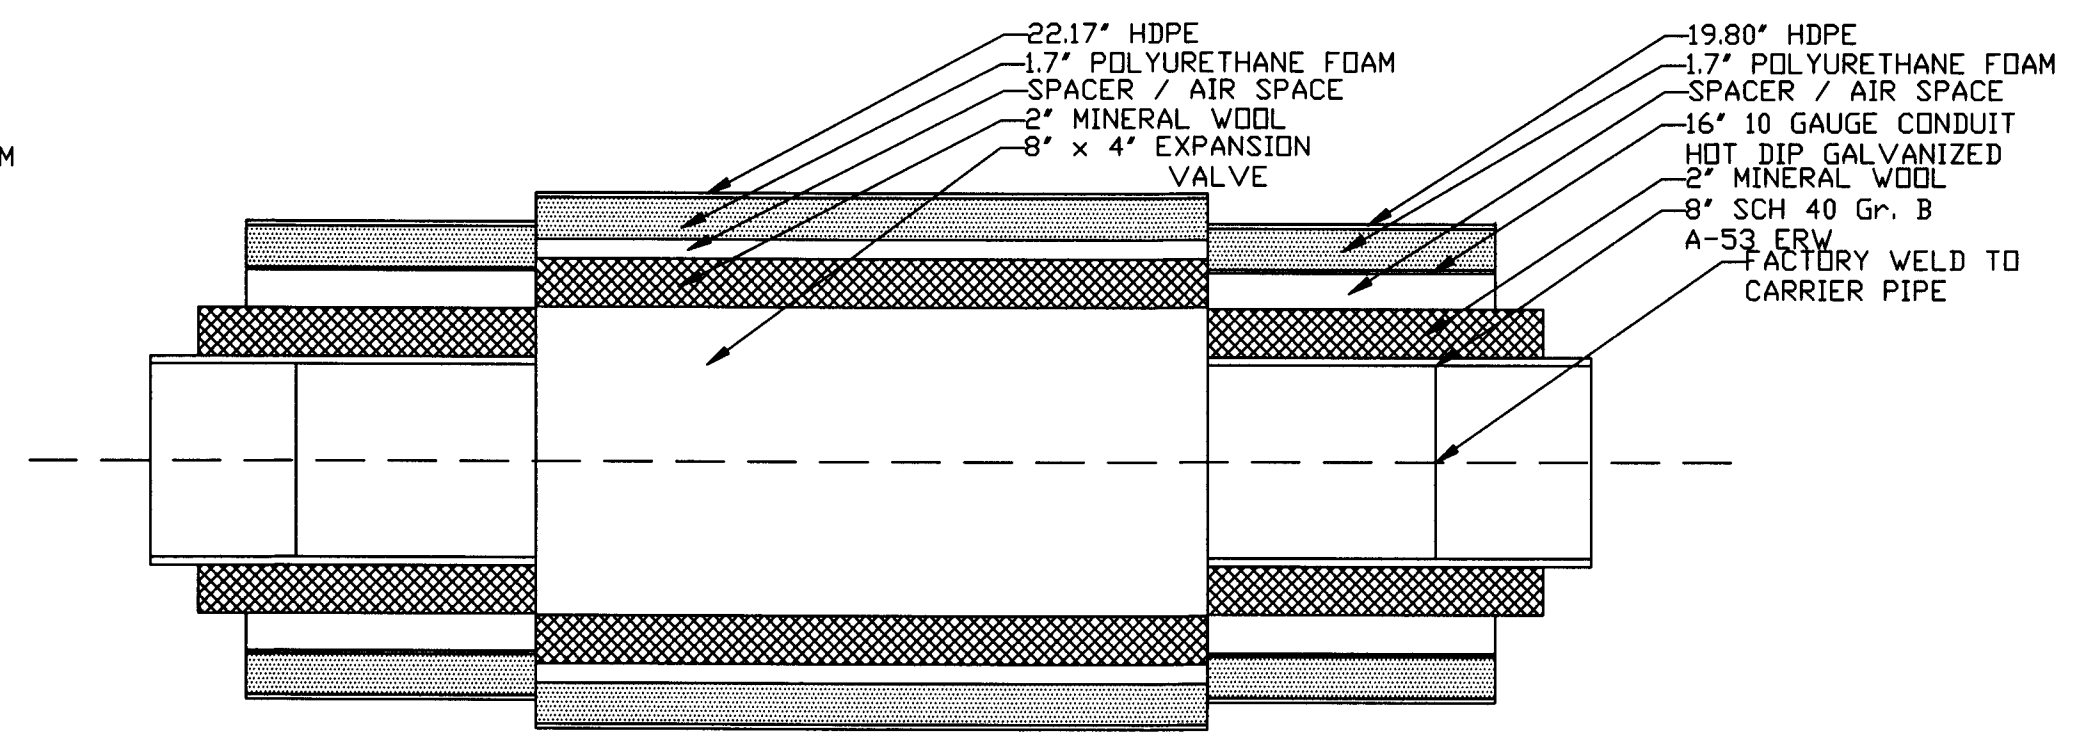

SECTION C-C
SCALE: N.T.S.

NOTES:
-CONTRACTOR TO FIELD VERIFY ALL DIMENSIONS PRIOR TO FABRICATION
-CONTRACTOR MAY HAVE TO MODIFY PIPE LENGTHS IN FIELD.
-THIS SYSTEM HAS BEEN DESIGNED TO BE INSTALLED AT 2'-0" CENTERS.
-PRIOR TO ANY MODIFICATIONS CONTRACTOR MUST NOTIFY MANUFACTURER IN WRITING.
-ALL DIMENSIONS ARE FROM CENTER OF FITTING TO CENTER OF FITTING, CENTER OF FITTING TO END OF CARRIER PIPE OR END OF CARRIER PIPE TO END OF CARRIER PIPE.
-ALL ANCHORS TO BE POURED IN CONCRETE BY THE INSTALLING CONTRACTOR (CONCRETE SUPPLIED BY OTHERS)
-FOR ADDITIONAL INFORMATION REFER TO CONTRACT DRAWINGS.

					SHEET No.	
					1	
					OF 1	