



CITY OF DULUTH
PURCHASING DIVISION
Room 100 City Hall
411 West First Street
Duluth, Minnesota 55802-1199
218/730-5340 218/730-5922 FAX
purchasing@duluthmn.gov

Addendum # 3
Project 2306
26th Avenue East and London Road Water Main Relocation

This addendum serves to notify all bidders of the following changes to the solicitation documents:

PLAN SHEETS

Plan sheet 16 of 40 has been updated to show 3rd party utility crossings of Jefferson Street Alley.

EXHIBIT A

The following bid items have been modified in the Exhibit A:

28.	2504.602	CONNECT TO EXISTING WATER MAIN	EACH	2
30.	2504.601	8" HDPE WATER MAIN SDR 11	LS	1

The following bid item has been added in the Exhibit A:

47.	2511.604	SALVAGE AND RESTORE LANDSCAPE ROCK	SY	93
-----	----------	------------------------------------	----	----

SPECIAL PROVISIONS

1. **MODIFY** Special Provision SP-14:

3. Final Completion. ALL work required under this Contract shall be complete on or before June 15, 2026.

2. **MODIFY** Special Provision SP-22:

Replace prior language with the following:

An Equal Opportunity Employer

The provisions of 2504 are supplemented with the following:

Any water shutdown to accommodate construction of the 8" water main offset shall be scheduled between the hours of 10 PM and 6 AM. Should a shutdown be required outside the specified hours, then temporary water services shall be provided to impacted customers.

3. **ADD** the following Paragraph to SP-23 Water Main:

6. The new 8" offset, if required, to the existing 6" cast iron main in London Road, may be made by a combination of vertical and horizontal offset. Compensation will be lump sum per bid item 30 (as modified by this addendum) for all materials, labor, and equipment necessary to complete the offset, inclusive of connections to existing main.

4. **ADD** the following Special Provision SP – 26:

SP-26 Salvage and Restore Landscape Rock

The bid item 47 (2511.604) Salvage and Restore Landscape Rock shall be compensation for labor and equipment necessary to salvage and restore landscape rock along the south side of the Jefferson Street Alley within the limits of disturbance, as indicated on plan sheets.

5. **ADD** the following Special Provision SP – 27:

SP-27 (2503) Sanitary Sewer

The peak sanitary sewer flow to be bypassed to complete bid item 22 (2503.601) Temporary Bypass Pumping is estimated to be 200 gpm.

ADDENDUM 2

1. **MODIFY** SP-23 Water Main, by **REPLACING** paragraphs 3 and 5 from Addendum 2 with the following:

3. Asbestos coating on Existing 30" Steel Water Main

The existing 30" steel water main is believed to have an asbestos containing coal tar coating. The City of Duluth will remove and abate asbestos coating from the steel water main along cut lines identified by the Contractor, at all locations where pipe removal is necessary. The Contractor shall then be responsible cutting, removing, and disposing of pipe.

5. Water Main Abandonment by Contractor

At the water main abandonment specified for 25th Avenue East, the Contractor shall be responsible for removing the 30" steel casing pipe from the existing HDPE water main. For permanent water main abandonment, the Contractor shall furnish and install a 24" HDPE end cap and fuse it to the existing water main. Then the Contractor shall also mortar the annular space between the 24" inch HDPE and the 30" Steel casing at that abandonment location.



At 26th Avenue East the water main will be abandoned by the City of Duluth by welding a steel plate on the end of the abandoned pipeline at the time of final tie-in.

Please acknowledge receipt of this Addendum by checking the acknowledgement box within the www.bidexpress.com solicitation.

Posted: **June 3, 2025**

5/29/2025 11:37 AM

I:\PW\ENGINEER\PROJECTS\2000-2499\2306_26th_ave_e_&_london_rd_water_main_relocation\DRAWINGS\BASE\2306-26th_ave_e-ba

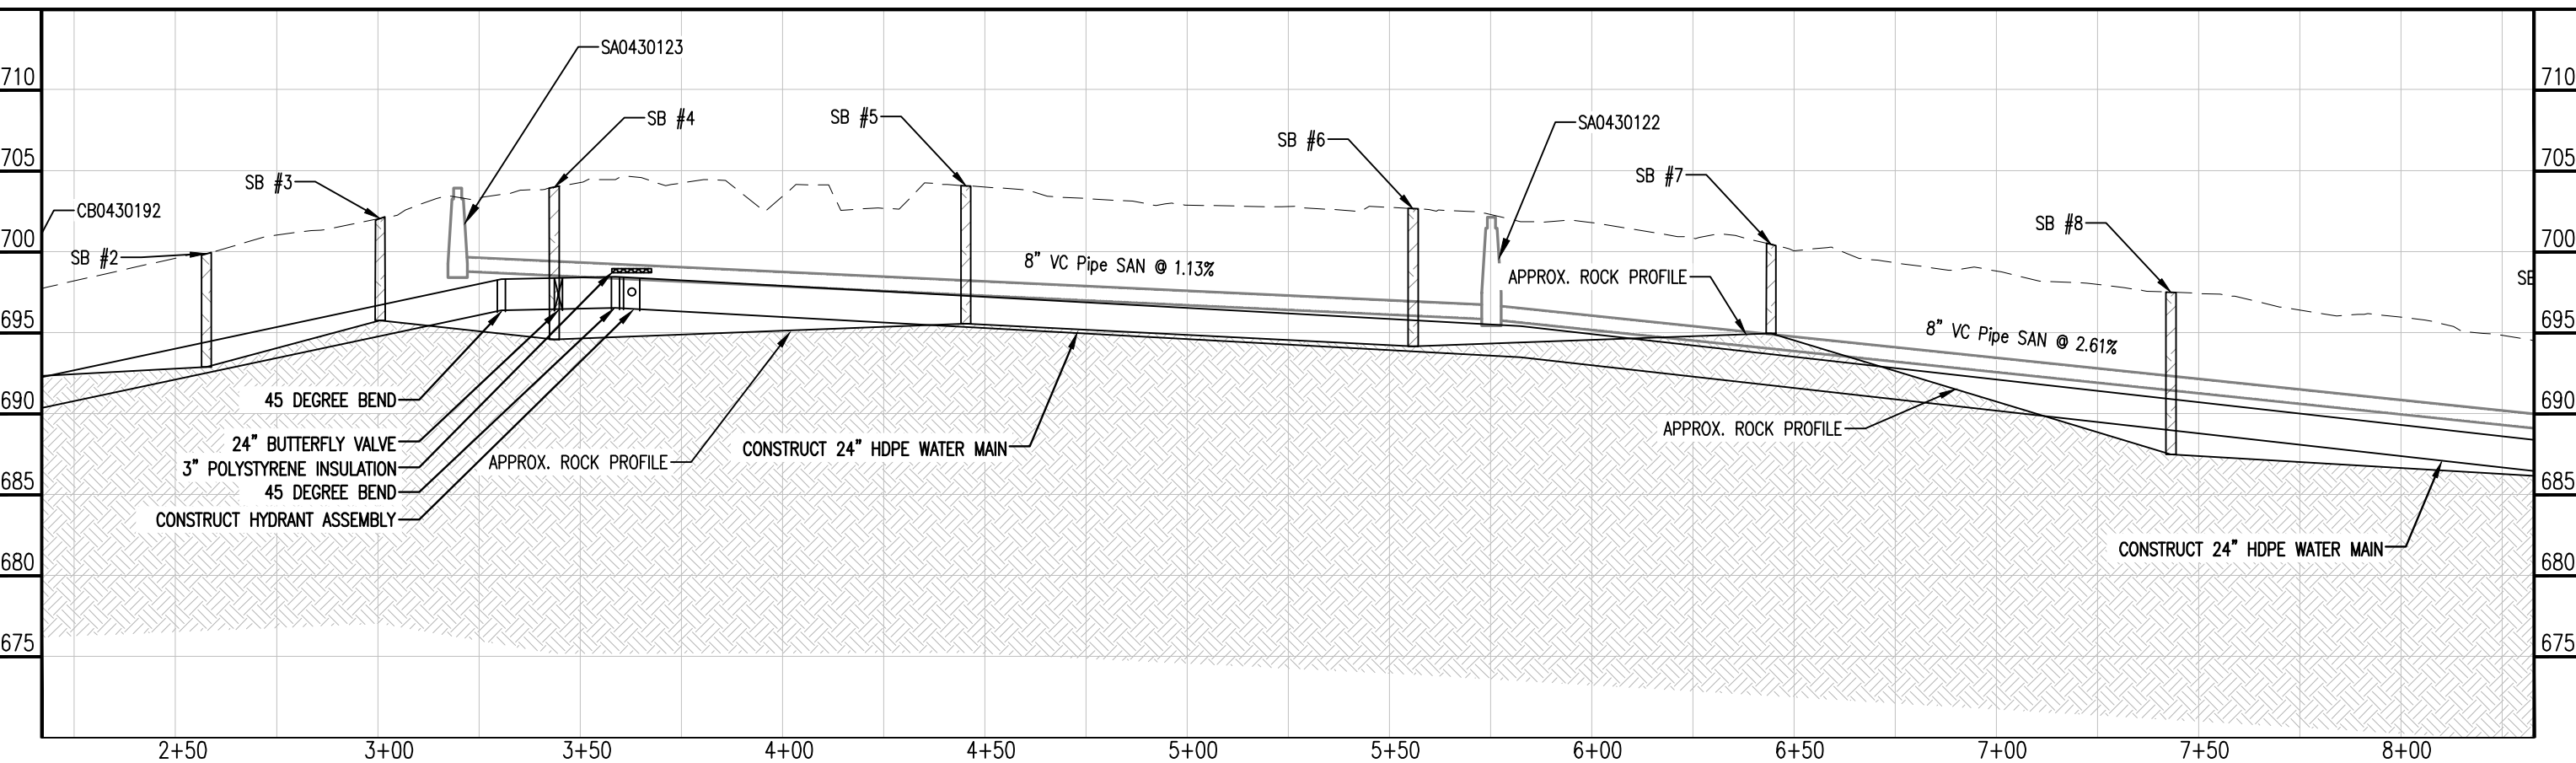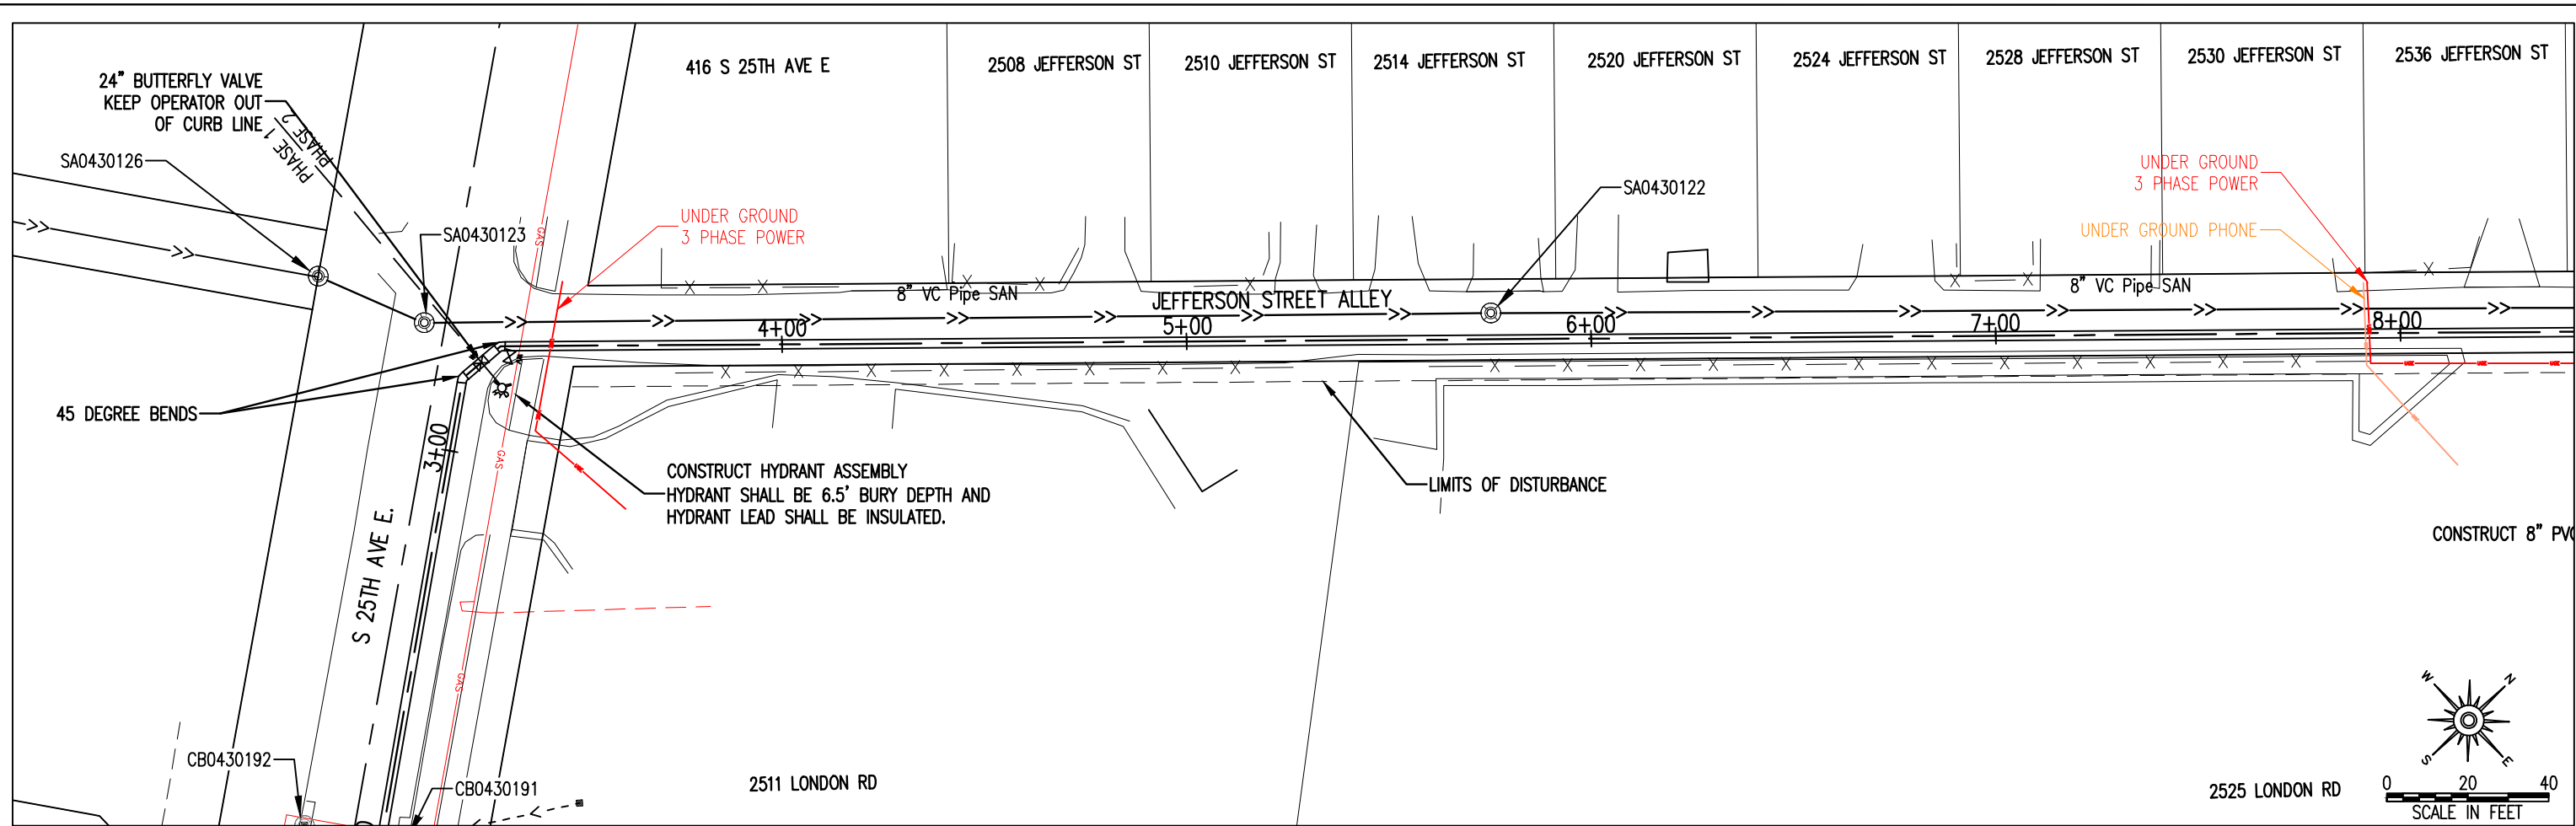

I HEREBY CERTIFY THAT THIS PLAN WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA.

SIGNATURE: *Howard Smith, P.E.*

HOWARD SMITH, P.E.
TYPE NAME

DATE: 5/15/2025

LIC. NO.: 46875



CITY OF DULUTH
ENGINEERING DIVISION
411 W. 1ST ST. STE. 240
DULUTH, MN 55802

26TH AVE E & LONDON RD WATER MAIN RELOCATION

CITY PROJECT NO.: 2306

STATE AID PROJECT NO.: NA

DRAWN BY: JAI
WATERMAIN PLAN AND PROFILE 2
SHEET NO. 16 OF 40